

Darnum Battery Energy Storage System

ADVERTISED PLAN

Risk Management Plan (including Fire Safety Study)

July 2026

This copied document to be made available
for the sole purpose of enabling
its consideration and review as
part of a planning process under the
Planning and Environment Act 1987.
The document must not be used for any
purpose which may breach any
copyright



Front cover – Darnum BESS site and surrounding area

Document history

Revision	Date	Description	By	Review	Approved
V1	24/10/2025	Initial draft following analysis of supplied information	FRC Project Team	FRC Review Team	G Taylor Managing Director
V2	15/02/2026	Updated following client feedback	FRC Project Team	FRC Review Team	G Taylor Managing Director
V2.1	9/04/2026	Updated following client feedback	FRC Project Team	FRC Review Team	G Taylor Managing Director
V2.2.	23/4/2026	Updated following client feedback	FRC Project Team	FRC Review Team	G Taylor Managing Director
V2.3	1/7/26	Updated with latest site layout diagram	FRC Project Team	FRC Review Team	G Taylor Managing Director

Fire Risk Consultants
PO Box 12, Glengarry VIC 3354
0487 750 287
This copied document to be made available for the sole purpose of enabling its consideration and review as part of a planning process under the Planning and Environment Act 1987. The document must not be used for any purpose which may breach any copyright.
www.fire-risk-consultants.com.au
Disclaimer and Information Statement

This report is issued by Fire Risk Consultants Pty Ltd and the information in this report is current as at the date of publication. Any Bushfire Emergency Plan or Bushfire Response Plan is current only at the date of issue as it is up to you to maintain the Australian Standard AS3959:2018 (or equivalent) and AS3745:2018 (or equivalent) for the property and/or building. Failure to maintain the property and/or building to these standards may compromise an insurance policy if currently covering any of your assets or those of any third party that may be consequentially affected due such failure. If not insured, and if you are seeking insurance, this report may not influence the decision of any insurer not to offer cover. To the extent permitted by law, Fire Risk Consultants Pty Ltd will not be held liable for any claims, demands, costs or expenses for any personal injury, property damage or death arising out of failure by you to maintain the property and/or building to AS3959:2018 (or equivalent) and AS3745:2018 (or equivalent).

The information and/or the recommendations contained in this report have been compiled and based on the information, records, data and any other sources of information supplied by you. Whilst we have exercised all due care and skill in compiling the report, you should confirm the accuracy and reliability of the information and material we have relied upon in producing the report. The information contained in the report is confidential and you should only read, disclose, re-transmit, copy, distribute or act in reliance on the information as you are authorised to do so. This report may also contain information, systems or data which is the property of Fire Risk Consultants Pty Ltd and Fire Risk Consultants Pty Ltd has in no way waived or altered in any way its ownership right, or provided consent for use by the report recipient, unless expressly provided in the report.

Any fire safety work, including but not limited to planned burning, back burning and/or fire suppression, on any property or building is specifically excluded from this report.

Where the term “**Bushfire prevention and mitigation related activities**” (or words to that effect) are used, this is to be defined as the clearance of vegetation in accordance with the Victorian State Government guidelines, including clearing and maintenance of existing fire breaks and/or fire access for fire fighters under electricity pylons and properties that have been constructed to Australian Standard AS3959 and/or the National Construction Code.

Contents

1	Introduction	5
2	Project Overview	8
2.1	Site development	8
2.2	Battery Energy Storage Systems	11
3	Existing conditions assessment	13
3.1	Site description and location	13
3.2	Risk indicators	14
3.2.1	Bushfire Management Overlay and Bushfire Prone Area	14
3.2.2	Bushfire history	17
3.2.3	Vegetation management activities	17
3.2.4	Vegetation classification	17
3.2.5	Battery Unit design fire	20
4	Risk assessment process	21
4.1	Clause 13.02-1S – Bushfire Planning Assessment	21
4.1.1	Bushfire Hazard Assessment	21
4.1.2	Bushfire Hazard Landscape Assessment	24
4.1.3	Bushfire Hazard Site Assessment	27
4.1.4	Radiant Heat Barrier	30
4.1.5	Assessment against Clause 13.02-1S Planning Objectives	32
4.1.6	Assessment against Clause 13.02-1S summary	37
4.2	Analysis against CFA Guidelines	38
4.3	Treatment summary	54
4.4	Risk Assessment	55
4.4.1	Introduction	55
4.4.2	Context	56
4.4.3	Analysis of fire risk	56
4.4.4	Risk identification	57
4.4.5	Risk analysis	58
4.4.6	Risk analysis worksheets	61
5	Conclusion	72
	Appendix A – UL9540A test sequence	73
	Appendix B – Flamesol Calculations	74

Appendix C – Radiant Heat Barrier Methodology.....77

Appendix D – Site photos80

**ADVERTISED
PLAN**

**This copied document to be made available
for the sole purpose of enabling
its consideration and review as
part of a planning process under the
Planning and Environment Act 1987.
The document must not be used for any
purpose which may breach any
copyright**

1 Introduction

ADVERTISED PLAN

Darnum BESS Pty Ltd (ACN 694 489 828) as trustee of the Darnum BESS Trust (ABN 84 694 489 828) (the Applicant), owned by Samsung C&T Renewable Energy Australia (SREA) (ABN 74 661 046 331), is proposing the development of the Darnum Battery Energy Storage System (the Project) at 875 Darnum Shady-Creek Road, Shady Creek, Victoria (the Project Site). The Project would involve the construction, operation and decommissioning of a Battery Energy Storage System (BESS) with a delivery capacity of up to approximately 200 Megawatts (MW) / 800 MWh (4 hr).

This Risk Management Plan (RMP) has been prepared as part of the Planning Permit Application for the Project which will be assessed by the Minister for Planning as the responsible authority. Fire Risk Consultants (FRC) has been engaged to prepare the RMP.

This RMP has been prepared in accordance with the *Design Guidelines and Model Requirements: Renewable Energy Facilities v4.4 (2023, updated June 2025)* (CFA Guidelines) and has been developed to support a planning permit application.

This report has been prepared following an assessment of the site and analysis of supplied information in relation to the design, construction, commissioning and operation of the proposed Project.

As the Project is at the planning application stage, the selection of a battery supplier has not been finalised however the Applicant has indicated that Tesla is preferred and being utilised for planning purposes. This is normal practice at this stage of a project, with the final design and supplier being confirmed and assessed as part of an update to this RMP (and other documentation) prior to the construction of the Project. Section 3.3 of the CFA Guidelines outlines the information required to support the development of an RMP. How this RMP addresses these requirements is outlined in Table 1.

Table 1 - CFA Guidelines requirements

CFA Guideline – RMP requirement	How this RMP addresses the requirement?
a) Describe the infrastructure (natural and built), landscape, nature of operations and occupancy of the facility.	Chapters 2 and 3
b) Describe the risks and hazards at the facility to and from the renewable energy infrastructure (including battery energy storage systems).	Chapters 3 and 4
C) Specify and justify, in accordance with Section 4.2 of the CFA Guidelines:	
The location of the facility within the landscape, and the proposed infrastructure on site.	Chapters 3 and 4.2
Emergency vehicle access to and within the facility that:	Chapter 4.1

- Includes site access points of a number suitable to the size and hazard of the facility (a minimum of two). - Provides access to renewable energy infrastructure, substations and fire service infrastructure.	
Firefighting water supply for the facility.	Chapter 4.1
A fire break width of 10m or greater, based on radiant heat flux (output) as an ignition source: - Around the perimeter of the facility. - Between any landscape buffer/vegetation screening and battery energy storage systems (and related infrastructure).	Chapter 4.1
The separation distance, based on radiant heat flux (output) as an ignition source, between: - Adjacent battery containers/enclosures. - Battery containers/enclosures and related battery infrastructure, buildings/structures, and vegetation.	Chapter 2.2, 3.2.2 and 4.1
All other controls for the management of on and off site hazards and risks at the facility (including all proposed battery energy storage system safety and protective systems).	Chapter 4.4.6
d) Provide an evidence-based determination of the effectiveness of the risk controls against the identified hazards, including justification for the omission of any battery safety and protective system/s.	Chapter 4.4.6
e) Form the basis for the design of the facility.	The outcomes of the assessment against the CFA Guideline and the risk assessment within Chapter 4 have influenced the design of the Project.

As per the CFA Guidelines, this report also aligns with the CFA *Fire Safety Studies for Battery Energy Storage Systems Guidelines (v1, June 2025)* and the NSW Planning's *Hazardous Industry Planning Advisory Paper 2: Fire Safety Study Guidelines (2011)* (Fire Safety Study Guidelines). The various requirements outlined within the Fire Safety Study Guidelines have been included within this report where it relates to the Project. Where the CFA Guideline provides specific requirements relating to matters that are outlined within the Fire Safety Study Guidelines, the CFA Guideline information has been utilised.

**ADVERTISED
PLAN**

In summary, the following sections of the Fire Safety Study Guidelines have been covered within this report.

Table 2 - Response to NSW Fire Safety Study Guideline

Section 2 summary	Response
Identification of fire hazards and the consequences of possible fire incidents	The CFA Guideline and National Fire Protection Authority (NFPA) 855 provides an outline of the types of fire hazards associated with renewable energy developments. This report analyses previous fire history (Chapter 3.2.2) and includes the assessment of risk resulting from these fire events and other information that is supplied by the developer and battery industry (Chapter 4.4.5).
Fire prevention strategies and measures	The outcome of the assessment of risk and the assessment of the design against the CFA Guideline and NFPA 855 has resulted in a range of fire prevention strategies and measures. These strategies and measures will be included within the Fire Management Plan and include their design and maintenance standards.
Analysis of the requirements for fire detection and protection and identification of the specific measures to be implemented	The CFA Guideline provides specific fire detection and protection requirements including the installation of a fire hydrant system, detection and suppression systems and bushfire protection measures. The specific installation measures are outlined in Chapter 4.2.
Calculation of firefighting water supply and demand	The CFA Guideline provides clear requirements to design and install the fire hydrant system to AS2419 – open yard protection requirements. This includes the development of a firefighting water supply and demand requirement.
Containment of contaminated firefighting water	The CFA Guideline provides the requirement to contain firefighting water to enable testing to occur before it is allowed to either enter the stormwater drainage system or needs to be sent to a disposal location.
First aid fire protection requirements.	The CFA Guideline imposes certain requirements along with the obligation on the operator to meet the occupational health and safety requirements imposed by various legislation. This includes the provision of fire extinguishers, warning signs, road access minimum requirements, staff training, induction programs and emergency management planning.

2 Project Overview

ADVERTISED PLAN

2.1 Site development

The Project would comprise the following key components:

- A 200 MW / 800 MWh BESS compound, including 196 battery modules, 49 x 6.36 MVA step-up transformers and associated cabling.
- An onsite 33/220 kV Project substation, including a 240 MVA HV transformer, switchgear / control rooms, harmonic filters and associated infrastructure.
- A switchyard to facilitate Project connection into the National Electricity Market (NEM) via the existing 220 kV overhead transmission line (Yallourn Power Station to Rowville Terminal Station) that runs across the southern portion of the Project Site.
- Ancillary infrastructure and works including site access, internal access roads and parking, operations and maintenance facilities, stormwater infrastructure, noise walls and radiant heat walls, fire water tanks and systems, asset protection zones, lightning protection, lighting, signage, security devices and fencing, landscaping/screening.

The Project would have a total development footprint of approximately 7 ha, inclusive of approximately 2.5 ha for the BESS compound, approximately 3.0 ha for the Project substation, switchyard and grid connection, along with approximately 1.5 ha for ancillary infrastructure external to the main infrastructure compounds.

Access to the Project is planned directly from Darnum-Shady Creek Road via a modified version of the existing crossover which currently provides access to the host dwelling and associated farm infrastructure and operations. A secondary access is also proposed off Darnum-Shady Creek Road near the southern site boundary and would function primarily as an emergency access.

The BESS would have a capacity of 200 MW active power and 800 MWh battery storage capacity, which would improve the stability of the NEM by storing electricity during period of low demand, and releasing during periods of high demand.

The Applicant is proposing to utilise the Tesla Megapack 3. Tesla is a mature and established provider in the Australian market. However, the final supplier, number and location of Project components are subject to refinement through detailed design, tender and procurement processes. Upper limit quantities and power level estimates are provided to ensure the assessment and any subsequent approval maintains the flexibility required in the detailed design stage following Project approval. Similarly, while an indicative design is provided, the delineation of the Project Site provides for the assessment and flexibility of minor layout changes in the final detailed design. Together this 'upper limit' or 'worst case' approach ensures that all impacts of construction, as well as operation and decommissioning, are considered and that any recommendations and mitigation strategies would be appropriate for the final detailed design. This approach would allow the Project to maximise potential benefits from the rapid technology advancements currently underway in the BESS industry.

Construction is expected to commence in 2027 and take up to 18 months to complete. For planning purposes, an indicative construction envelope of up to approximately 20.5 ha has been identified to encompass areas required for access, material and equipment laydown, staff parking and amenities, offices and construction water supply, along with temporary working buffers around the

development footprint. Not all of the indicative construction envelope is expected to be disturbed for construction of the Project. Additional temporary construction areas beyond the permanent infrastructure footprint would be minimised, wherever practicable, to reduce disturbance impacts, and would be investigated once the construction contractor is appointed and detailed construction scheduling / sequencing has been confirmed.

The Project would operate 24 hours a day, 7 days a week and has an expected 30-year operating lifespan. At the conclusion of this 30-year period, the BESS components may be replaced or refurbished to extend the life (subject to market conditions) or otherwise decommissioned.

The proposed Project concept layout plan is shown in Figure 1.

ADVERTISED PLAN

**This copied document to be made available
for the sole purpose of enabling
its consideration and review as
part of a planning process under the
Planning and Environment Act 1987.
The document must not be used for any
purpose which may breach any
copyright**

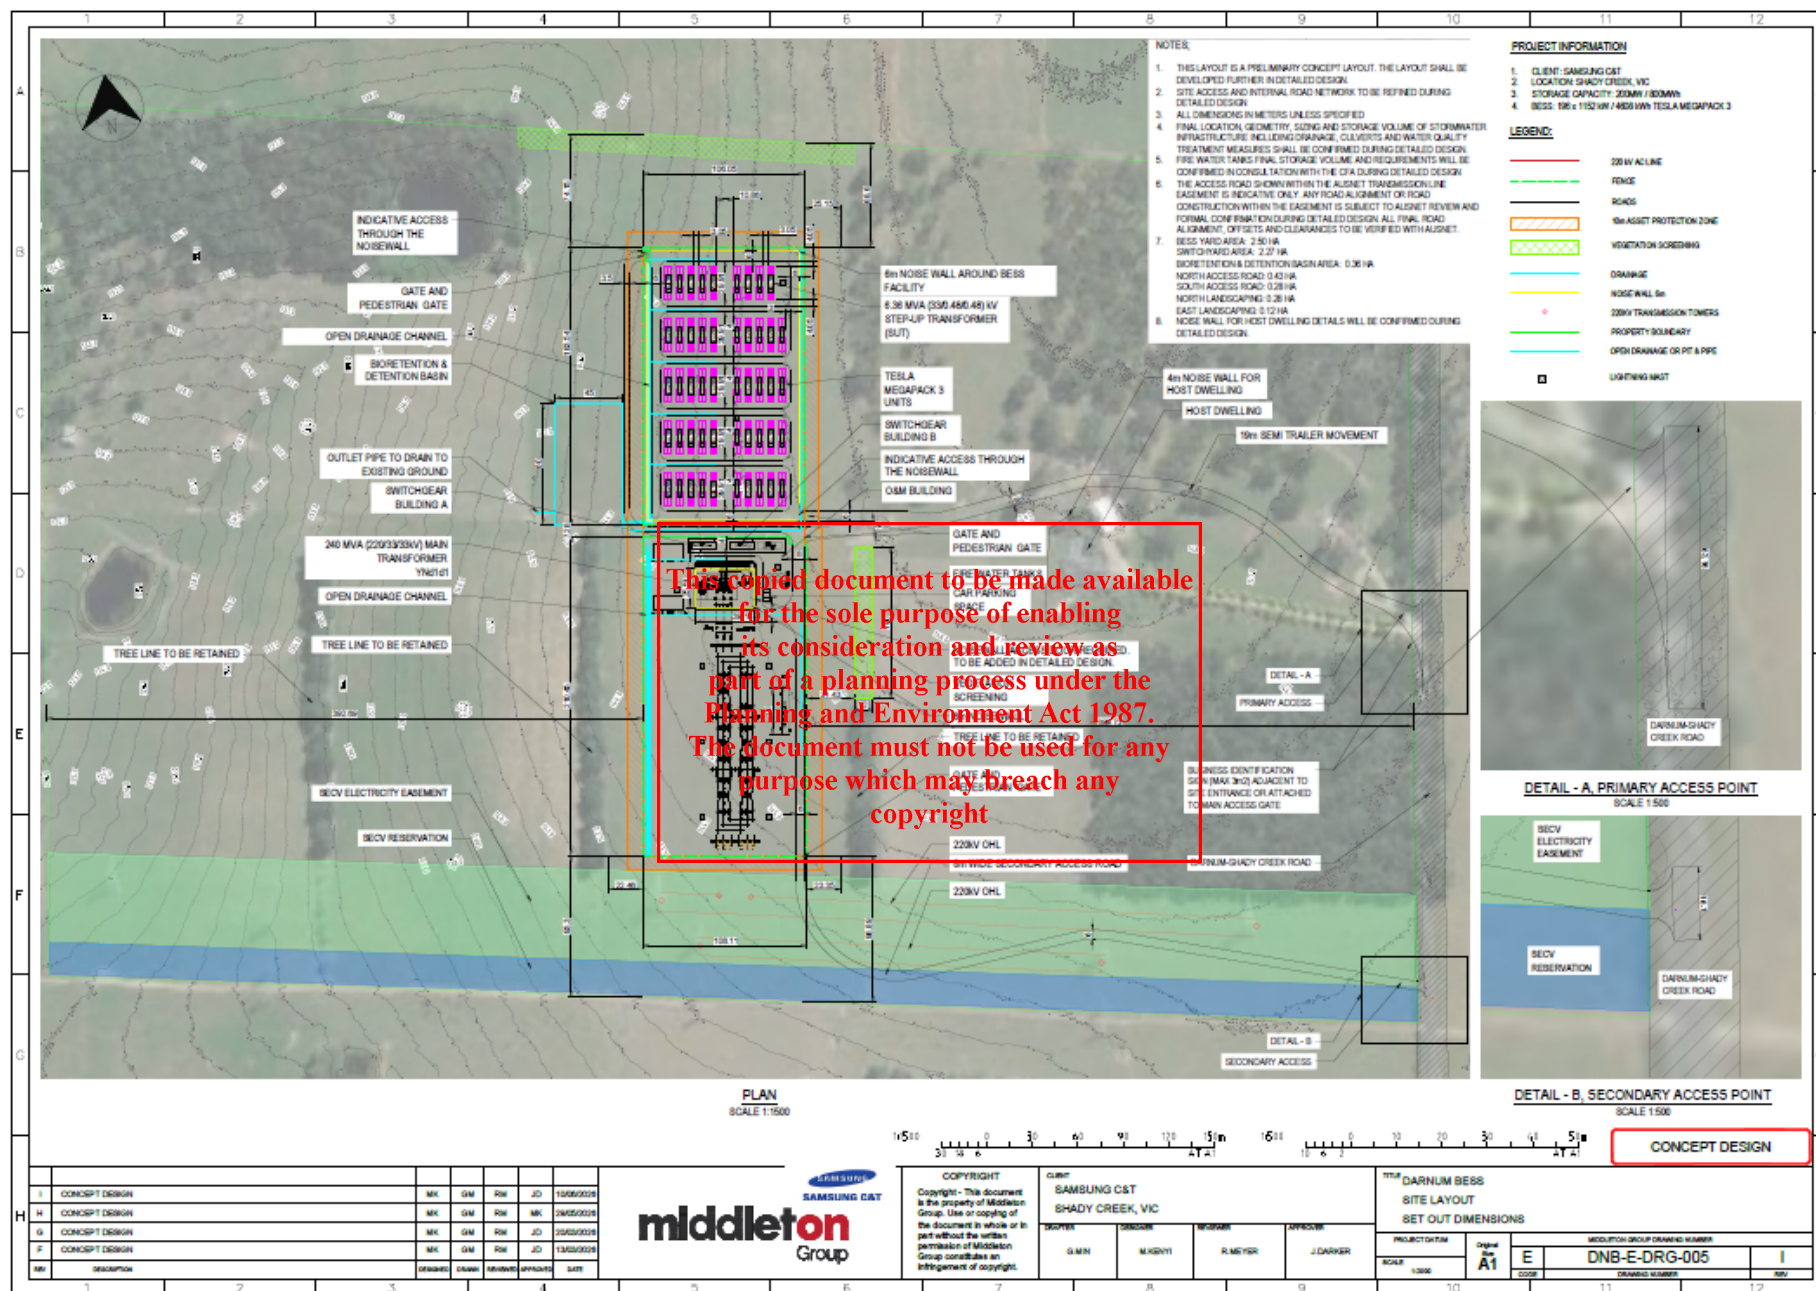


Figure 1 - Indicative Project Layout

**ADVERTISED
PLAN**

2.2 Battery Energy Storage Systems

Whilst not finalised, the Applicant has identified their preferred BESS technology is Tesla Megapack 3. Notwithstanding, across the industry there are numerous inconsistencies in the design, construction and installation of different Battery Units. This is mainly driven by the requirement to comply with International and Australian codes and standards. In relation to managing fire risk, the following standards and codes will be complied with:

- UL9540A Standard for Test Method for Evaluating Thermal Runaway Fire Propagation in Battery Energy Storage Systems
- UL9540 Energy Storage Systems and Equipment
- NFPA 855 Standard for the Installation of Stationary Energy Storage Systems.

The Battery Unit will likely be assembled offsite within the factory and arrive with a small charge and largely a plug-in type of arrangement. The product will be fitted with a range of systems that manage the Battery Units and receive and respond to various alerts, these are outlined in Table 3.

The equipment will be supplied with a range of manuals that address installation, maintenance and safety. The manuals will outline the outcomes of the various tests including UL9540A that demonstrates that the design of the system meets the requirements of UL9540.

Table 3 outlines the typical fire safety systems that are likely to be installed within the Battery Units:

Table 3 - Overview of fire safety systems

Fire Safety System	Description
Battery Management System (BMS)	The BMS constantly monitors cell and pack level voltage, temperature, State of Charge (SOC), and other parameters to ensure early detection of pre fault conditions, and immediate detection of fault events. Should any parameter exceed a permissible value, the BMS will disconnect the affected Battery Units and send an alarm to the monitoring centre. The BMS can be regularly updated as new technologies or learnings are introduced into the software
Early detection systems	The Battery Units will be fitted with a system to detect off gassing and fires. The Tesla Unit relies on a system of igniters to ensure off gassing is not released or becomes explosive.
Site Controller and	Beyond the built-in safeguards of the BMS described above, the Battery Units will have 24/7 remote monitoring, diagnostics, and troubleshooting capabilities, without the need to have a technician on site.

Fire Safety System	Description
Monitoring (SCADA)	Customers and first responders will benefit from immediate support from trained technicians via the monitoring centre. Additionally, the facility will have a local SCADA system.
Emergency system shutdown	In the event of an emergency on site, the Battery Units can be shut down locally, or remotely. A system shutdown will result in electrical isolation of the battery strings and cessation of battery charging or discharging.
IP Rating	The IP (Ingress Protection) rating varies for each manufacturer, but it will likely be elevated in that it will prevent ember ingress into the Battery Units. The IP rating is defined by the international standard EN 60529 (British Standard BS EN 60529:1992). The first digit relates to the ability for solids to enter the enclosure and the second digit indicates the ability for liquids to enter the enclosure. Most Battery Units are a minimum of IP55 rating (The Tesla Megapack is rated IP66). IP55 is classified as: - Ingress of dust is not entirely prevented, but it must not enter in sufficient quantity to interfere with the safe operation of the equipment. - Water projected by a nozzle (6.3 mm) against enclosure from any direction shall have no harmful effects. In the unlikely event of a bushfire in the surrounding vegetation that develops embers, the IP rating will likely reduce the ability for embers to enter the Battery Unit.
Explosion prevention	The chosen Battery Unit will comply with Clause 9.6.5.1.5 of NFPA 855. This clause permits compliance with either NFPA 68 or NFPA 69. The explosion prevention system that is provided will be designed to direct overpressure, and any other explosive events or flammable gases, away from the Battery Unit.
Unit separation	The preliminary design has allowed for 3.05m separation distances between the Units, which exceeds the recommended distances specified by Tesla.

ADVERTISED PLAN

ADVERTISED PLAN

3 Existing conditions assessment

3.1 Site description and location

The Project Site is located at 875 Darnum-Shady Creek Road, Shady Creek within the Gippsland region of Victoria approximately 7 km north of Darnum and 8 km north-east of Warragul. The Project Site comprises a single parcel of privately owned freehold land having a total area of approximately 51.2 ha and is located in the Baw Baw Shire Local Government Area (LGA).

The Project Site primarily comprises an open, agricultural landscape which has been largely cleared of native vegetation and is used for grazing. Patches of native vegetation and some scattered trees are present in the north-west, north-east, and south-east parts of the site. There are three shelterbelts of planted trees (Monterrey Cypress) within the central parts of the Project Site and two water bodies (farm dams) near the northern and western site boundaries.

The Project Site currently contains a dwelling, large shed and cattle yard which are located on the eastern part of the site and are accessed off Darnum-Shady Creek Road. The existing dwelling, large shed and cattle yard will remain on site during the operation of the BESS. The closest dwelling to the proposed Project is the host dwelling located approximately 160 m east of the BESS compound, with the closest neighbour dwellings located approximately 450 m west and approximately 480 m north of the BESS compound.

The existing 220 kV overhead transmission line (Yallourn Power Station to Rowville Terminal Station) into which the Project would connect, runs across the southern part of the Project Site within an easement held by Ausnet.

The proposed BESS is in the centre of the Project Site. The southeast and northwest vegetation is forest vegetation, while the north-east vegetation is consistent with the woodland classification. These vegetation patches are isolated, noting that the surrounding landscape is generally agricultural grassland, with sparse areas of woody vegetation mainly associated with shading for stock. Large areas of forested vegetation are located approximately 7 km to the north, with areas of forested vegetation extending south of the reserve being 5km from the site. The forested areas are associated with the Sweetwater Creek Nature Conservation Reserve and State Forests.

The Project Site is within the Bushfire Prone Area (BPA) and partially within the Bushfire Management Overlay (BMO). The site has a minor western 0-5° downslope.

The provision of two accessways has been identified to ensure responding emergency services have options when entering the site. The northern, primary access point would utilise the existing access to the host dwelling and would veer to the north around the large farm shed to meet the perimeter road at the southern end of the BESS compound. This access would be approximately 430 m in length and would require some modification of the existing crossover to accommodate construction vehicles, in particular any over-sized over-mass (OSOM) vehicles, which would be required to deliver components for the BESS and Project substation.

A secondary access point is proposed near the southern boundary within the existing AusNet easement and would function primarily as an emergency access. The final alignment, design, construction and clearances associated with this secondary emergency access would be confirmed with AusNet. However, consultation with AusNet to date has indicated that the provision of access for emergency vehicles as per the CFA Guidelines would be acceptable within the easement.

3.2 Risk indicators

In support of the risk assessment required by the CFA Guideline, the following information has been obtained and informs the analysis of risk. This information supports the assessment contained within Chapter 4.4. This information relates to the potential bushfire risk and the fire risk relating to a BESS installation.

3.2.1 Bushfire Management Overlay and Bushfire Prone Area

The BMO and BPA are legislative controls within the State of Victoria that are included within the planning and building systems. The BMO recognises areas identified by local councils, where the extent of vegetation can create an extreme bushfire hazard. The BPA is assigned to areas that are subject to, or likely to be subject to bushfires.

The Project Site is wholly located within the BPA and partially within the BMO. Figure 3 indicates the location of the BMO in relation to the site. Furthermore, as the property is within the BPA, this triggers an assessment against Clause 13.02-1S of the Baw Baw Planning Scheme.

**ADVERTISED
PLAN**

**This copied document to be made available
for the sole purpose of enabling
its consideration and review as
part of a planning process under the
Planning and Environment Act 1987.
The document must not be used for any
purpose which may breach any
copyright**

ADVERTISED PLAN



Figure 2 – Project Site overview

ADVERTISED PLAN



Figure 3 – BMO in relation to the Project Site (Note that BMO Schedule 1 and 2 does not exist within this area)

3.2.2 Bushfire history

The available data does not indicate any historical bushfire impact on the Project Site; however, it does indicate historical bushfire activity in the surrounding landscape, particularly to the north (Figure 4).

The largest bushfire to have impacted the local area occurred in 1939 and was associated with the Black Friday bushfires. This fire was the cumulation of several years of drought, high temperatures and strong winds¹. This fire reached within 1.9km of the site. However, the landscape is likely significantly different since this bushfire occurred. Extensive land clearing, changes in vegetation type and continuity, and the establishment of agricultural land uses would affect the extent and connectivity of available fuel in the area. In addition, the development of road networks and property boundaries has introduced further breaks in vegetation, which can limit fire spread and intensity. These changes alter the potential fire behaviour compared to the conditions present during the 1939 event, and reduce the likelihood of a bushfire of similar scale and intensity impacting the site under current landscape conditions.

Other bushfires have also occurred in the surrounding landscape; however, they are mostly associated with the forested landscape to the north. Except for the 1939 Black Friday bushfire, few bushfires have been recorded to have left the bushland interface in this area.

3.2.3 Vegetation management activities

Fuel reduction activities have been conducted in the surrounding landscape, including to the north of the site. Fuel reduction activities are planned in the future years as well, including in 2026 and 2027.

Future Planned burns detailed in the Joint Fuel Management Plan are shown in Figure 5. It is likely that the fuel reduction activities planned within the forested areas to the north of the site will influence bushfire activity.

3.2.4 Vegetation classification

The vegetation on the site and in the surrounding area is typical of the Alpine Ranges foothills. It is primarily dominated by grassland areas associated with stock grazing and cropping activities along with small patches of forested areas. The grassland vegetation can be easily modified to reduce the radiant heat impact onto the Project. The presence of the BMO indicates areas of treed vegetation that require further assessment. Refer to Section 4.1.3.

**ADVERTISED
PLAN**

This copied document to be made available for the sole purpose of enabling its consideration and review as part of a planning process under the Planning and Environment Act 1987. The document must not be used for any purpose which may breach any copyright

¹ <https://knowledge.aidr.org.au/resources/bushfire-black-friday-victoria-1939/>

ADVERTISED PLAN



Figure 4 - Fire history surrounding the Project Site.

ADVERTISED PLAN



Figure 5 - Joint Fuel Management Program.

3.2.5 Battery Unit design fire

Initial scoping has identified potential BESS suppliers, with the current preferred technology being the Tesla Megapack 3. This system is understood to be capable of meeting the minimum requirements outlined below. Final supplier selection will remain subject to compliance with the requirements defined in this RMP.

The minimum requirements include:

- The Battery Unit and its components have been tested in accordance with the UL9540A test method.
- The BESS supplier has undertaken a large-scale fire test to demonstrate that the separation between the Battery Units is sufficient.

Prior to construction, and once a BESS supplier is finalised, more detailed analysis will be undertaken to ensure the outcomes of fire testing meets the requirements of the CFA Guidelines. The available data will provide a range of information including:

- The likely radiant heat impact on adjoining Battery Units from a fully involved Battery Unit fire.
- The performance of the cell, module and unit when exposed to elevated temperatures as specified within UL9540A.
- The required separation distances to prevent fire spread between Battery Units.

**ADVERTISED
PLAN**

**This copied document to be made available
for the sole purpose of enabling
its consideration and review as
part of a planning process under the
Planning and Environment Act 1987.
The document must not be used for any
purpose which may breach any
copyright**

4 Risk assessment process

To effectively assess the fire risk associated with the proposal, this report assesses risk using the following frameworks:

- Assessment against Clause 13.02 – 1S of the Baw Baw Planning Scheme (Chapter 4.1).
- Assessment against the requirements of the CFA Guidelines (including the Fire Safety Study requirements outlined within the NSW Fire Safety Study Guidelines) (Chapter 4.2).
- Risk assessment that meets section 5 of the CFA Guidelines (Chapter 4.2 and 4.4).

The risk assessment is based on the information outlined in this report along with industry best practices and our professional expertise.

4.1 Clause 13.02-1S – Bushfire Planning Assessment

Clause 13.02-1S of the Baw Baw Planning Scheme is utilised to support the assessment of bushfire risk. The Clause 13.02-1S policy aims to strengthen the resilience of settlements and communities and prioritise protection of human life through several objectives. However, it should be noted the Project does not introduce new settlements into the landscape. The assessment has been undertaken within the context of a BESS development.

4.1.1 Bushfire Hazard Assessment

Elevated bushfire risk in southeast Australia is often dominated by strong and gusty north westerly winds followed by a south westerly change that normally occurs in the afternoon or early evening. While it is acknowledged that bushfires may approach from other directions, these conditions have historically caused the loss of life and property and are usually associated with elevated fire danger warnings issued by the fire agencies.

Figure 6 and Figure 7 provide an overview of the likely bushfire scenarios within the surrounding area. There is the potential for bushfires to approach from a north westerly or south westerly direction. It is acknowledged that bushfires can approach from other directions, however, they are unlikely to be as severe as those that approach from the northwest or southwest.

Clause 13.02-1S outlines the need to assess the bushfire hazard based on:

- Landscape conditions - meaning conditions in the landscape within 20 kilometres (and potentially up to 75 kilometres) of a site
- Local conditions - meaning conditions in the area within approximately 1 kilometre of a site
- Neighbourhood conditions - meaning conditions in the area within 400 metres of a site; and
- The site for the development

Considering the landscape factors, the consideration and assessment of the bushfire hazard can be effectively achieved using a methodology that includes the site, one kilometre and 20 kilometres from the development.

ADVERTISED PLAN

Table 4 - Assessment against Clause 13.02

Bushfire hazard type	Conditions	Likely Scenario	Considerations
The site for the development	Once completed, the BESS will comply with the conditions specified within the CFA Guidelines that include the management of vegetation around the Project during the fire danger period. During construction, there is a risk of a fire igniting and spreading through unmanaged grassland vegetation.	A bushfire starting on the property is a possibility during the construction phase of the Project. Fires starting because of construction or operational activities have the potential to leave the property and enter adjoining areas. There are sufficient grassed areas and connectivity in some directions for a fire to spread rapidly under elevated fire danger conditions. A fire would have access to woodland or forest fuels on site, but these areas are limited and do not provide significant connectivity to the surrounding landscape (beyond grassland). Management of vegetation during the construction phase will occur regularly and be maintained during the fire danger period. Following construction, the Project will be managed as per the requirements of the Fire Management Plan that conforms with the CFA Guidelines.	During the construction phase, if the vegetation on site is retained, it will be managed during the fire danger period. During the fire danger period the grassed areas will be managed as per the CFA Guideline requirement. Hot works are not to occur within 10 metres of vegetation (including grass and other plants) during the fire danger period. When the fire danger conditions are elevated (Catastrophic Fire Danger Rating), the Emergency Management Plan will outline procedures to close the site during the construction phase and limit operations unless critical. The access roads will be established at the commencement of the construction phase and be maintained for the life of the Project.
Neighbourhood and local conditions (one kilometre)	Within one kilometre of the development, the surrounding landscape is generally grassland with some groups of woody vegetation, particularly to the northwest.	The likely scenario is for a fire to start in the broader landscape and travel towards the site under north westerly or south westerly wind conditions. Under strong wind conditions a grassfire can travel quickly across the landscape. Grassfires are heavily influenced by	The vegetation management around the BESS will limit the impact of a fire. The vegetation management requirements will limit the chances of a bushfire

This copied document to be made available for the sole purpose of enabling its consideration and review as part of a planning process under the Planning and Environment Act 1987. The document must not be used for any purpose which may breach any copyright.

ADVERTISED PLAN

Bushfire hazard type	Conditions	Likely Scenario	Considerations
	To the southwest, the landscape is generally grassland with single lines of trees present. There is also the potential for a bushfire to start along the surrounding road network or on surrounding properties. The surrounding road network provides access and egress opportunities for emergency services.	the quantity of fuels within the paddocks and the wind strength. The forested vegetation to the northwest would likely contribute towards localised ember attack and slightly elevated levels of radiant heat.	starting on the site and impacting on the surrounding landscape. The BESS area and associated infrastructure will be provided with adequate setback from unmanaged vegetation.
Landscape conditions (20 kilometres)	The landscape hazard surrounding the development mostly consists of grassland associated with agricultural land. To the north is an extensive forest landscape associated with State Forests and National Parks. However, this is located approximately 7km from the site, with associated forested vegetation extending south from these areas to within 5km of the Project Site. To the southwest the landscape is generally grassland. An area of forest associated with Mount Worth State Park is located approximately 13.5km to the south of the site.	The likely bushfire behaviour that will result in the greatest intensity and risk to the development is typically from either the northwest or southwest. In the context of this development, the likely impact would be from the north. The forested landscape to the north would allow for a bushfire to approach the site over days or weeks. However, over 5km of grassland and mixed fuels would reduce the intensity of the fire as it approaches the site. Similarly, to the southwest, the landscape is generally grassland, except for the forested areas 13.5km to the south. The likely impact from the landscape is generally limited to long distance ember attack.	The protection of the Project through the provision of vegetation management arrangements will reduce bushfire intensity. The vegetation management arrangements will be effective regardless of the fire starting locally or having travelled to the site. The risk of ember attack can be dealt with through the provision of suitable IP ratings.

4.1.2 Bushfire Hazard Landscape Assessment

Figure 6 and Figure 7 show the outcome of the bushfire landscape assessment. The assessment identifies the two likely scenarios that may occur in relation to the Project. Both scenarios are possible, however would be influenced by the surrounding landscape that includes varying farming activities, roads and other landscape features. Table 5 provides a description of each of the scenarios.

Table 5 - Bushfire Scenarios

Scenario	Description
Northwest – Scenario A	A bushfire originating in the forested landscape to the north would face challenges in reaching the project site. It would need to traverse approximately over 5km of grassland and mixed fuels would reduce the intensity of the fire before reaching the BESS. While the fire might continue to burn through the grassland environments to the north, it would be slowed or halted at the roads to the north, including Old Sale Road. However, under elevated fire danger conditions, embers generated from the forested areas could ignite grassfires near the site. At the local level, elevated fire danger conditions and the presence of the forested areas closer to the site could contribute to ember attack and some levels of radiant heat. However, the road network on neighbouring properties and cleared residential areas are likely to influence fire behaviour. Potential local bushfire ignition sources from the northwest include vehicles along roadsides, farming machinery, or arson. In the forested area farther to the north, lightning strikes could also cause bushfires.
Southwest – Scenario B	A bushfire originating from the forested area to the south associated with Mount Worth State Park would be able to burn across approximately 10km of forested vegetation. However, there is approximately 13.5km of grassland vegetation and landscape barriers, such as roads, managed properties, and towns between the forested landscape and the BESS, which would assist in controlling the fire and limiting impact. If a fire travelled to or started in the neighbouring property, the presence of grassland fuels would allow the fire to move quickly under prevailing wind conditions. However, ember attack and radiant heat output would be limited. Under lower fire danger conditions, the landscape features, including residential properties, roads and other fuel reduced areas, lessen or stop the bushfire risk to the BESS.

**ADVERTISED
PLAN**

This copied document to be made available for the sole purpose of enabling its consideration and review as part of a planning process under the Planning and Environment Act 1987. The document must not be used for any purpose which may breach any copyright

ADVERTISED PLAN



Figure 6 – 400 metre and 1 kilometre Bushfire Hazard Landscape Assessment

ADVERTISED PLAN

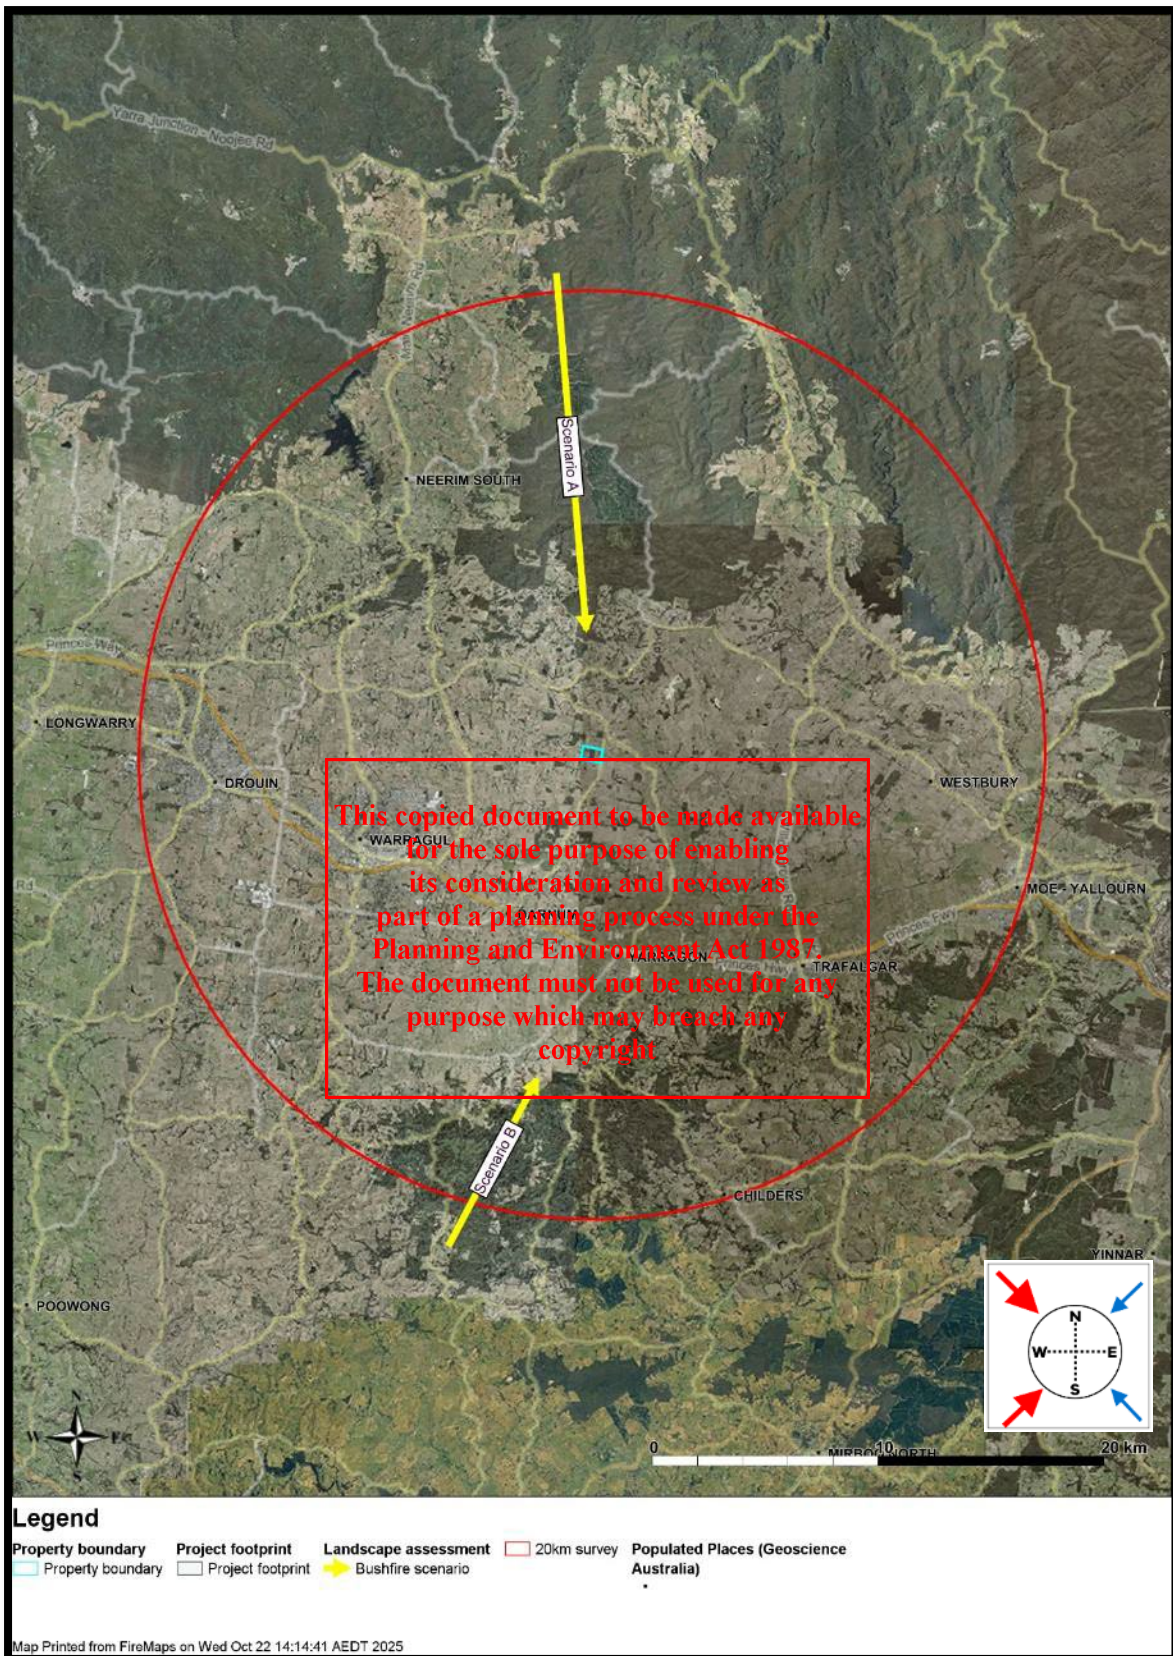


Figure 7 - 20-kilometre Bushfire Hazard landscape Assessment

ADVERTISED PLAN

4.1.3 Bushfire Hazard Site Assessment

The bushfire hazard within 400 metres is outlined within Figure 8 and Table 6.



Figure 8 - Bushfire Site Hazard Assessment

Table 6 - Bushfire Site Hazard Assessment vegetation assessment

Plot	Vegetation classification	Slope	Separation distance
1	Class A - Forest	Flat	83.55 m
2	Class B – Woodland	Flat/upslope	148.6 m
3	Class A - Forest	Flat/upslope	179.5 m
4	Class A - Forest	Flat/upslope	121.6 m
5	Class A - Forest	2.5° downslope	343.8 m
6	Class G – Grassland	4° downslope	0 m
7	Class G - Grassland	Flat/upslope	0 m
8	Excluded – Clause 2.2.3.2 (AS3959)	N/A	N/A

The assessment of vegetation has identified multiple plots within the 400 metre assessment area outlined in Figure 8. Vegetation is classified according to AS3959. The forest and woodland vegetation is associated with the BMO with an additional 150 metre buffer.

The Project incorporates an Asset Protection Zone of at least 10 metres to the adjoining grassland, as shown on the concept design plan. This setback is consistent with this type of Project . The separation from the forest and woodland will be sufficient to reduce radiant heat flux exposure to <10kW/m² from all plots identified.

This is shown in Figure 9. Flamesol outputs are presented in Appendix B – Flamesol Calculations.

ADVERTISED PLAN

This copied document to be made available for the sole purpose of enabling its consideration and review as part of a planning process under the Planning and Environment Act 1987. The document must not be used for any purpose which may breach any copyright

ADVERTISED PLAN



Figure 9 - Radiant heat exposure from Forest and Woodlands within 400m

4.1.4 Radiant Heat Barrier

A radiant heat barrier reduces heat exposure by blocking or absorbing a portion of radiant energy between a fire source and a structure. The modelling approach, based on the view factor method from AS3959, quantifies how much of the fire's radiant energy reaches a receiver (the Project). When a barrier exists between the fire and the structure, it intercepts part of the emitted radiation, lowering the effective heat load on the structure. Often radiant heat barriers also serve as a noise wall providing the specifications address both matters.

The process involves three steps:

1. Calculate the view factor for an unobstructed line of sight between the fire and the site.
2. Determine the view factor of the barrier, using its effective height and position relative to the fire.
3. Subtract the barrier's view factor from the original to obtain the adjusted heat flux (kW/m^2) at the site.

For modelling, the barrier is treated as a vertical surface equal in width to the flame front. It must be durable enough to resist the bushfire's duration and intensity without becoming a secondary emitter. The method assumes uniform barrier height and does not account for flame contact or ember attack. When the barrier is offset from the vegetation edge, trigonometric adjustment is used to determine its effective shielding height.

The methodology underpinning the process is provided in more detail in Appendix C – Radiant Heat Barrier Methodology.

The radiant heat barrier and adjusted radiant heat flux exposure are presented in Figure 10. The Flamesol calculator output is presented in Appendix B – Flamesol Calculations.

**This copied document to be made available
for the sole purpose of enabling
its consideration and review as
part of a planning process under the
Planning and Environment Act 1987.
The document must not be used for any
purpose which may breach any
copyright**

**ADVERTISED
PLAN**

ADVERTISED PLAN

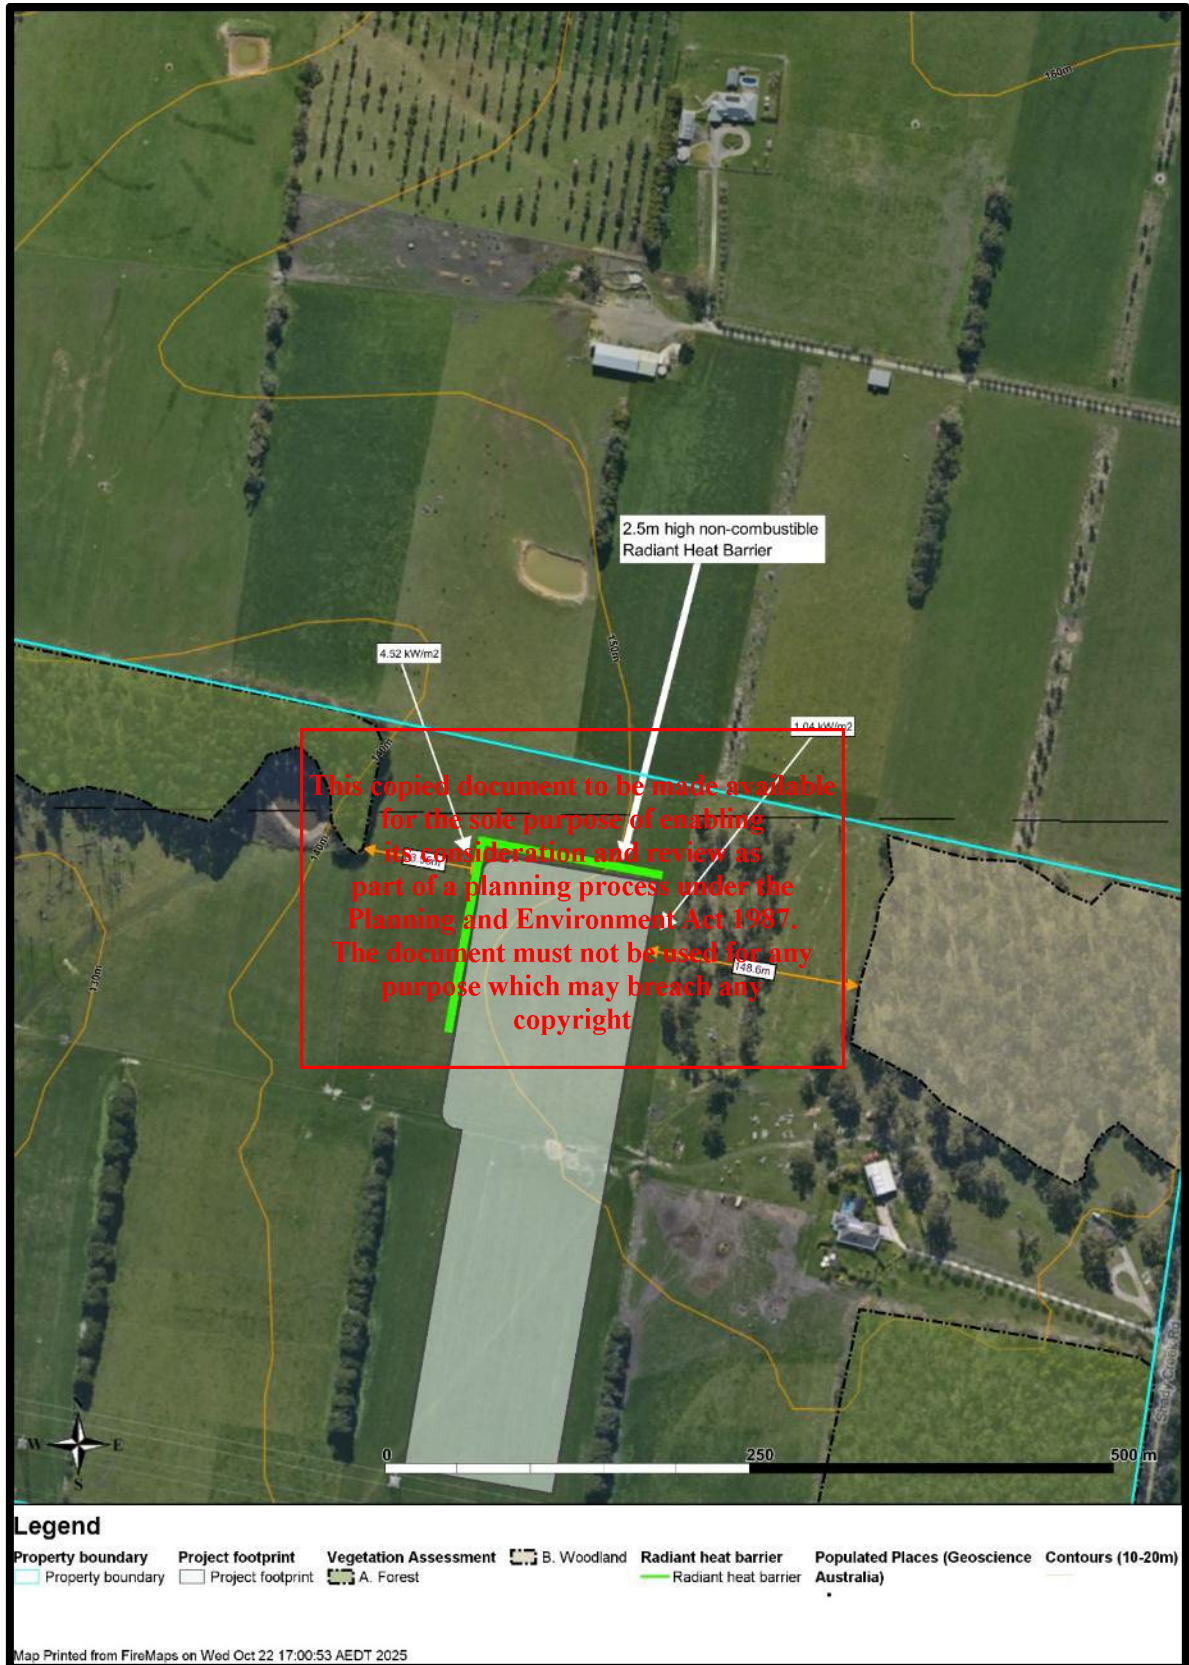


Figure 10 - Radiant heat barrier location and adjusted radiant heat flux

ADVERTISED PLAN

4.1.5 Assessment against Clause 13.02-1S Planning Objectives

Table 7 - Response to Clause 13.02 – Protection of human life objectives

Protection of Human Life Objectives	Project response	Achieved (✓ or ✕)
Prioritising the protection of human life over all other policy considerations.	Protection of human life is prioritised through the siting, design, and operation of the Project. The Project is not a residential or population-based land use and will have limited personnel onsite.	✓
Directing population growth and development to low risk locations and ensuring the availability of, and safe access to, areas where human life can be better protected from the effects of bushfire.	The Project is located within an agricultural landscape with low surrounding fuel loads and significant separation from forested areas. The layout provides perimeter roads and asset protection zones in accordance with CFA guideline requirements. Access is provided via primary and secondary entry points, which allow responding emergency services options when entering the site. The Project will not substantially increase population growth in the area and is also generally considered low risk.	✓
Reducing the vulnerability of communities to bushfire through the consideration of bushfire risk in decision making at all stages of the planning process.	Bushfire risk has informed planning and design at all stages. The assessment considers landscape, neighbourhood, and site-level hazards. The Project incorporates measures including vegetation management, firebreaks, water supply, emergency access, and operational controls to reduce ignition risk and limit fire spread.	✓

This copied document to be made available for the sole purpose of enabling its consideration and review as part of a planning process under the Planning and Environment Act 1987. The document must not be used for any purpose which may breach any copyright.

Table 8 - Response to Clause 13.02 – Bushfire hazard identification and assessment objectives

Protection of Human Life Objectives	Project response	Achieved (✓ or ✕)
Applying the best available science to identify vegetation, topographic and climatic conditions that create a bushfire hazard.	The site has been assessed as per AS3959 and has been supported by a site inspection. Classified Forest, Woodland and Grassland has been identified. An APZ will be applied to manage the grassland hazard. The woodland and forest vegetation is	✓

ADVERTISED PLAN

Protection of Human Life Objectives	Project response	Achieved (✓ or ✕)
	sufficiently far enough away that the hazard can be effectively managed. A radiant heat barrier will be provided between the northwestern forest and the BESS.	
Considering the best available information about bushfire hazard including the map of designated bushfire prone areas prepared under the <i>Building Act 1993</i> or regulations made under that Act.	The site is within the Bushfire Prone Area and partially within the Bushfire Management Overlay. Areas of forest and woodland associated with the site have been assessed, and appropriate setbacks and separation distances have been applied to reduce radiant heat exposure to acceptable levels. 10 metre asset protection zones have been applied to manage the grassland hazard.	✓
Applying the Bushfire Management Overlay to areas where the extent of vegetation can create an extreme bushfire hazard.	This property is located within the Bushfire Management Overlay and a design solution that meets the requirements has been proposed.	✓
Considering and assessing the bushfire hazard on the basis of: - Landscape conditions - meaning conditions in the landscape within 20 kilometres (and potentially up to 75 kilometres) of a site; - Local conditions - meaning conditions in the area within approximately 1 kilometre of a site; - Neighbourhood conditions - meaning conditions in the area within 400 metres of a site; and - The site for the development.	The site has been assessed using 400 m, 1 km and 20 km. The assessment found that bushfire risk is driven mainly by grassfire behaviour, with limited impact from distant forested areas, and that the risk can be reduced to an acceptable level through vegetation management, separation distances, and site controls.	✓
Consulting with emergency management agencies and the relevant fire authority early in the process to receive their recommendations and implement	Consultation with the CFA has informed the preparation of this Risk Management Plan. Consultation occurred with CFA on 7 th October 2025. CFA were provided an overview of the project and were provided	✓

ADVERTISED PLAN

Protection of Human Life Objectives	Project response	Achieved (✓ or ✕)
appropriate bushfire protection measures.	the opportunity to discuss the layout and design. The document aligns with CFA Guidelines and is intended to support permit conditions. It also establishes the basis for subsequent Fire Management and Emergency Management Plans, which will be prepared prior to construction.	
Ensuring that strategic planning documents, planning scheme amendments, planning permit applications and development plan approvals properly assess bushfire risk and include appropriate bushfire protection measures.	The Project has considered the bushfire risk and identified mitigations to offset this risk including: • Asset Protection Zone • Management of vegetation on the site • Separation of equipment to prevent fire spread • Emergency Management Plan that includes the response arrangements in the event of a bushfire.	✓
Not approving development where a landowner or proponent has not satisfactorily demonstrated that the relevant policies have been addressed, performance measures satisfied or bushfire protection measures can be adequately implemented.	The design solution for this Project demonstrates how the bushfire risk can be mitigated on the site.	✓

This copied document to be made available for the sole purpose of enabling its consideration and review as part of a planning process under the Planning and Environment Act 1987. The document must not be used for any purpose which may breach any copyright

Table 9 - Response to Clause 13.02 - Settlement Planning Objectives

Settlement planning objectives	Project response	Achieved (✓ or ✕)
Directing population growth and development to low risk locations, being those locations assessed as	This Project does not promote population growth and will only have people onsite during the construction phase and when	✓

ADVERTISED PLAN

Settlement planning objectives	Project response	Achieved (✓ or x)
having a radiant heat flux of less than 12.5 kilowatts/square metre under AS 3959-2009 Construction of Buildings in Bushfire-prone Areas (Standards Australia, 2009).	undertaking maintenance during the operations phase.	
Ensuring the availability of, and safe access to, areas assessed as a BAL-LOW rating under AS 3959-2009 Construction of Buildings in Bushfire-prone Areas (Standards Australia, 2009) where human life can be better protected from the effects of bushfire.	The Project results in areas that will achieve a BAL Low rating. In addition, multiple travel options are available away from the site to areas that are considered safer. Egress could be achieved to Darnum, Yarragon, Trafalgar or Warragul in an emergency. The direction the bushfire is approaching will influence the decision as to which direction to leave the Project Site. This will be addressed within the Emergency Management Plan that is developed for the Project. Multiple locations in the surrounding landscape will also provide BAL LOW areas, such as areas within Yarragon, Darnum, or Warragul.	✓
Ensuring the bushfire risk to existing and future residents, property and community infrastructure will not increase as a result of future land use and development.	The Project will be provided with a range of protection measures that will ensure the bushfire risk to existing and future surrounding properties will not increase. These measures include: • Asset Protection Zone (an area where vegetation is either managed or removed) surrounding the BESS footprint and other ancillary infrastructure areas. • An access road to be developed around the BESS footprint and maintained for the life of the Project. • Provision of firefighting water to support firefighting operations. • Battery safety systems, including early detection, monitoring, isolation and suppression systems to prevent escalation of fire events.	✓
Achieving no net increase in risk to existing and future residents,	The fire protection measures required by the CFA Guidelines ensure that there is no net	✓

This copied document to be made available for the sole purpose of enabling its consideration and review as part of a planning process under the Planning and Environment Act 1987. The document must not be used for any purpose which may breach any copyright.

Settlement planning objectives	Project response	Achieved (✓ or ✕)
property and community infrastructure, through the implementation of bushfire protection measures and where possible reducing bushfire risk overall.	increase in risk to existing and future residents. The site for the Project has been chosen to ensure adequate separation from existing dwelling, host landowners dwelling, and other infrastructure. The placement of the BESS location ensures the Battery Units are a reasonable distance from nearby roads to ensure egress routes are not disturbed.	
Assessing and addressing the bushfire hazard posed to the settlement and the likely bushfire behaviour it will produce at a landscape, settlement, local, neighbourhood and site scale, including the potential for neighbourhood-scale destruction.	The bushfire risk has been assessed at the landscape level. This has identified the potential for grassfires to approach from the northwest and southwest aspects. This Project will not change the current expected bushfire behaviour in the landscape.	✓
Assessing alternative low risk locations for settlement growth on a regional, municipal, settlement, local and neighbourhood basis.	As outlined previously, a BESS project is not a settlement. The CFA Guidelines requirements ensure the management of risk is occurring based on the landscape bushfire risk.	✓
Not approving any strategic planning document, local planning policy, or planning scheme amendment that will result in the introduction or intensification of development in an area that has, or will on completion have, more than a BAL-12.5 rating under AS 3959-2009 Construction of Buildings in Bushfire-Prone Areas (Standards Australia, 2009).	The Project does not involve any strategic planning document, local planning policy, or planning scheme amendment.	✓

**ADVERTISED
PLAN**

4.1.6 Assessment against Clause 13.02-1S summary

The assessment against Clause 13.02-1S has identified that the Project is within an area where bushfires are possible, but unlikely to directly impact the site. The bushfire risk is minorly influenced by the presence of forested areas in the landscape to the northwest and southwest. However, the impact to the site is most likely going to be from grassfires that start in the local area or spread from the landscape.

The Project has been designed to limit both the potential impact from grassfires impacting the site and to limit the risk of fires leaving the property and entering the surrounding landscape. As the Project is required to achieve the requirements outlined within the CFA Guidelines as a minimum, this will ensure that the settlement planning objectives are achieved.

**ADVERTISED
PLAN**

**This copied document to be made available
for the sole purpose of enabling
its consideration and review as
part of a planning process under the
Planning and Environment Act 1987.
The document must not be used for any
purpose which may breach any
copyright**

ADVERTISED PLAN

4.2 Analysis against CFA Guidelines

The CFA have developed guidelines (CFA Guidelines) that outline their requirements to address fire risk within renewable energy installations. These guidelines are anticipated to be aligned to likely conditions recommended by CFA to be included in a Planning Permit for the Project.

Table 10 outlines the model requirements from the CFA Guidelines and details how this influences the design. In addition, further analysis occurs (Chapter 4.4) that addresses the risk assessment requirements of the CFA Guidelines.

Table 10 - Response to CFA Requirements

Model requirement	Compliance	Comments
Section 2 – Consulting with CFA		
a) Where located within a Bushfire Prone Area, bushfire risk is addressed according to the Victoria Planning Provisions, Clause 13.02-1S (Bushfire Planning), through bushfire hazard identification and assessment (including a bushfire hazard site and landscape assessment). This assessment must include risks to the proposed technologies from the landscape (bushfire/grassfire).	✓	The Project is located in a BPA and partially within a BMO. The indicative layout and design of the Project demonstrates that it has and will be designed to prevent fires from occurring and the potential for fires to leave the property. As required by the CFA Guidelines, an assessment against Clause 13.02-1S has been undertaken in Chapter 4.1.
b) Address risks from proposed technologies through a comprehensive risk management process, documented in a Risk Management Plan.	✓	This RMP includes an analysis of risk to demonstrate the mitigation solutions are sufficient to manage the fire risk.
c) Indicate where the exact specifications of elements within the renewable energy facility will be determined during the detailed design phase, such as solar panel and wind turbine model/ manufacturer and battery chemistry.	✓	This RMP considers the indicative layout and design and identifies further design solutions to manage the fire risk. The RMP will be updated prior to construction, in accordance with any anticipated Planning Permit conditions, and for the final BESS supplier and Project layout. Additionally, informed by the RMP, a Fire Management Plan and Emergency Management Plan will also be developed.
d) Explicitly state that the following documentation will be prepared in	✓	This document is the Risk Management Plan (RMP), which (as discussed above) will be

ADVERTISED PLAN

Model requirement	Compliance	Comments
accordance with this guideline, in consultation with CFA, before development starts: • Risk Management Plan • Fire Management Plan • Emergency Management Plan		updated prior to construction. The outcomes of this assessment will inform the preparation of a Fire Management Plan and Emergency Management Plan.
Section 3 – Risk Management Plan		
A Risk Management Plan must be developed for all renewable energy facilities. The Risk Management Plan must:		
a) Describe the infrastructure (natural and built), landscape, nature of operations and occupancy of the facility.	✓	Refer to Chapter 2 and 3.
b) Describe the risks and hazards at the facility to and from the renewable energy infrastructure (including battery energy storage systems).	✓	Refer to Chapter 4.4.
c) Specify and justify, in accordance with Section 4.2 of [the CFA Guideline]:		
• The location of the facility in the landscape, and the proposed infrastructure on-site.	✓	Refer to Section 4.1 of this Table.
• Emergency vehicle access to and within the facility that: ○ Includes site access points of a number suitable to the size and hazard of the facility (a minimum of two). ○ Provides access to renewable energy infrastructure, substations and fire service infrastructure.	✓	Refer to Section 4.2.1 of this Table. This copied document to be made available for the sole purpose of enabling its consideration and review as part of a planning process under the Planning and Environment Act 1987. The document must not be used for any purpose which may breach any copyright

ADVERTISED PLAN

Model requirement	Compliance	Comments
Firefighting water supply for the facility.	✓	Refer to Section 4.2.2 of this Table.
- A fire break width of 10m or greater, based on radiant heat flux (output) as an ignition source: - Around the perimeter of the facility. - Between any landscape buffer/vegetation screening and infrastructure.	✓	Refer to Section 4.2.5 of this Table.
- The separation distance, based on radiant heat flux (output) as an ignition source, between: - Adjacent renewable energy infrastructure (e.g., between adjacent battery containers/enclosures). - Battery containers/enclosures and related battery infrastructure, buildings/structures, and vegetation.	✓	Refer to Section 4.2.5 and 4.2.6 of this Table. This copied document to be made available for the sole purpose of enabling its consideration and review as part of a planning process under the Planning and Environment Act 1987. The document must not be used for any purpose which may breach any copyright
All other controls for the management of on and off-site hazards and risks at the facility (including all proposed battery energy storage system safety and protective systems).	✓	Refer to Section 4.2 of this Table.
d) Provide an evidence-based determination of the effectiveness of the risk controls against the identified hazards, including justification for the omission of any battery safety and protective system/s.	✓	Refer to Chapter 4.4.6.

ADVERTISED PLAN

Model requirement	Compliance	Comments
e) Form the basis for the design of the facility.	✓	The outcomes of this assessment will form the basis of the design and is outlined within the available site plan.
Section 4- Facility Location and Design		
Section 4.1 – Facility Location		
Planning applications for all renewable energy facilities proposed in high-risk environments must address the following:		
a) An assessment against policy at Clause 13.02-1S (Bushfire Planning) where the facility is located in a Bushfire Prone Area (BPA).	✓	An assessment has been undertaken against Clause 13.02-1S and is contained within this RMP (see Chapter 4.1).
b) The impact of any ignitions arising from the infrastructure (solar panels, wind turbines, battery energy storage systems, electrical infrastructure) on nearby communities, infrastructure and assets.	✓	This report considers the potential impact of fires that leave the property. Refer to Table 17 for the assessment detail.
c) The impact of bushfire on the infrastructure (e.g. ember attack, radiant heat impact, flame contact).	✓	If embers landed on or around the site, the standard safety features fitted within the Battery Units would be sufficient to prevent new fire ignition. The Battery Units IP rating (discussed in Chapter 2.2) that ensures no dust sized particles can enter will also keep embers from entering the Battery Unit. The perimeter road and 10m fire break will maintain adequate separation from the grassland hazard. Following the assessment against Clause 13.02-1S, it is considered appropriate for a non-combustible radiant heat barrier to be installed along the sides of the BESS area that are closest to the forested vegetation. The other vegetation is considered far enough away that it would not impact the BESS during a bushfire event. The design and height are subject to the detailed design stage.

This copied document to be made available for the sole purpose of enabling its consideration and review as part of a planning process under the Planning and Environment Act 1987. The document must not be used for any purpose which may breach any copyright

ADVERTISED PLAN

Model requirement	Compliance	Comments
		Refer to Table 18 in Chapter 4.3 for the assessment detail.
d) Assessment of whether the proposal will lead to an increase in risk to adjacent land and how the proposal will reduce risks at the site to an acceptable level.	✓	This report considers this matter in Section 4.2 and provides various strategies to reduce the impact on the surrounding areas. The risk reduction strategies include: • Provision of a 10m APZ that provides separation from the surrounding grassland. • Setbacks from trees of at least 20 metres. • Provision of a perimeter road around the BESS Facility. • Vegetation management activities to occur across the site during the fire danger period.
This copied document to be made available for the sole purpose of enabling its consideration and review as part of a planning process under the Planning and Environment Act 1987.		
The document must not be used for any purpose which may breach any copyright		
a) Construction of a four (4) metre perimeter road within the perimeter fire break.	✓	A minimum four metre wide perimeter road will be provided around the BESS facility, as illustrated on the Project indicative layout.
b) Roads must be of all-weather construction and capable of accommodating a vehicle of fifteen (15) tonnes (e.g. no compacted earth).	✓	All areas where a vehicle can park or travel across including the formed access roads will be designed and constructed to accommodate a vehicle of 15 tonnes
c) Constructed roads should be a minimum of four (4) metres in trafficable width with a four (4) metre vertical clearance for the width of the formed road surface. Ensure any fencing along access routes allows for width of fire vehicles.	✓	This has been considered as part of the Project indicative design and will also be included within the final design. The road widths will be a minimum of four metres wide.

ADVERTISED PLAN

Model requirement	Compliance	Comments
d) The average grade should be no more than 1 in 7 (14.4% or 8.1°) with a maximum of no more than 1 in 5 (20% or 11.3°) for no more than fifty (50) metres.	✓	Significant undulation or steep slopes on site are not present. This requirement has been considered as part of the indicative design and compliance can be achieved.
e) Dips in the road should have no more than a 1 in 8 (12.5% or 7.1°) entry and exit angle.	✓	There are no roads that will require assessment of dips.
f) Roads must incorporate passing bays at least every 600 metres, which must be at least twenty (20) metres long and have a minimum trafficable width of six (6) metres. At least one passing bay must be incorporated where roads are less than 600 metres long.	✓	The access / perimeter roads are proposed to be 6m in width. Any access tracks with a width of less than 6m will need to incorporate passing bays every 600m. These will be included on final plans if they are required.
g) Road networks must enable responding emergency services to access all areas of the facility, including fire service infrastructure, buildings, battery energy storage systems and related infrastructure substations and grid connection areas.	✓	The indicative design provides two access and egress points from Darnum–Shady Creek Road. The primary access is centrally located along the eastern boundary and connects via the existing dwelling driveway. The secondary access is provided from Darnum–Shady Creek Road near the southeastern corner of the site and runs along the southern edge of the site. Refer to Figure 1 for more information. Roads will be of suitable construction and width for responding emergency services.
h) Provision of at least two (2) but preferably more access points to each part of the facility.	✓	See discussion above. The BESS footprint is provided with access from Darnum-Shady Creek Road.
The number of access points must be informed through a risk management process, in consultation with the CFA.		The indicative design provides two access and egress points from Darnum–Shady Creek Road. The primary access is centrally located along the eastern boundary and connects via the existing dwelling driveway. The secondary access is provided from Darnum–Shady Creek Road near the southeastern corner of the site and runs along the southern edge of the site. Refer to Figure 1 for more information.

This copied document to be made available for the sole purpose of enabling its consideration and review as part of a planning process under the Planning and Environment Act 1987. The document must not be used for any purpose which may breach any copyright

ADVERTISED PLAN

Model requirement	Compliance	Comments
		This is based on previous feedback from CFA.
Section 4.2.2 Firefighting Water Supply		
a) Water access points must be clearly identifiable and unobstructed to ensure efficient access.	✓	The fire hydrant system will be located and marked to enable efficient access for firefighters.
b) Static water storage tank installations must comply with AS 2419.1-2021: <i>Fire hydrant installations – System design, installation and commissioning</i> .	✓	The fire hydrant system will comply with this requirement.
c) The static water storage tank(s) must be an above-ground water tank constructed of concrete or steel.	✓	Static water tank(s) will be located adjacent to the primary accessway in an above-ground tank constructed of concrete or steel. This will be shown on the final plan.
d) The static water storage tank(s) must be capable of being completely refilled automatically or manually within 24 hours.	✓	The static water storage tank(s) will be capable of being manually filled within 24 hours of them being used. This process will be contained within the FMP.
e) The static water storage tanks must be located at vehicle access points to the facility and must be positioned at least ten (10) metres from any infrastructure (solar panels, wind turbines, battery energy storage systems, etc.).	✓	There is ample space on site to comply with this requirement, see the figure in Chapter 2.1. The final design will position all static water storage tanks more than 10m from site infrastructure.
f) The hard-suction point must be provided, with a 150mm full bore isolation valve (Figure 1) equipped with a Storz connection, sized to comply with the required suction hydraulic performance. <i>Adapters that may be required to match the connection are: 125mm, 100mm, 90mm, 75mm, 65mm Storz tree adapters (Figure 2) with a matching blank end cap to be provided.</i>	✓	The fire hydrant system will comply with this requirement. This copied document to be made available for the sole purpose of enabling its consideration and review as part of a planning process under the Planning and Environment Act 1987. The document must not be used for any purpose which may breach any copyright

ADVERTISED PLAN

Model requirement	Compliance	Comments
g) The hard-suction point must be positioned within four (4) metres to a hardstand area and provide a clear access for emergency services personnel.	✓	The fire hydrant system will comply with this requirement.
h) An all-weather road access and hardstand must be provided to the hard-suction point. The hardstand must be maintained to a minimum of 15 tonne GVM, eight (8) metres long and six (6) metres wide or to the satisfaction of the CFA.	✓	The fire hydrant system will comply with this requirement.
i) The road access and hardstand must be kept clear at all times.		As illustrated by the indicative layout, and described above, the Project will include appropriate access roads. During operations, due to the low number of staff and contractors that will be on the site, the potential for road access and hardstand areas to be blocked is highly unlikely. The Emergency Management Plan during the construction and operations phases, will include a requirement that if a fire has started requiring fire brigade to respond, and where it is safe to do so, all vehicles will be removed from the site.
j) The hard-suction point must be protected from mechanical damage (e.g. bollards) where necessary.	✓	The fire hydrant system will comply with this requirement.
k) Where the access road has one entrance, a ten (10) metre radius turning circle must be provided at the tank.	✓	There are no access roads that will require a turning circle to be provided.
l) An external water level indicator must be provided to the tank and be visible from the hardstand area.	✓	The fire hydrant system will comply with this requirement.
m) Signage indicating 'FIRE WATER' and the tank capacity must be fixed to each tank.	✓	The fire hydrant system will comply with this requirement.

This copied document to be made available for the sole purpose of enabling its consideration and review as part of a planning process under the Planning and Environment Act 1988. The document must not be used for any purpose which may breach any copyright

ADVERTISED PLAN

Model requirement	Compliance	Comments
n) Signage must be provided at the front entrance to the facility, indicating the direction to the static water tank.	✓	The fire hydrant system will comply with this requirement.
Battery Energy Storage Systems		
1) For facilities with battery energy storage systems, the fire protection system must include as a minimum:		
a) Where reticulated water is available, a fire protection system as per Model Requirement (1a) under 'Centralised Battery Energy Storage Systems' <i>[Not applicable to this Project]</i> .		
b) Where no reticulated water is available, a fire hydrant system that complies with AS 2419.1-2021 must be provided.		
i. The fire water supply must be of a quantity no less than 288,000L or as per the provisions of AS 2419.1-2021: Fire hydrant installations, Table 2.2.5(D) for open yards flowing for a period of no less than four hours at 20L/s, whichever is the greater.	✓	A fire hydrant system that meets the requirements of AS2419.1:2021 will be provided. A fire water supply of 432,000 litres will be provided. The tank locations will be shown on the final plans, located adjacent to the primary accessway.
ii. The quantity of static fire water storage is to be calculated from the number of hydrants required to flow from AS 2419.1-2021: Fire hydrant installations, Table 2.2.5(D). (E.g., For battery installations with an aggregate area of over 27,000m ² , 4 (four) hydrant outlets are required to operate at 10L/s for four hours, which equates to a minimum static fire water supply of 576kL.)	✓	The aggregate area of the BESS footprint in the current design is approximately 19,000 m ² , requiring 30 l/s performance from the fire hydrant system. Note: the substation area has been excluded from this calculation.
iii. Fire hydrants must be provided and located so that every part of the battery energy storage system is within reach of a 10m hose stream issuing from a nozzle at the	✓	The fire hydrant design will ensure this requirement is met.

ADVERTISED PLAN

Model requirement	Compliance	Comments
end of a 60m length of hose connected to a fire hydrant outlet.		
iv. The fire water supply must be located at vehicle entrances to the facility, at least 10m from any infrastructure (electrical substations, inverters, battery energy storage systems, buildings).	✓	A Water tank location will be located more than 10m from any infrastructure. The figure provided in Chapter 2 and the final design will comply with this requirement.
v. The fire water supply must be reasonably adjacent to the battery energy storage system and shall be accessible without undue danger in an emergency. (E.g., Fire water tanks are to be located closer to the site entrance than the battery energy storage system)	✓	The fire water tanks will be located at the primary accessway to the BESS. This will be included on final plans.
Section 4.2.3 Fire Detection and Suppression Equipment		
Suitable fire detection and suppression equipment must be provided:		
a) For on-site buildings and structures, according to the requirements of the National Construction Code.	✓	The buildings will comply with the National Construction Code where required.
b) For storages of dangerous goods, according to the requirements of any Australian Standards for storing and handling of dangerous goods.	✓	The storage of dangerous goods will comply with the requirements of any Australian Standards for storage and handling of dangerous goods. This requirement will be included in the Fire Management Plan for the project.
c) For electrical installations, a minimum of two (2) suitable fire extinguishers must be provided within 3m-20m of each PCU.	✓	Fire extinguishers will be provided across the site. This requirement will be further reinforced within the Fire Management Plan.
d) In all vehicles and heavy equipment, each vehicle must carry at least a nine (9)-litre water stored-pressure fire extinguisher with a minimum rating of 3A, or other firefighting equipment as a	✓	This requirement will be specified within the Fire Management Plan.

ADVERTISED PLAN

Model requirement	Compliance	Comments
minimum when on-site during the Fire Danger Period.		
Section 4.2.5 – Fire Breaks		
A fire break must be established and maintained around:		
a) The perimeter of the facility, commencing from the boundary of the facility or from the vegetation screening inside the property boundary.	✓	Vegetation within the Project Site will be managed during the fire danger period. A 10 m APZ will be provided around the BESS compound, as well as a 10 m APZ around other buildings. A 20 m setback from screening vegetation will be provided for all infrastructure. The BESS footprint surfaces will be covered with concrete or other non-combustible surface products. The BESS will also have a road running between the BESS units, as well as a perimeter road around the compound.
b) The perimeter of control rooms, electricity compounds, substations and all other buildings onsite. <i>The width of fire breaks must be a minimum of 10m, and at least the distance where radiant heat flux (output) from the vegetation does not create the potential for ignition of on-site infrastructure.</i>	✓	All buildings within the BESS Facility will be provided with a minimum firebreak of 10m around the perimeter of the building.
Battery Energy Storage Systems		
A fire break must be established and maintained around battery energy storage systems and related infrastructure.	✓	This will be included within the final design, as illustrated by the indicative layout and design. Requirements to maintain this fire break will be included in the Fire Management Plan.
Section 4.2.6 – Design Specific to Facility Type		
Battery Energy Storage Systems		
1) The design of the facility must incorporate:		

ADVERTISED PLAN

Model requirement	Compliance	Comments
a) A separation distance that prevents fire spread between battery containers/enclosures and: • Other battery containers/enclosures. • On-site buildings. • Substations. • The site boundary. • Any other site buildings. • Vegetation. <i>Separation must be at least the distance where the radiant heat flux (output) from a battery energy storage system container/enclosure fully involved in fire does not create the potential for ignition of these site elements.</i>	✓	The battery system as per the CFA Guideline is required to be designed with appropriate separation between the batteries and supporting infrastructure. The CFA Guideline also requires the Battery Unit to comply with UL9540 and be certified against UL9540A by an independent testing authority. The results of the UL9540A test guides the required separation distance between the various Battery Units and other infrastructure to reduce the likelihood of fire spread occurring. The layout of the Battery Units will conform with the manufacturer specifications that directly relate to the outcomes of the UL9540A test. The UL9540A standards requires the test methodology to: <i>Determine the capability of a battery technology to undergo thermal runaway and then evaluate the fire and explosion hazard characteristics of those battery energy storage systems that have demonstrated a capacity to undergo thermal runaway.</i> The spacing requirements are also influenced by NFPA 855 which requires the BESS manufacturer/supplier to determine the spacing requirements through appropriate testing including the use of UL9540A. Whilst the selection of a BESS supplier has not been finalised, demonstration of these spacing requirements being met will be part of an update to this RMP, and preparation of the Fire Management Plan and Emergency Management Plan, prior to the commencement of construction.
b) A fire break around the battery energy storage system and related infrastructure, of a width of no less than 10m, or greater where determined in the Risk Management Plan. <i>Fire breaks must be non-combustible, constructed of</i>	✓	The separation from vegetation being provided around the BESS and associated infrastructure be at least 10m. The fire breaks will be a non-combustible surface and provide for the protection of the infrastructure, with the ability to be utilised by firefighting vehicles.

This copied document to be made available for the sole purpose of enabling its consideration and review as part of a planning process under the Planning and Environment Act 1987. The document must not be used for any purpose which may breach any copyright

ADVERTISED PLAN

Model requirement	Compliance	Comments
<i>concrete, mineral earth or non-combustible mulch such as crushed rock. The width must be calculated based on the ignition source being radiant heat of surrounding vegetation, including landscaping.</i>		
c) A layout of site infrastructure that: i. Considers the safety of emergency responders. ii. Minimises the potential for grassfire and/or bushfire to impact the battery energy storage system. iii. Minimises the potential for fires in battery containers/enclosures to impact on-site and offsite infrastructure.	✓	The indicative design has been developed to provide emergency responders with options to travel through BESS area once they have entered the BESS footprint. The indicative design includes access points to the BESS footprint from the southeast, where responders can either continue west around the perimeter or north through the BESS compound. The provision of a perimeter road around the BESS footprint and individual roads between the BESS units will ensure firefighters have access to all areas around the BESS. The indicative layout is considerate of the potential for fires and how they may spread through a Project Site.
2) Battery energy storage systems must be		
a) Located so as to be reasonably adjacent to a site vehicle entrance (suitable for emergency vehicles).	✓	The Project Site is easily accessible from Darnum-Shady Creek Road via a ~430m access road, maintaining sufficient setbacks to prevent hazards from affecting road users or surrounding houses.
b) Located so that the site entrance and any fire water tanks are not aligned to the prevailing wind direction (therefore least likely to be impacted by smoke in the event of fire at the battery energy storage system.)	✓	The site entrance will be from the east, away from the most likely wind direction. Fire water will be provided from the primary site entrance, and a hydrant system will be installed to ensure fire water is available regardless of wind direction.
c) Provided with in-built detection and suppression systems. Where these systems are not provided, measures to effectively detect and/or suppress fires within	✓	The chosen BESS system will be provided with a fire safety system in consultation with CFA. This is outlined in Chapter 2.2.

This copied document to be made accessible for the sole purpose of enabling its consideration and review as part of a planning process under the Planning and Environment Act 1987. The document must not be used for any purpose which may breach any copyright

ADVERTISED PLAN

Model requirement	Compliance	Comments
containers must be detailed within the Risk Management Plan.		
d) Provided with explosion prevention via sensing and venting, or explosion mitigation through deflagration panels.	✓	The Battery Units will be provided with explosion prevention and venting systems that comply with NFPA855.
e) Provided with suitable ember protection to prevent embers from penetrating battery containers/enclosures.	✓	The Battery Units are designed to eliminate the ingress of dust, spiders and other insects. This will also prevent any embers from fires in the surrounding area to enter the Battery Unit. The chosen Battery Unit will have a suitable IP rating, and this will be included within the updated RMP.
f) Provided with suitable access roads for emergency services vehicles, to and within the site including to battery energy storage system(s) and fire service infrastructure.	✓	Driveway access is provided that allows access to BESS units along with perimeter access around the battery storage area. The indicative design and the final design will address this requirement.
g) Installed on a non-combustible surface such as concrete.	✓	The BESS and substation infrastructure are being installed on a non-combustible surface.
h) Provided with adequate ventilation.	✓	The Battery Units are provided with sufficient ventilation. This includes appropriate separation between and within the Battery Units. The design of ventilation systems will be in accordance with either NFPA 68 or 69 and the manufacturer specifications.
i) Provided with impact protection to at least the equivalent of a W guardrail-type barrier, to prevent mechanical damage to battery containers/enclosures.	✓	There will be various protection systems installed, such as bollards to ensure the battery enclosures and other infrastructure are protected from damage from vehicles and other equipment. The final decision for the provision of a system to prevent mechanical damage will be based on a final assessment during detailed design.
j) Provided with enclosed wiring and buried cabling, except where	✓	This will be included within the final design.

This copied document to be made available for the sole purpose of enabling its consideration and review as part of a planning process under the Planning and Environment Act 1987. The document must not be used for any purpose which may breach any copyright

ADVERTISED PLAN

Model requirement	Compliance	Comments
required to be above-ground for grid connection.		
k) Provided with spill containment that includes provision for management of fire water runoff.	✓	The Project will include a stormwater retention area that will also be used to capture any fire water runoff from the BESS footprint that may occur during firefighting operations. This will be included in the final plan. The stormwater retention area will be able to capture a minimum of 432,000 litres of fire water. Procedures will be included within the Emergency Management Plan to inform onsite staff and firefighters on the procedure to utilise the stormwater/fire water retention area.
Section 5 – Facility Construction and Commissioning		
Section 5.1.4 – Emergency Management		
An Emergency Plan must be developed for the construction and commissioning phase, before development starts.	✓	An Emergency Management Plan will be developed for both the construction and operations phases.
Section 6 – Facility Operation		
Section 6.1 – Fire Management Plan		
A Fire Management Plan must be developed for the facility, in consultation with CFA, before development starts.	✓	A Fire Management Plan will be developed for both the construction and operations phase.
Section 6.2 1 – Fire Hazards and Risk Controls		
If your facility is at-risk of bushfire, prevention and preparedness activities must be detailed in the Fire Management Plan.	✓	Appropriate procedures will be incorporated within the Fire Management Plan and Emergency Management Plan that addresses the bushfire risk. This will be informed by an update to this RMP once a BESS supplier has been finalised.

This copied document to be made available for the sole purpose of enabling its consideration and review as part of a planning process under the Planning and Environment Act 1987. The document must not be used for any purpose which may breach any copyright

ADVERTISED PLAN

Model requirement	Compliance	Comments
Section 6.2 2–Vegetation Management		
Facility operators must undertake the following measures during the Fire Danger Period:		
a) Grass must be maintained at or below 100mm in height during the declared Fire Danger Period.	✓	This requirement will be included within the Fire Management Plan.
b) Long grass and/or deep leaf litter must not be present in areas where heavy equipment will be working, during construction or operation.	✓	This requirement will be included within the Fire Management Plan.
c) Restrictions and guidance must be adhered to during the Fire Danger Period, days of high (and above) fire danger and Total Fire Ban days (refer to www.cfa.vic.gov.au).	✓	This requirement will be included within the Fire Management Plan and Emergency Management Plan.
Section 6.2 4–Facility and System Monitoring		
Appropriate monitoring for facility infrastructure must be provided to ensure that any shorts, faults or equipment failures with the potential to ignite or propagate fire are rapidly identified and controlled. Any fire must be notified to 000 immediately.	✓	The site will be monitored by a SCADA system that is remotely monitored. All alerts will be received at a central monitoring centre, and a procedure will be in place to determine the most effective response which may include the following: • Deploy a technician to the site. • Call 000 and request emergency service assistance.
6.2.5 – Maintenance		
Inspection, maintenance and any required repair activities must be conducted for all infrastructure, equipment and vehicles at the facility. Maintenance must be in line with any relevant Australian Standards and the manufacturer's requirements.	✓	This will be outlined within the Fire Management Plan.
Section 7 – Emergency Planning		

This copied document to be made available for the sole purpose of enabling its consideration and review as part of a planning process under the Planning and Environment Act 1987. The document must not be used for any purpose which may breach any copyright

ADVERTISED PLAN

Model requirement	Compliance	Comments
An Emergency Plan must be developed specific to the facility, in conjunction with CFA, before development starts.	✓	An Emergency Management Plan will be developed prior to construction commencing.
Section 8 – Provision of emergency information		
An Emergency Information Book must be developed and available to emergency responders. Emergency Information Books must be located in Emergency Information Containers, provided at each vehicle entrance the facility.	✓	An Emergency Information Book will be provided at the main entrance in a container that is protected from weather.

4.3 Treatment summary

Following the assessment against the CFA Guidelines the following treatments will be provided to manage the risk of fires. The Fire Management Plan will outline the detailed requirements for the provision and maintenance of fire management treatments. The below list is a summary of the requirements:

1. Access to the site to include dual perimeter access to the BESS area, including appropriate widths and load limits from access gates.
2. Dual accessway to the site from Darnum-Shady Creek Road.
3. Perimeter firebreak of 10m around Project infrastructure, and a 20m setback from screening vegetation.
4. Provision of a radiant heat barrier made of a non-combustible material separating the closest forest from the BESS. A minimum height of 2.5m has been recommended and is proposed to be integrated with the noise wall for the Project.
5. Provision of a static water supply (432,000 litres) made of concrete or steel and located at the primary accessway and more than 10 metres from any infrastructure.
6. Fire hydrant system that complies with AS2419.1, and booster assembly and pumps that enables appropriate pressures at the fire hydrant.
7. Minimum fire water retention of 432,000 litres.
8. Fire Management Plan as per the requirements of the CFA Guidelines.
9. Emergency Management Plan as per the requirements of the CFA Guidelines.
10. Emergency Information Book and Emergency Information Containers located at the primary access entrance.

ADVERTISED PLAN

4.4 Risk Assessment

This risk assessment has been developed to meet the requirements of Section 5 of the CFA Guidelines.

4.4.1 Introduction

The risk assessment process involves identifying, analysing, evaluating and treating the identified risks. The overall risk assessment process requires a consistent approach and follows *AS ISO 31000:2018 Risk management – Guidelines* as incorporated into the National Emergency Risk Assessment Guidelines (NERAG). Figure 11 provides an overview of the risk assessment process as outlined within *AS ISO 31000:2018 Risk management – Guidelines*.

Risk management is the process of recognising risk and developing methods to both minimise and manage the risk. This requires the development of a method to identify, prioritise, treat (deal with), control and monitor risk exposures.

A risk assessment is a function of the likelihood of an adverse event occurring and the consequence of the event. A comprehensive risk assessment will identify potential risks and consequences and therefore assist with the development of mitigation actions.

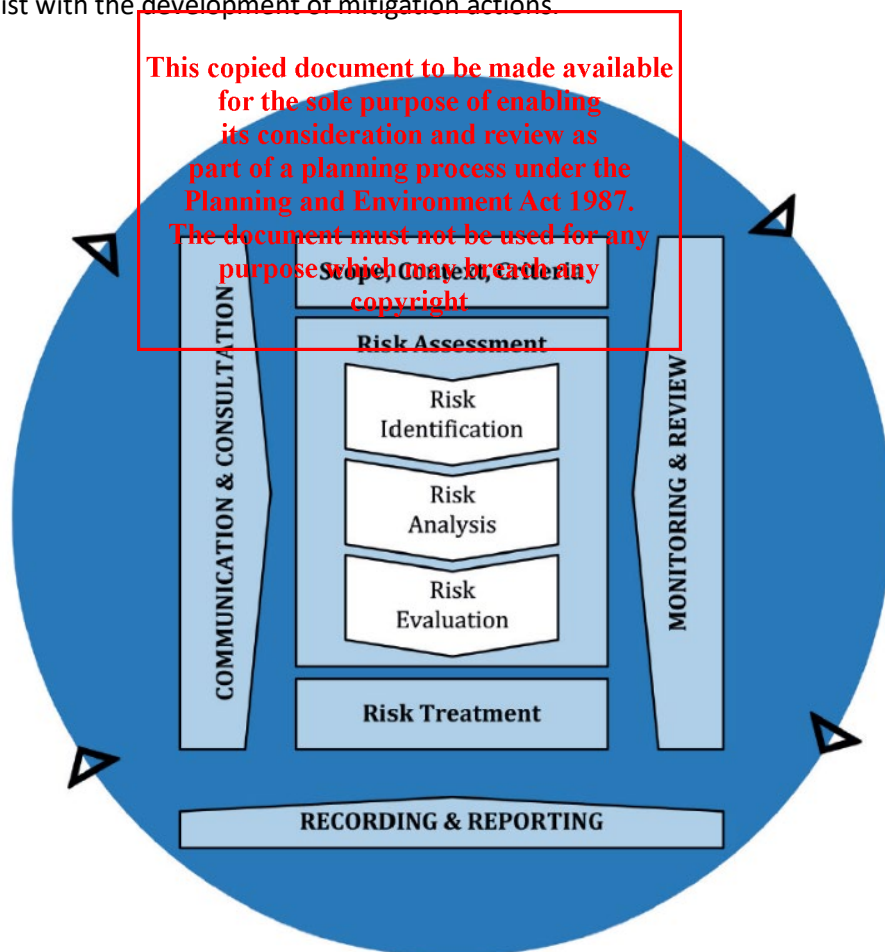


Figure 11 - Overview of AS/NZS ISO 31000-2018 risk management process

ADVERTISED PLAN

This report seeks to follow the steps outlined within the risk management guideline along with the process outlined within NERAG. The outcome of this assessment is a detailed understanding of hazards, the likelihood and consequence of a hazard becoming an emergency, and the treatments identified to manage this risk.

4.4.2 Context

The assessment of fire risk is a key requirement to accompany an application for a planning permit for a BESS project. The CFA Guidelines outlines the types of hazards that may need to be considered in relation to BESS infrastructure at the design, construction and operational phases.

4.4.3 Analysis of fire risk

BESS infrastructure is largely acknowledged as having limited potential to cause fires largely due to the high standards of safety set by the Australian and International standards and guidelines. Fires have occurred previously and where possible these have been considered during the assessment of risk outlined in this report. The occurrence of fires in large scale battery packs is not common. Fires have occurred and these are usually contained to a single battery pack. The range of sensors that are fitted to the systems will in most cases enable the early shut down that will prevent thermal runaway from occurring.

This assessment of risk considers the key stages of the Project being the construction and operations phase.

Assessment of fire risk during construction (including commissioning)

The construction phase includes various stages including site establishment works, installation of underground infrastructure, construction of hardstands and footings and the installation of the Battery Units and other ancillary infrastructure. This stage also includes the commissioning of the Battery Units and other systems (including fire protection systems). This stage also ensures the relevant connectivity is installed to ensure that all alerts and system messages are transmitted to an appropriate monitoring location.

A 2021 fire that occurred at the Victorian Big Battery² during its commissioning on the outskirts of Geelong has been assessed and reports are available that outline what occurred and how system manufacturers and installers should consider this information. This fire occurred during the commissioning phase of the particular Battery Unit. In summary, the isolation of the Battery Unit whilst it contained a charge was considered an incorrect process³.

² <https://victorianbigbattery.com.au/wp-content/uploads/2023/10/VBB-Fire-Independent-Report-of-Technical-Findings.pdf>

³ https://victorianbigbattery.com.au/wp-content/uploads/2023/06/VBB_StatementOfFindings_FINAL_28Sep2021.pdf

ADVERTISED PLAN

On 28 September 2021, Energy Safe Victoria released their Statement of Findings – Fire at the Victorian Big Battery. They outlined that the root cause was most likely:

a leak within the Megapack cooling system that caused a short circuit that led to a fire in an electronic component. This resulted in heating that led to a thermal runaway and fire in an adjacent battery compartment within one Megapack, which spread to an adjacent second Megapack.

The report outlines the contributory factors, and the lessons learned to prevent a reoccurrence. Energy Safe Victoria provided approval to recommence commissioning at the Victorian Big Battery providing the measures outlined were in place. The report states that the affected Battery Units failed safely despite total loss.

The outcomes of the Victorian Big Battery fire resulted in changes to the CFA Guideline to ensure the safety of firefighters is at the forefront of design requirements.

Assessment of fire risk during operations

The operations phase follows the commissioning stage of the Project, and the role of maintenance becomes critical to ensure that the system operates as it was designed, for the life of the Project. The ongoing maintenance of the infrastructure is critical to ensure the ongoing management of fire risk.

All the system components are to be considered as critical as they all are contributing to the ongoing safe operations. The system components including monitoring connectivity, fire protection systems, vegetation management, site access and controlling battery safety systems and other safety systems.

The development of an FMP will ensure the ongoing management of the fire safety systems for the life of the Project.

This copied document to be made available for the sole purpose of enabling its consideration and review as part of a planning battery safety system Planning and Environment Act 1987. The document must not be used for any purpose which may breach any copyright

4.4.4 Risk identification

Through discussions with key stakeholders, review of various documentation and the consideration of previous fire history that involved BESS infrastructure, review of the site specific constraints, and engagement with the CFA, the following hazards have been identified:

Table 11 - Hazard identification and description

Hazard	Description
Electrical hazards causing a fire	Electrical faults and/or hazards can be a key cause of fire in BESS infrastructure. Hazards including battery faults, overcharging, rapid discharge, loss of remote monitoring systems, internal short circuits and overheating.
Fire causing spread to adjoining infrastructure on the property	A fire that has started in a single Battery Unit may spread to adjoining batteries, facilities or other infrastructure. Rapid escalation of the fire size and complexity can create issues for onsite staff and contractors, firefighters and the community.

ADVERTISED PLAN

Hazard	Description
Fire causing offsite impacts	Any fire on the property that is able to spread to adjoining properties most likely through vegetation connectivity, on bushfire risk days can start fires in the surrounding landscape that can threaten the community.
Offsite fire impacting on the site	A bushfire burning through the surrounding landscape can enter the property and threaten the infrastructure by potentially starting new fires.
Fire water runoff	In the event of a fire, firefighters will respond and may use water to either extinguish or cool the surrounding area until the infrastructure is deemed safe.
Dangerous Goods exposure	The dangerous goods that are stored within the BESS and associated infrastructure may leak and either ignite or require clean up by either on site staff, contractors or firefighters.
Staff and firefighters	The response to a fire by staff, contractors or firefighters can be dangerous due to the various safety hazards associated with a fire in this type of infrastructure.
Smoke and gas	A fire within a Battery Unit will generate either gas or smoke that can spread throughout the site and into the neighbouring properties.

The above list will allow the assessment of most hazards that may be encountered in a development of this type.

4.4.5 Risk analysis

The analysis of risk requires the consideration of the likelihood and consequence of an event occurring and measuring this against a predetermined matrix to enable the consideration of each risk both individually and collectively.

For this assessment, a risk matrix has been developed that enables the effective consideration of risk and to enable a comparison between the outcome of the hazard assessment.

Likelihood

An assessment of the likelihood of a fire occurring at this development including the potential to impact on people and other infrastructure/property is a key part of the risk assessment. The following will be considered during the assessment of an event occurring:

- Potential for an unplanned fire to occur
- Potential for this ignition to develop and exhibit significant fire behaviour
- Potential for that fire to destroy assets
- Potential for people to be affected or threatened
- The potential for it to develop into a major fire.

Recommendations for mitigation actions in the area may be determined by a number of approaches depending on the level of assessed risk. Strategies to lower risk are provided to ensure the risk is managed to an acceptable level.

An assessment of likelihood considers factors such as:

- Sources of ignition
- Use of the property and/or surrounding area
- History of ignitions within similar infrastructure
- Ability to spread from the property.

Table 12 - Likelihood table

Likelihood scale frequency	Description
Almost certain	The event is expected to occur in most circumstances. (75%-99%). Has occurred frequently at the location.
Likely	The event will probably occur in most circumstance (50% - 75%). Has occurred frequently in the company.
Possible	The event should occur at some time. Likely to occur sometime (25% - 50%). Has occurred many times in the industry, but not in the company.
Unlikely	The event could occur at some time. Unlikely but possible (10% - 25%). Has occurred once or twice in the industry.
Rare	The event may occur only in exceptional circumstances. Assumed it may not be experienced (0% - 10%). Unheard of in the industry.

Consequence

Consequence refers to the potential damage that could result from a fire occurring in relation to people and assets. In assessing the possible consequences, the assessment considers a variety of hazard, exposure and vulnerability factors including:

- The likely number of people at the facility
- The proximity of other assets
- The location of surrounding properties and the type of activities
- Response capability if an event occurred.

The consequence scale refers to the potential impacts which could occur should a fire occur.

Table 13 - Risk assessment consequence table

Consequence scale	Description		
	People	Environment	Plant/Equipment
Catastrophic	Multiple fatalities	Permanent widespread ecological damage. Toxic release off-site with detrimental effect. Likely EPA prosecution	Massive widespread equipment damage (i.e. plant/equipment write-off) (\$1M+).

Consequence scale	Description		
	People	Environment	Plant/Equipment
Major	Single fatality or permanent disability	Heavy ecological damage with costly restoration. Off-site release contained with outside assistance and little detrimental impact.	Multiple equipment replacements (\$200 000 - \$1M).
Moderate	Major injuries - Incapacitations or requiring time off work	Major but recoverable ecological damage. On-site release contained with outside assistance.	Equipment level replacement /repair (\$50 000 - \$200 000).
Minor	Significant injuries - Medical treatment, non-permanent injury	Limited but medium term damage. On-site release immediately contained	Component level replacement /repair (\$10 000 - \$50 000).
Insignificant	Slight injuries- First Aid Treatments (cuts/ bruises)	Short term damage. Low financial loss, negligible environmental impact	Slight Damage (< \$10 000).

The risk rating table (Table 14) is used to combine likelihood and consequence to obtain a risk score. The risk score is used to aid decision making by determining which areas are at the greatest risk of a fire starting and spreading through the site. Actions can be prioritised using this method to determine where risk mitigation works will occur.

This copied document to be made available for the sole purpose of enabling its consideration and review as part of a planning process under the Planning and Environment Act 1987. The document must not be used for any purpose which may breach any copyright

**ADVERTISED
PLAN**

ADVERTISED PLAN

Table 14 - Risk matrix

				Impact Score					
				1	2	3	4	5	
				Insignificant	Minor	Moderate	Major	Catastrophic	
Risk Assessment Matrix				People	Slight Injuries- First Aid Treatments (cuts/bruises)	Significant Injuries - Medical Treatment, non-permanent injury	Major Injuries - Incapacitations or requiring time off work	Single Fatality or Permanent Disability	Multiple Fatalities
				Environment	Short term damage / Low financial loss, negligible environmental impact	Limited but medium term damage / On-site release immediately contained. Unlikely EPA investigation.	Moderate but recoverable ecological damage / On-site release contained with outside assistance. Possible EPA investigation.	Major ecological damage with costly restoration / Off-site release contained with outside assistance and little detrimental impact. Possible EPA prosecution.	Permanent widespread ecological damage / Toxic release off-site with detrimental effect / Likely EPA prosecution
				Plant / Equipment	Slight Damage	Component level replacement /repair	Equipment level replacement /repair	Multiple equipment replacements	Massive widespread equipment damage (ie plant/equipment write-off)
Likelihood	A	Almost Certain	The event is expected to occur in most circumstances / 75%-99% / Has occurred frequently in the industry	Low (5)	Moderate (10)	Very High (18)	Extreme (23)	Extreme (25)	
	B	Likely	The event will probably occur in most circumstance / 50% - 75% / Has occurred frequently in the industry	Low (4)	Moderate (9)	Very High (17)	Very High (20)	Extreme (24)	
	C	Possible	The event should occur at some time. Likely to occur some time / 25% - 50% / Has occurred in the industry	Low (3)	Moderate (8)	High (13)	Very High (19)	Very High (22)	
	D	Unlikely	The event could occur at some time. Unlikely but possible / 10% - 25% / Has occurred once or twice in the industry	Low (2)	Low (7)	Moderate (12)	High (15)	Very High (21)	
	E	Rare	The event may occur only in exceptional circumstances. Assumed it may not be experienced / 0% - 10% / Unheard of in the industry	Low (1)	Low (6)	Moderate (11)	High (14)	High (16)	

The outcomes of the risk assessment are used to inform the recommendations. These are aimed at providing guidance to management to reduce the fire risk at the property.

4.4.6 Risk analysis worksheets

The following worksheets have assessed the hazards identified in Chapter 4.4.4 and results in a risk classification along with strategies to lower risk if it is deemed required. The initial assessment of risk is based on the information that has been supplied to date.

ADVERTISED PLAN

Table 15 - Risk assessment - Electrical hazards causing a fire.

RISK	Electrical hazards causing a fire
CAUSE	Electrical faults and/or hazards can be a key cause of fire in BESS infrastructure. Hazards including battery faults, overcharging, rapid discharge, loss of remote monitoring systems, internal short circuits and overheating. These events may cause off gassing or thermal runaway.
LIKELIHOOD	Possible
JUSTIFICATION	The occurrence of electrical faults and/or hazards has occurred in the past and are likely to occur again in the future. The likelihood of an electrical fault escalating into an emergency such as a fire is unlikely due to the multiple layers of controls in place including sensors, 24/7 system monitoring and maintenance programs. There are examples of fires within BESS technology that indicates that when faults occur, they can escalate into challenging events including thermal runaway. To offset the likelihood of a fault within the BESS that creates a flammable atmosphere in and around the BESS, escalates to a fire, or a fire that affects adjacent infrastructure, the following mitigation treatments will be included: - Cooling systems that maintain the temperature of the Battery Units during day-to-day operations. - Early system shutdown to alert the monitoring centre if a sensor is activated. - Internal barriers within the battery enclosures designed to reduce the possibility of thermal runaway events from spreading to adjoining Battery Units. - Separation distances between individual Battery Units and rows of batteries and other infrastructure in accordance with manufacture installation guidelines. - The external walls of the Battery Units provide at least a 60-minute fire rating. - The BESS will be installed by qualified and competent people in accordance with the manufacturer's specifications and including compliance with <i>UL9540 – Energy Storage System Requirements</i> and <i>NFPA 855 - Standard for the Installation of Stationary Energy Storage Systems</i>. - The design and layout of the Battery Units are guided by the outcomes of the testing completed in accordance with UL9540A.
CONSEQUENCE	Major
JUSTIFICATION	The identification of a fault by the system monitoring process will result in early intervention. Intervention includes shut down, response from a technician and/or calling the fire brigade. The CFA Guideline requires a range of controls to be implemented and maintained including: Non-combustible surface that will not support fire spread through vegetation accumulation.

	• SCADA monitoring system that will monitor the system performance including over charging, elevated temperatures and a range of other faults and send alerts to the monitoring centre • Compliance with UL9540 and subsequently UL9540A • Appropriate separation between Battery Units and other infrastructure If the fire escalates and the implementation of shut down procedures does not stop the battery entering the off gassing phase and the thermal runaway phase, it is unlikely for the fire to spread beyond the Battery Unit. The potential for a fire to occur and to then spread throughout the Battery Unit is highly unlikely. The implementation of the controls outlined above will support the prevention of faults from escalating into fires and if a fire does occur, limit the ability for the fire to spread into an adjoining battery enclosure. The provision of a communications system between the SCADA system and the monitoring centre with built in redundancies will ensure the site is monitored 24/7 thereby ensuring early notification and receipt of alerts. The site is in an area that provides access options depending on the location of the fire and the prevailing wind conditions. This ensures that firefighters can assess the conditions and select the most suitable access option.
RISK RATING	Very High (19)
STRATEGY TO LOWER RISK	The requirements outlined within the response to the CFA Guidelines will be sufficient to ensure the risk is managed at an acceptable level. Other strategies outlined within the response to the CFA Guidelines that will also assist with managing the risk includes: • Development of an Emergency Management Plan that includes in addition to that required by CFA: ○ A system to communicate effectively between a central monitoring centre and the onsite staff and contractors. ○ Provision of 24/7 contact details for the fire brigade to contact in the event of an emergency or threat of an emergency. • Developing a procedure that requires a technician to be deployed to the site when the site monitoring communications are down, or a fault has been detected that may lead to an off gassing or thermal runaway event. • The SCADA system will be zoned to enable quick identification of the area of the facility that has caused an alarm. • Fire hydrant systems enabling firefighters to access firefighting water immediately.
RESIDUAL RISK	Moderate (12) (Unlikely /Moderate)

**ADVERTISED
PLAN**

This copied document to be made available for the sole purpose of enabling its consideration and review as part of a planning process under the Planning and Environment Act 1987. The document must not be used for any purpose which may breach any copyright

ADVERTISED PLAN

Table 16 - Risk assessment - Fire causing spread to adjoining infrastructure on the property.

RISK	Fire causing spread to adjoining infrastructure on the property.
CAUSE	A fire that has started in a Battery Unit may spread to adjoining batteries, facilities or other infrastructure. Rapid escalation of the fire size and complexity can create issues for onsite staff and contractors, firefighters and the community.
LIKELIHOOD	Unlikely
JUSTIFICATION	The installed monitoring systems will send alerts to a central monitoring centre. These include sensors that are monitoring for over charging, elevated temperatures, and other faults. The day-to-day monitoring system will trigger an immediate response if alerted. The BESS system can be remotely operated, and this includes the commencement of shutdown procedures. The battery system is provided with a detailed operating manual that outlines the likely cause of an alert and how the operators are to respond. The site procedures will outline when a technician is required to attend the site to investigate faults or alerts. Operators within the monitoring centre will be able to access CCTV footage to enable them to gather additional information on the status of the faults at the site. Upon the system sensing a fault, the monitoring centre will determine an appropriate response which may include: • Notifying the on-call technician to attend the site. • Calling 000 and reporting the activation to the fire brigade in addition to notifying the on-call technician to attend. The Battery Units will be made of non-combustible material and will provide a level of protection if a fire does occur inside the enclosure. If a fire occurs in an adjoining area of the site, the same enclosures will provide a level of protection. Most of the infrastructure that supports the BESS is non-combustible or has low quantities of combustible materials. There are a small number of fire events within BESS technology where a fire has spread to an adjoining battery. The layout design incorporates spaces that will reduce the risk of fire spread occurring that is influenced by the outcomes of large scale fire testing.
CONSEQUENCE	Major
JUSTIFICATION	If a fire does spread to another battery enclosure or other infrastructure it may cause additional issues including smoke management, dangerous goods leaks, fire water runoff management and exposure to electrical hazards. The ability for fire spread to occur is limited due to the many safety systems that are installed and maintained including sensors that generate alerts and 24/7 monitoring resulting in early detection and response. The firefighting hydrant system and water supply will enable firefighters to protect exposures for the duration of the fire event if this is deemed required. It is noted that the BESS manufacturers response guide advises fire agencies to not attempt to extinguish a fire and to allow it to burn out. The layout design will be in accordance with the manufacturers specifications which will ensure there is suitable separation being provided between the battery enclosures and to other infrastructure. The separation distance requirements have been determined through fire engineering analysis and small to large scale fire testing.

ADVERTISED PLAN

RISK RATING	High (15)
STRATEGY TO LOWER RISK	The requirements outlined within the response to the CFA Guidelines and complying with the manufacturer specifications that have been developed following UL9540A and large scale fire testing and will be sufficient to ensure the risk is managed at an acceptable level. Other strategies outlined within the response to the CFA Guidelines that will also assist with managing the risk includes: • Development of Emergency Management Plan that includes in addition to that required by CFA: ○ A system to communicate effectively between the monitoring centre and the onsite staff and contractors. ○ Provision of 24/7 contact details for the fire brigade to contact in the event of an emergency or threat of an emergency. • Developing a procedure that requires a technician to be deployed to the site when the site monitoring communications are down. • The SCADA system will be zoned to enable quick identification of the area of the facility that has caused an alarm.
RESIDUAL RISK	Moderate(12) (Rare/Major)

Table 17 - Risk assessment - Fire causing onsite impacts.

RISK	Fire causing onsite impacts.
CAUSE	Any fire on the property can spread to adjoining properties. This would most likely be through vegetation connectivity. If this occurred on an elevated fire danger day, the fire could spread into adjoining properties.
LIKELIHOOD	Possible
JUSTIFICATION	The likelihood of a fire occurring within the BESS footprint is outlined within Table 13 and Table 14. In addition to this, the compliance with CFA Guidelines also requires mitigation strategies implemented including: • Non-combustible surface under the Battery Units and other infrastructure. • Provision of a fire break and additional managed areas between the fire break and the boundary fence. • Provision of a radiant heat barrier made of a non-combustible material. • The batteries are contained within the metal cabinets, and any fire activity will likely stay within the cabinets. • The requirement for a Fire Management Plan and Emergency Management Plan that will include prevention and preparedness activities that must occur annually prior to the fire danger period. These activities will include: ○ Management of vegetation on the site.

ADVERTISED PLAN

	○ Evacuation exercising and training. • The Fire Management Plan will also provide clear direction on the maintenance of the various controls required to manage the fire risk. In addition to the CFA Guideline, the manufacturer specifications will outline the separation requirements that must be implemented through the layout design including separation from adjoining properties.
CONSEQUENCE	Major
JUSTIFICATION	The surrounding landscape is dominated by grasslands and small areas of forested vegetation. With the setback distances being provided from the adjoining boundaries, there is sufficient space to limit the potential for fire spread to occur. In the event of a fire and smoke is being generated, the Emergency Management Plan will require the site operators to immediately engage with their neighbours to inform them of the fire and the suggested actions they should take. The fire agency also has access to a system that can warn or alert the surrounding area of the fire and provide advice as to actions they can take.
RISK RATING	Very High (19)
STRATEGY TO LOWER RISK	Any vegetation growth on the property surrounding the Project will be managed and removed as required to maintain a 10m fire break. The details of this will be outlined within the Fire Management Plan. During the fire danger period, additional inspections will occur to ensure that all vegetation is removed from the fire break and within the Project footprint. Any on site works during construction or operations will enact standard Occupational Health and Safety policies and procedures including Hot Works, use of naked flames on the property, smoking management, induction of new staff and contractors and contractor management. The induction procedure will include a requirement to ensure people are aware of their obligations of not creating fire risks during their day-to-day activities.
RESIDUAL RISK	Moderate(12) (Unlikely/Moderate)

Table 18 - Risk assessment - Offsite fire impacting on the site.

RISK	Offsite fire impacting on the site.
CAUSE	A fire burning in the surrounding landscape can enter the property and threaten the infrastructure by potentially starting new fires through ember attack or flame contact.
LIKELIHOOD	Unlikely
JUSTIFICATION	Due to the surrounding landscape, there is the potential for bushfires to impact the Project. Due to the setbacks, the likely bushfire impact is through embers landing on and around the property as well as some levels of radiant heat from surrounding forested patches.

ADVERTISED PLAN

	The site includes fire breaks and managed areas that will limit the ability for a fire to burn around the Project. The Fire Management Plan will outline the management arrangements and the maintenance requirements. The ongoing removal of vegetation and other combustible materials in and around the BESS area will be specified within the Fire Management Plan. The design of the battery enclosures will likely prevent fires from entering the Battery Units. The enclosures are designed to prevent dust, insects and birds from entering. The enclosures are also fitted with internal climate control systems that will result in fires likely to self-extinguish due to the cool temperatures. Radiant heat barriers will be provided for the BESS. A nominal height of 2.5m has been recommended. The provision of this radiant heat barrier ensures radiant heat exposure from the forested areas does not exceed 5kW/m².
CONSEQUENCE	Major
JUSTIFICATION	The ability for a vegetation fire to generate sufficient radiant heat to impact on the Battery Units is unlikely. The requirements to maintain and manage the onsite vegetation will ensure that fire spread onto the property will be limited. Radiant heat barriers will be provided for the BESS. A nominal height of 2.5m has been recommended. The provision of this radiant heat barrier ensures radiant heat exposure from the forested areas does not exceed 5kW/m². It is highly unlikely for flame contact or radiant heat to impact on the BESS from a fire in the surrounding area.
RISK RATING	High (15)
STRATEGY TO LOWER RISK	Within the Emergency Management Plan ensure the following is included: - When elevated fire danger conditions are forecast, ensure all vegetation maintenance activities have occurred. - If a fire is occurring in the surrounding landscape, engage with CFA to ascertain any actions that should be undertaken to protect the BESS infrastructure.
RESIDUAL RISK	Moderate (11) (Rare/ Moderate)

This copied document to be made available for the sole purpose of enabling its consideration and review as part of a planning process under the Planning and Environment Act 1987. The document must not be used for any purpose which may breach any copyright.

Table 19 - Dangerous Goods

RISK	Dangerous Goods
CAUSE	With reference to the Dangerous Goods (Storage and Handling) Regulations 2022, there are quantities of Dangerous Goods at the Project within various components. There is the potential for a Dangerous Goods leak to occur that may cause a threat to people, the environment or be involved in a fire.
LIKELIHOOD	Unlikely
JUSTIFICATION	Dangerous Goods are located within the Battery Units and the transformers. The Dangerous Goods are largely installed within the components/equipment during the

ADVERTISED PLAN

	manufacturing process which means that they are contained and sealed and not readily accessible at the site. Following transportation to the site, any infrastructure with Dangerous Goods will be inspected to ensure it has not been damaged during transportation. If infrastructure with Dangerous Goods is to be stored at site prior to installation, it will be stored in line with manufacturer's specifications to ensure its integrity. Infrastructure will be installed in line with manufacturer's specifications (including inspection and testing). Together, these measures will prevent the likelihood of leaks outside the BESS Site. The design of the BESS including the installation of impact protection devices, such as bollards, around the perimeter of the BESS will prevent vehicles from impacting the infrastructure and potentially causing a leak. The products classified as a Dangerous Good located within the Project will be listed within the Site's Dangerous Goods register and the site operators will be aware of the locations and quantities of Dangerous Goods. Maintenance programs will be enacted to ensure all infrastructure that contains Dangerous Goods within the Project will be maintained in accordance with the manufacturer's specifications and the relevant Australian Standards. This will include checking for physical and electrical faults that could result in leaks. Due to the manufacturing and installation procedures, the potential for a Dangerous Good incident to occur is unlikely.
CONSEQUENCE	Moderate
JUSTIFICATION	The assessment of the dangerous goods quantities at the BESS identified infrastructure with quantities of dangerous goods that will likely exceed the Schedule 2 requirements as outlined within the Victorian Dangerous Goods legislation. The largest quantity of Dangerous Goods will be the Lithium Ion (Class 9). Other Dangerous Goods may include refrigerant and oils. These will be assessed when the final design has been endorsed. The Dangerous Goods referred above, are stored in separate components within the Battery Units, or in separate infrastructure. It is therefore unlikely for the total quantities of Dangerous Goods on the site to be involved in an incident at the site at the same time. There are other goods that may be utilised and stored on the site, but it would be expected that these would be in small quantities.
RISK RATING	High (12)
STRATEGY TO LOWER RISK	In accordance with the Dangerous Goods (Storage and Handling) Regulations (2022), the CFA's views must be sought if the quantities have exceeded the fire protection amounts listed in Schedule 2 as is the case for the Lithium-Ion. The CFA will be aware of the presence of Dangerous Goods in relation to the Project. Further consultation with CFA to confirm the outcomes of this assessment will occur prior to construction and will be ongoing throughout the life of the Project. The Emergency Management Plan will include details of the hazards associated with dangerous goods and appropriate procedures in response to this RMP, including leak management and other response arrangements to Dangerous Goods related emergencies.
RESIDUAL RISK	Moderate (11) (Rare/Moderate)

ADVERTISED PLAN

Table 20 - Risk assessment - Fire water runoff

RISK	Fire water runoff
CAUSE	In the event of a fire, firefighters will respond and may use water to either extinguish or cool the surrounding area until the infrastructure is deemed safe. If the fire water comes into contact with burning materials or smoke, it may become contaminated.
LIKELIHOOD	Unlikely
JUSTIFICATION	As outlined in previous assessments, the risk of a large fire is very low and unlikely. This is due to the separation between various areas of the Project and the extensive use of non-combustible materials. The infrastructure is monitored 24/7 and will alert technicians and if required, the fire brigade to the site early. If a fire occurs, it will likely be contained to a single battery container. Firefighting water can be used to cool the adjoining areas and will be considered largely clean as it has not been exposed to fire or smoke. BESS manufacturers advice is to not attempt to extinguish the Battery Unit that is on fire. The safest and most effective firefighting strategy is to let the Battery Unit burn out.
CONSEQUENCE	Minor
JUSTIFICATION	Any fire water that is used at the site will be contained until testing can occur and then in conjunction with EPA determine the most effective disposal method. The Emergency Management Plan will include procedures to capture fire water and then if required, disposal arrangements.
RISK RATING	Low (7)
STRATEGY TO LOWER RISK	Onsite staff will be trained in the fire water runoff management procedures. They will then be available to assist firefighters with managing fire water runoff. The requirement to regularly check the fire water runoff pond will be contained within the Fire Management Plan.
RESIDUAL RISK	Low (6) (Rare/Minor)

Table 21 - Risk assessment – Staff and firefighters

RISK	Staff and firefighters
CAUSE	The response to a fire by staff, contractors or firefighters can be dangerous due to the various safety hazards associated with a fire in this type of infrastructure.
LIKELIHOOD	Possible
JUSTIFICATION	There is the potential for firefighters and/or staff and contractors to be present during an emergency event and not be familiar with the site. The CFA Guidelines impose a variety of controls onto the management of the site through the Emergency Management Plan and how the CFA interacts with the site if they are called to a fire.

ADVERTISED PLAN

	Whilst a low risk that a fire will occur, if a fire does occur, there is the potential for a firefighter to arrive who is unfamiliar with property and the technology installed.
CONSEQUENCE	Moderate
JUSTIFICATION	The provision of an Emergency Information Container that will include the Emergency Management Plan, site plans and contact details for technical specialists will ensure responding firefighters seek information prior to entering the property. The layout of the site will ensure that firefighters will initially access the site from the main accessway, which is where the Emergency Information Container will be located.
RISK RATING	High (13)
STRATEGY TO LOWER RISK	The arrangements for monitoring the SCADA system through the monitoring centre will ensure that an informed decision can be made following an assessment of the alerts being received. In all cases a technician will be dispatched to the site to review the alert at the Project. The Emergency Management Plan will include a requirement to engage with the responding firefighters early to ensure they are aware that a technician is on their way and that entry to the site can wait until they arrive unless there is a life protection emergency. The Emergency Information Container that is required by the CFA Guidelines will provide detailed contact information for responding firefighters to seek specialist advice prior to accessing the property.
RESIDUAL RISK	Moderate (8) (Possible/Minor)

This copied document to be made available
for the sole purpose of enabling
its consideration and review as
part of the planning process under the
Planning and Environment Act 1987.
The document must not be used for any
purpose which may breach any
copyright

Table 22 -Risk assessment – Smoke and gas

RISK	Smoke and gas
CAUSE	As a result of a fire involving a BESS unit, the production of gases and smoke can occur.
LIKELIHOOD	Unlikely
JUSTIFICATION	As discussed previously, the likelihood of a fire starting within a BESS Unit is considered Low. If a fire does ignite, there will be the production of smoke and gases depending on the stage of the thermal runaway event. The monitoring systems will detect any faults and the BMS will commence shut down procedures.
CONSEQUENCE	Minor
JUSTIFICATION	The production of smoke or gases depending on the weather conditions may spread from the site and into neighbouring areas. Due to the slow progression of a fire within a BESS Unit, the production of smoke and gases will likely be influenced by the weather conditions causing dispersal to occur rapidly. The types of smoke and gases are consistent with a fire within a structure such as a dwelling, though specific differences may exist depending on the materials within the BESS unit.

RISK RATING	Low (7)
STRATEGY TO LOWER RISK	The mitigations outlined in previous assessments will limit the likelihood and consequence of a fire occurring within and externally of a BESS Unit. In addition to the mitigation treatments outlined previously, in support of future emergency management planning a detailed smoke and gas consequence analysis will be undertaken to enable responding firefighters to be aware of the likely dispersion of smoke and gas. The emergency management agencies also operate an emergency warning system that could be utilised if they deem the smoke and gas dispersion to be a concern.
RESIDUAL RISK	Low (6) (Minor/Rare)

ADVERTISED PLAN

This copied document to be made available for the sole purpose of enabling its consideration and review as part of a planning process under the Planning and Environment Act 1987. The document must not be used for any purpose which may breach any copyright

5 Conclusion

The assessment of risk for the Darnum BESS has found that the concept design and layout can meet the requirements of the CFA Guidelines and adequately manage the fire risk to an acceptable level. This assessment has been undertaken based on the Tesla Megapack 3 as the preferred OEM, which reflects a representative and conservative design basis. This RMP will be updated to confirm these findings once the selection of a BESS supplier has been finalised, prior to construction.

The reduction in risk is driven by compliance with the CFA Guidelines, which will be confirmed once the selection of a BESS supplier has been finalised. All the model requirements outlined within the CFA Guideline can be achieved with this Project as illustrated by the indicative layout and design.

The risk assessment along with the assessment against the CFA Guideline (Chapter 4.2) has identified the Project can achieve compliance. The systems and procedures that will be implemented during design, construction (including commissioning) and operation will ensure that any risk is managed to an acceptable level.

Historically, fire events involving these types of facilities are due to inappropriate procedures that include having not considered the risk of fire effectively. This RMP has considered these examples in the development of risk mitigation treatments for the Darnum BESS.

BESS facilities can present fire risks if not designed, constructed, commissioned and operated effectively.


The importance of following design requirements and committing to the ongoing maintenance of the system is critical to reduce fire risk.

**This copied document to be made available
for the sole purpose of enabling
its consideration and review as
part of a planning process under the
Planning and Environment Act 1987.
The document must not be used for any
purpose which may breach any
copyright**

**ADVERTISED
PLAN**

Appendix A – UL9540A test sequence

Figure 1.1
Schematic of Test Sequence

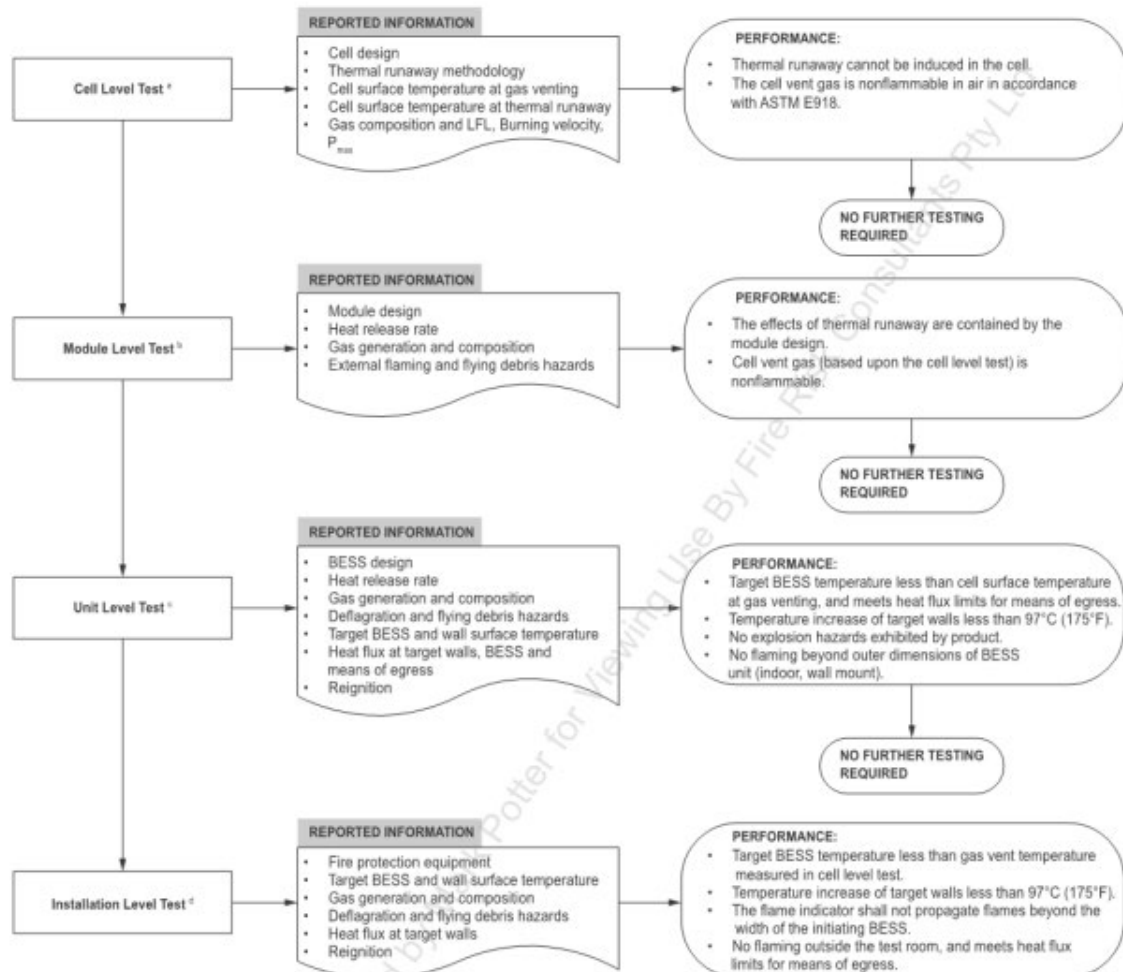

**ADVERTISED
PLAN**

This copied document to be made available for the sole purpose of enabling its consideration and review as part of a planning process under the Planning and Environment Act 1987. The document must not be used for any purpose which may breach any copyright

Appendix B – Flamesol Calculations

**ADVERTISED
PLAN**

**This copied document to be made available
for the sole purpose of enabling
its consideration and review as
part of a planning process under the
Planning and Environment Act 1987.
The document must not be used for any
purpose which may breach any
copyright**

ADVERTISED PLAN

FLAMESOL FPA AUSTRALIA			
Calculated October 22, 2025, 10:07 am (BALc v4.9)			
Bushfire Attack Level calculator - AS3959-2018 (Method 2)			
Inputs		Outputs	
Fire Danger Index	100	Rate of spread	3 km/h
Vegetation Classification	Forest	Flame length	23.7 m
Understorey fuel load	25 t/ha	Flame angle	77 °
Total fuel load	35 t/ha	Panel height	23.09 m
Vegetation height	n/a	Elevation of receiver	11.54 m
Effective slope	0 °	Fire intensity	54,250 kW/m
Site slope	0 °	Transmissivity	0.735
Distance to vegetation	83.5 m	Viewfactor	0.0898999999999999
Flame width	100 m	Radiant heat flux	5.03 kW/m²
Windspeed	n/a	Bushfire Attack Level	BAL-12.5
Heat of combustion	18,600 kJ/kg		
Flame temperature	1,090 K		
Rate of Spread - McArthur, 1973 & Noble et al., 1980			
Flame length - NSW Rural Fire Service, 2001 & Noble et al., 1980			
Elevation of receiver - Douglas & Tan, 2005			
Flame angle - Douglas & Tan, 2005			
Radiant heat flux - Drysdale, 1999, Sullivan et al., 2003, Douglas & Tan, 2005			

Figure 12 - Flamesol output for Plot 1 (Forest, Flat/upslope)

FLAMESOL FPA AUSTRALIA			
Calculated October 22, 2025, 10:08 am (BALc v4.9)			
Bushfire Attack Level calculator - AS3959-2018 (Method 2)			
Inputs		Outputs	
Fire Danger Index	100	Rate of spread	1.79 km/h
Vegetation Classification	Woodland	Flame length	14.7 m
Understorey fuel load	15 t/ha	Flame angle	85 °
Total fuel load	25 t/ha	Panel height	14.64 m
Vegetation height	n/a	Elevation of receiver	7.32 m
Effective slope	0 °	Fire intensity	23,249 kW/m
Site slope	0 °	Transmissivity	0.6909999999999999
Distance to vegetation	148.6 m	Viewfactor	0.0197
Flame width	100 m	Radiant heat flux	1.04 kW/m²
Windspeed	n/a	Bushfire Attack Level	BAL-12.5
Heat of combustion	18,600 kJ/kg		
Flame temperature	1,090 K		
Rate of Spread - McArthur, 1973 & Noble et al., 1980			
Flame length - NSW Rural Fire Service, 2001 & Noble et al., 1980			
Elevation of receiver - Douglas & Tan, 2005			
Flame angle - Douglas & Tan, 2005			
Radiant heat flux - Drysdale, 1999, Sullivan et al., 2003, Douglas & Tan, 2005			

Figure 13 - Flamesol output for Plot 2 (Woodland, Flat/upslope)

FLAMESOL FPA AUSTRALIA			
Calculated October 22, 2025, 10:13 am (BALc v4.9)			
Bushfire Attack Level calculator - AS3959-2018 (Method 2)			
Inputs		Outputs	
Fire Danger Index	100	Rate of spread	3 km/h
Vegetation Classification	Forest	Flame length	23.7 m
Understorey fuel load	25 t/ha	Flame angle	83 °
Total fuel load	35 t/ha	Panel height	23.52 m
Vegetation height	n/a	Elevation of receiver	11.76 m
Effective slope	0 °	Fire intensity	54,250 kW/m
Site slope	0 °	Transmissivity	0.673
Distance to vegetation	179.5 m	Viewfactor	0.0223
Flame width	100 m	Radiant heat flux	1.14 kW/m²
Windspeed	n/a	Bushfire Attack Level	BAL-12.5
Heat of combustion	18,600 kJ/kg		
Flame temperature	1,090 K		
Rate of Spread - McArthur, 1973 & Noble et al., 1980			
Flame length - NSW Rural Fire Service, 2001 & Noble et al., 1980			
Elevation of receiver - Douglas & Tan, 2005			
Flame angle - Douglas & Tan, 2005			
Radiant heat flux - Drysdale, 1999, Sullivan et al., 2003, Douglas & Tan, 2005			

Figure 14 - Flamesol output for Plot 3 (Forest, Flat/upslope)

FLAMESOL FPA AUSTRALIA			
Calculated October 22, 2025, 10:13 am (BALc v4.9)			
Bushfire Attack Level calculator - AS3959-2018 (Method 2)			
Inputs		Outputs	
Fire Danger Index	100	Rate of spread	3 km/h
Vegetation Classification	Forest	Flame length	23.7 m
Understorey fuel load	25 t/ha	Flame angle	80 °
Total fuel load	35 t/ha	Panel height	23.33 m
Vegetation height	n/a	Elevation of receiver	11.66 m
Effective slope	0 °	Fire intensity	54,250 kW/m
Site slope	0 °	Transmissivity	0.71
Distance to vegetation	121.6 m	Viewfactor	0.0464
Flame width	100 m	Radiant heat flux	2.5 kW/m²
Windspeed	n/a	Bushfire Attack Level	BAL-12.5
Heat of combustion	18,600 kJ/kg		
Flame temperature	1,090 K		
Rate of Spread - McArthur, 1973 & Noble et al., 1980			
Flame length - NSW Rural Fire Service, 2001 & Noble et al., 1980			
Elevation of receiver - Douglas & Tan, 2005			
Flame angle - Douglas & Tan, 2005			
Radiant heat flux - Drysdale, 1999, Sullivan et al., 2003, Douglas & Tan, 2005			

Figure 15 - Flamesol output for Plot 4 (Forest, Flat/upslope)

FLAMESOL FPA AUSTRALIA			
Calculated October 22, 2025, 9:12 am (BALc v4.9)			
Bushfire Attack Level calculator - AS3959-2018 (Method 2)			
Inputs		Outputs	
Fire Danger Index	100	Rate of spread	3.56 km/h
Vegetation Classification	Forest	Flame length	27.37 m
Understorey fuel load	25 t/ha	Flame angle	88.5 °
Total fuel load	35 t/ha	Panel height	27.36 m
Vegetation height	n/a	Elevation of receiver	0 m
Effective slope	2.5 °	Fire intensity	64,463 kW/m
Site slope	2.5 °	Transmissivity	1.615
Distance to vegetation	343.8 m	Viewfactor	0.0072
Flame width	100 m	Radiant heat flux	0.89 kW/m²
Windspeed	n/a	Bushfire Attack Level	BAL-12.5
Heat of combustion	18,600 kJ/kg		
Flame temperature	1,090 K		
Rate of Spread - McArthur, 1973 & Noble et al., 1980			
Flame length - NSW Rural Fire Service, 2001 & Noble et al., 1980			
Elevation of receiver - Douglas & Tan, 2005			
Flame angle - Douglas & Tan, 2005			
Radiant heat flux - Drysdale, 1999, Sullivan et al., 2003, Douglas & Tan, 2005			

Figure 16 - Flamesol output for Plot 5 (Forest, 2.5° downslope)

FLAMESOL FPA AUSTRALIA			
Calculated October 22, 2025, 2:43 pm (RHbc v1.4)			
Radiant Heat Barrier calculator - AS3959-2018			
Inputs		Outputs	
Fire Danger Index	100	Rate of spread	3 km/h
Vegetation Classification	Forest	Flame length	23.7 m
Understorey fuel load	25 t/ha	Flame angle	77 °
Total fuel load	35 t/ha	Panel height	23.09 m
Vegetation height	n/a	Elevation of receiver	11.54 m
Effective slope	0 °	Effective barrier height	2.5 m
Site slope	0 °	Fire intensity	54,250 kW/m
Distance to vegetation	83.5 m	Transmissivity	0.735
Flame width	100 m	Viewfactor	0.0898999999999999
Windspeed	n/a	Radiant heat flux	5.03 kW/m²
Heat of combustion	18,600 kJ/kg	Viewfactor of barrier	0.008999999999999999
Flame temperature	1,090 K	Adjusted viewfactor	0.0808
Actual barrier height	2.5 m	Adjusted radiant heat flux	4.52 kW/m²
		Bushfire Attack Level	BAL-12.5
Rate of Spread - McArthur, 1973 & Noble et al., 1980			
Flame length - NSW Rural Fire Service, 2001 & Noble et al., 1980			
Elevation of receiver - Douglas & Tan, 2005			
Flame angle - Douglas & Tan, 2005			
Radiant heat flux - Drysdale, 1999, Sullivan et al., 2003, Douglas & Tan, 2005			

Figure 17 - Flamesol output for Plot 1 with a 2.5m radiant heat barrier

**ADVERTISED
PLAN**

This copied document to be made available for the sole purpose of enabling its consideration and review as part of a planning process under the Planning and Environment Act 1987. The document must not be used for any purpose which may breach any copyright

Appendix C – Radiant Heat Barrier Methodology

**ADVERTISED
PLAN**

**This copied document to be made available
for the sole purpose of enabling
its consideration and review as
part of a planning process under the
Planning and Environment Act 1987.
The document must not be used for any
purpose which may breach any
copyright**

ADVERTISED PLAN

This copied document to be made available for the sole purpose of enabling its consideration and review as part of a planning process under the Planning and Environment Act 1987. The document must not be used for any purpose which may breach any copyright

Methodology underpinning the Radiant Heat Barrier calculator Version 2 – 21 November 2017

The modelling process within Method 2 of *Australian Standard 3959: Construction of buildings in bushfire-prone areas*¹ (AS3959) is based on the 'view factor' principle (sometimes called "configuration factor").

A view factor represents the proportion of total radiation that leaves an emitter and impacts the receiver². In simple terms it represents how much of the emitter (the fire) can be seen from the receiver (the site).

The modelling process in AS3959 assumes that there are no objects between the emitter and the receiver – see Figure 1.

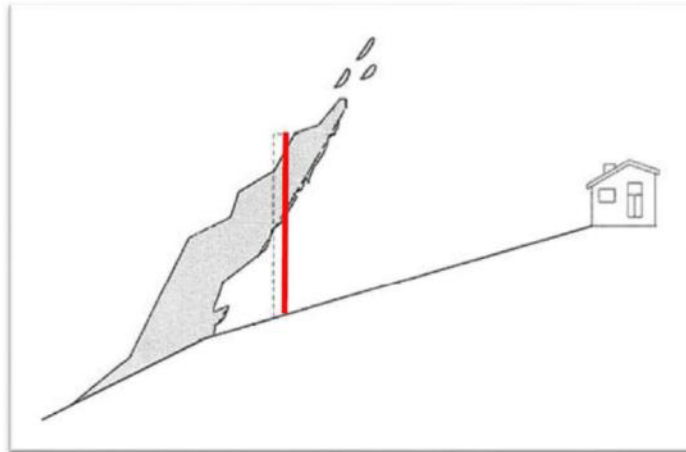


Figure 1 – Standard 'view factor' scenario in AS3959
(Red line indicates emitter and house indicates the site)

This assumption has the potential to over predict the view factor when there is a barrier located between the emitter and receiver as the barrier itself will absorb a portion of the total radiation being emitted. The most common examples of such barriers include small hills or manmade objects such as other houses or fences.

As view factor's are additive³ and subtractive the view factor of the barrier can be deducted from the total view factor (the "unshielded" scenario) to achieve a more accurate result.

To do so, the following steps can be undertaken to quantify the impact of a barrier using the modelling process in Method 2 of AS3959:

¹ Standards Australia (2011) *AS 3959-2009 Construction of buildings in bushfire-prone areas – Amendment 3*

² Sullivan, A., Ellis, P. & Knight, I (2003) *A review of radiant heat flux models used in bushfire applications*

³ Drysdale, D. (2011) *An Introduction to Fire Dynamics – Third edition*

ADVERTISED PLAN

This copied document to be made available for the sole purpose of enabling its consideration and review as part of a planning process under the Planning and Environment Act 1987. The document must not be used for any purpose which may breach any copyright

1. Calculate the view factor based on an unobstructed scenario
2. Calculate the view factor of the barrier itself
3. Calculate the radiation impact (kW/m^2) using the view factor value determined in step 1 but reduced by the value determined in step 2.

To determine the view factor of the barrier in step 2 above, flame length shall be used to represent the barrier itself (this is the “actual height” input in the calculator) and at a 90-degree flame angle. The latter assumes that the barrier will be vertical.

Once the barriers view factor has been determined, that value can be subtracted from the original unobstructed view factor (determined in step 1) and then that view factor value used in another calculation to determine the overall impact received at the site.

There are some assumptions (or limitations) in the application of such a methodology which need to be carefully considered. These include that:

- The barrier is the same width as the emitter itself (the barrier width is the same as the flame width); and
- The barrier is uniform in height (e.g. 3 m all the way along); and
- The barrier is constructed to be able to withstand the amount and duration of bushfire attack expected and will not become an emitter of radiation itself; and
- The methodology does not address the potential for flame contact or ember attack; and
- The location of the flame is not modified for the purposes of calculating its view factor. i.e. it is not moved to the midpoint of the distance between the base of the flame and flame tip – see Figure 2. Trigonometry can be used for situations where the barrier is not located at the edge of the vegetation. In that case the “actual height” input is purely cosmetic and should reflect the actual height of the barrier. The “Effective height” input should be used in that scenario to reflect the effective reduction in view factor.

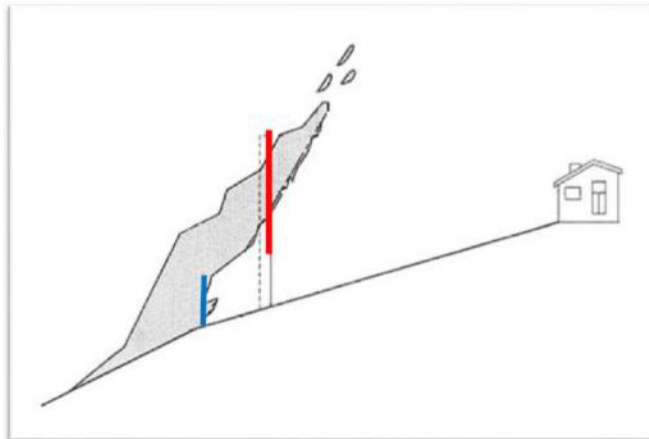


Figure 2 – Adjusted ‘view factor’ taking into account a barrier

(Red line indicates portion of emitter to which the adjusted view factor represents and blue line indicates the barrier)

Appendix D – Site photos

**ADVERTISED
PLAN**

**This copied document to be made available
for the sole purpose of enabling
its consideration and review as
part of a planning process under the
Planning and Environment Act 1987.
The document must not be used for any
purpose which may breach any
copyright**

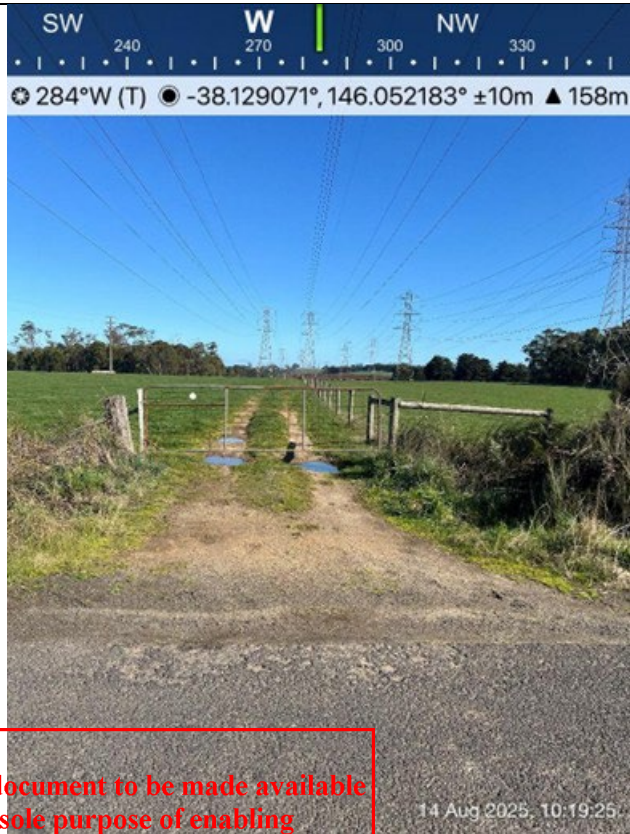


Figure 18 - Photopoint locations

**ADVERTISED
PLAN**


ADVERTISED PLAN

1. Looking west from
Darnum-Shady Creek
Road.




This copied document to be made available
for the sole purpose of enabling
its consideration and review as
part of a planning process under the
Planning and Environment Act 1987.
The document must not be used for any
purpose which may breach any
copyright.

2. Looking south along
Darnum-Shady Creek
Road.

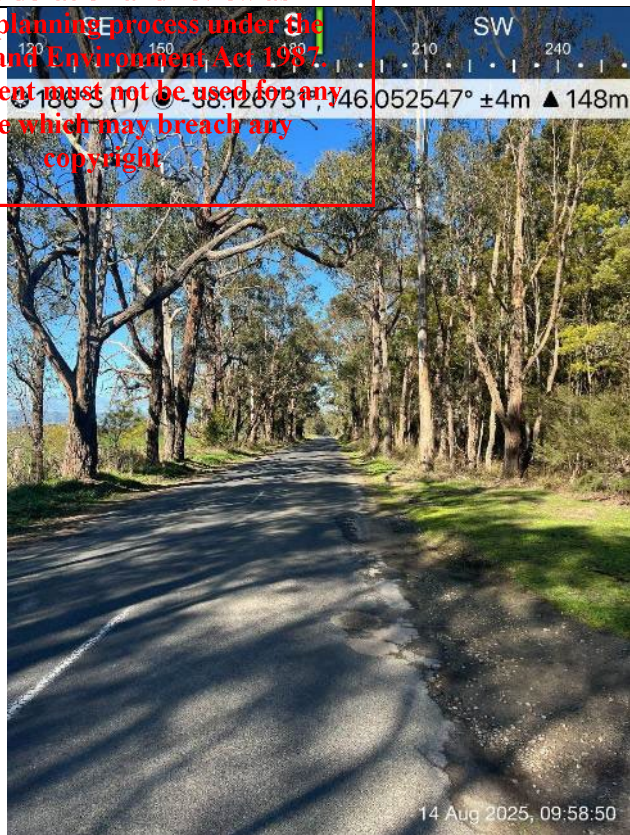

ADVERTISED PLAN

3. Looking north along Darnum-Shady Creek Road.

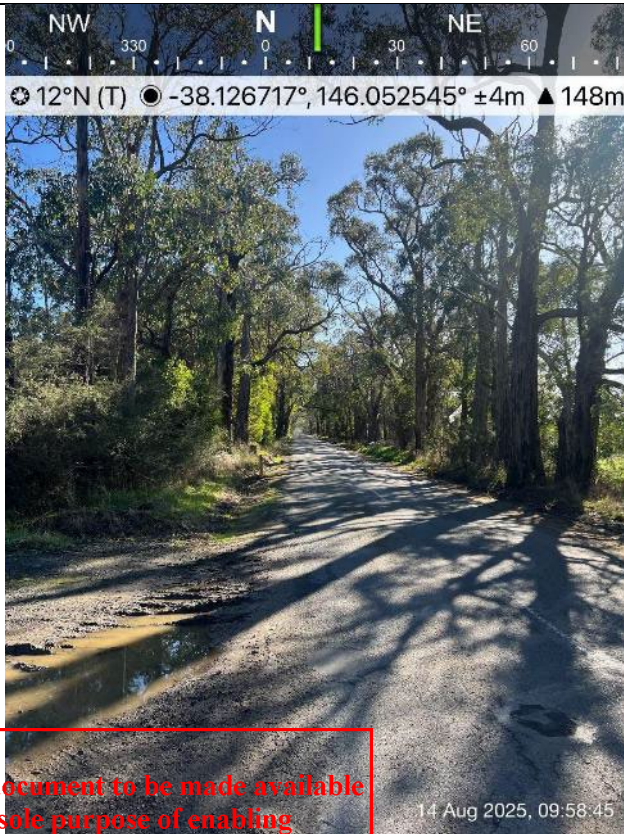


This copied document to be made available for the sole purpose of enabling its consideration and review as part of a planning process under the Planning and Environment Act 1987. The document must not be used for any purpose which may breach any copyright

4. Looking west at the existing site entrance.




ADVERTISED PLAN

5. Looking east towards the front of the site and existing site entrance.

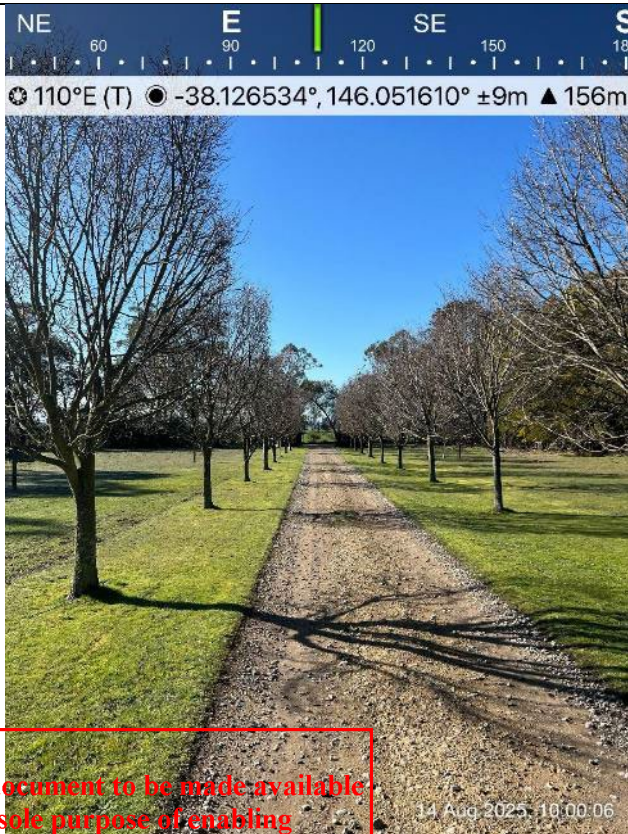


This copied document to be made available for the sole purpose of enabling its consideration and review as part of a planning process under the Planning and Environment Act 1987. The document must not be used for any purpose which may breach any copyright

6. Looking south at forested vegetation on the southeast side of the site.

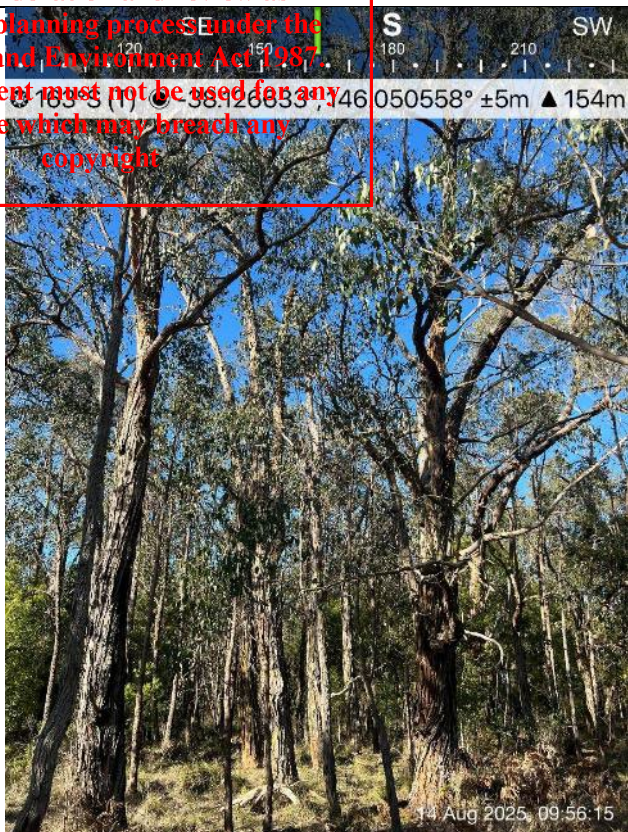


ADVERTISED PLAN

7. Looking south at the forested vegetation on the southeast side of the site.

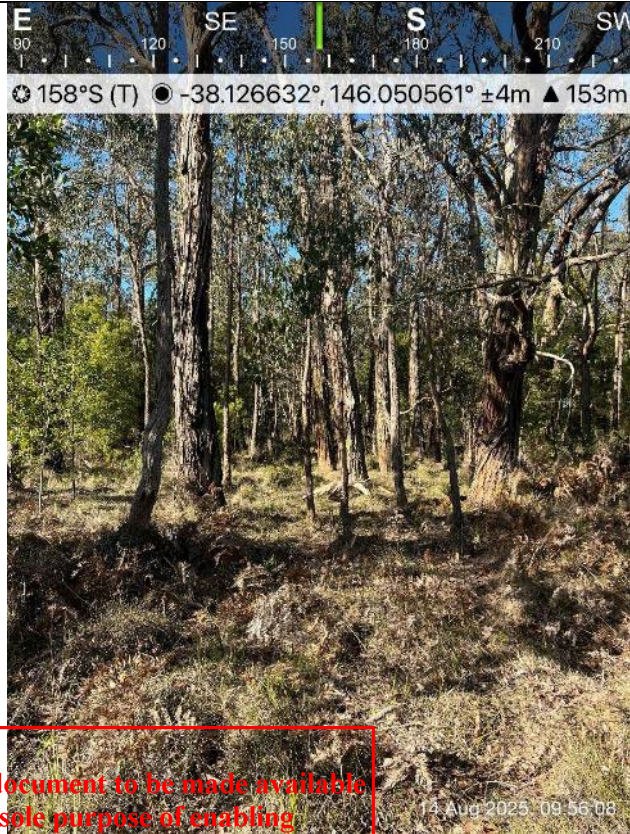

8. Looking east within the woodland vegetation on the northeast side of the site.

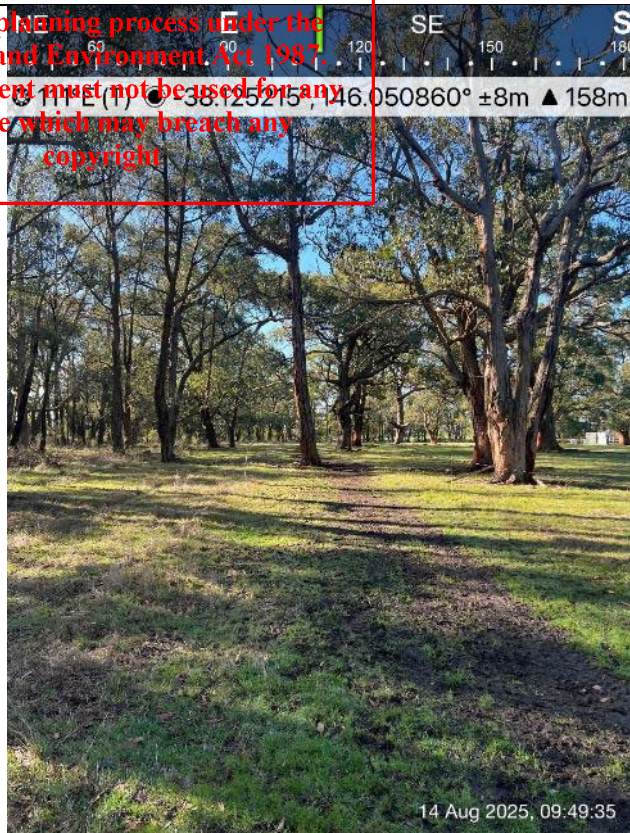

This copied document to be made available for the sole purpose of enabling its consideration and review as part of a planning process under the Planning and Environment Act 1987. The document must not be used for any purpose which may breach any copyright.


ADVERTISED PLAN

9. Looking east at the woodland vegetation on the eastern side of the site.



This copied document to be made available for the sole purpose of enabling its consideration and review as part of a planning process under the Planning and Environment Act 1987. The document must not be used for any purpose which may breach any copyright

10. Looking north at the woodland vegetation on the eastern side of the lot.

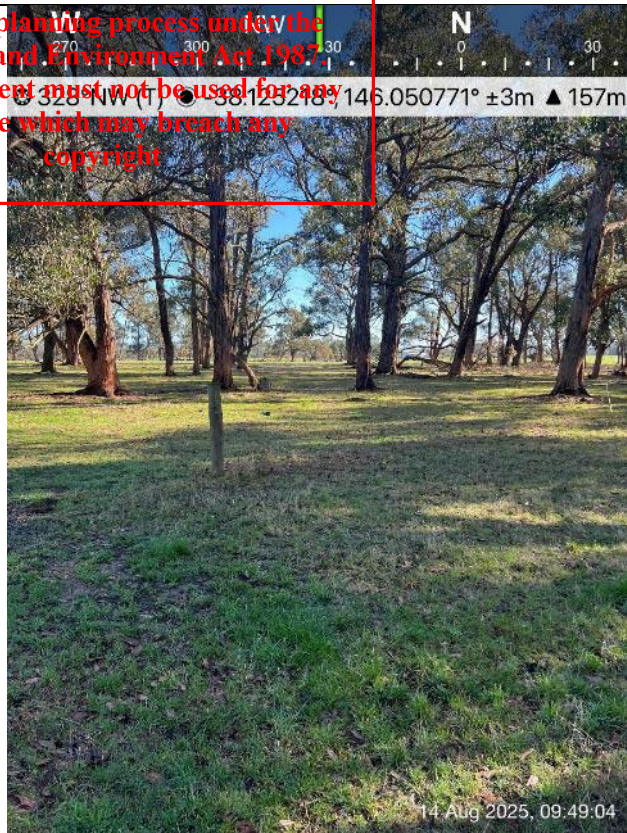

ADVERTISED PLAN

11. Looking west from the woodland vegetation on the eastern side of the site.



12. Looking north at the isolated vegetation patch.



This copied document to be made available for the sole purpose of enabling its consideration and review as part of a planning process under the Planning and Environment Act 1987. The document must not be used for any purpose which may breach any copyright

ADVERTISED PLAN

13. Looking northwest from the future Project location.	
14. Looking southwest from the future Project location.	

This copied document to be made available for the sole purpose of enabling its consideration and review as part of a planning process under the Planning and Environment Act 1987. The document must not be used for any purpose which may breach any copyright

ADVERTISED PLAN

15. Looking southeast from the future Project location.	 14 Aug 2025, 09:39:39
16. Looking south from the Project footprint.	 14 Aug 2025, 09:42:41

This copied document to be made available for the sole purpose of enabling its consideration and review as part of a planning process under the Planning and Environment Act 1987. The document must not be used for any purpose which may breach any copyright

**This copied document to be made available
for the sole purpose of enabling
its consideration and review as
part of a planning process under the
Planning and Environment Act 1987.
The document must not be used for any
purpose which may breach any
copyright**

**ADVERTISED
PLAN**