


NOTES:

- LEVELS ARE IN METRES TO AHD, COORDINATES ARE IN METRES TO MGA 94 ZONE 54.
- REFER TO STATION DESIGN MANUAL SDM 05-10400 EARTHWORKS, ROAD, PAVEMENTS AND DRAINAGE CONSTRUCTION SPECIFICATION.
- EXISTING SERVICES TO BE PROVEN PRIOR TO CONSTRUCTION.
- FOR MISCELLANEOUS DETAILS REFER TO DRG. TRTS-0000000-C06.
- FOR PAVEMENT DETAILS REFER TO DRG. TRTS-0000000-C20.
- REMOVE EXTERNAL PERIMETER STOCK FARM FENCE AND REINSTATE.
- WHERE SUBGRADE SHRINK/SWELL > 2.5%, MINIMUM 150mm THICK TYPE A CAPPING LAYER IN ACCORDANCE VICROADS SPECIFICATION SECTION 204 SHALL BE APPLIED TO SUBGRADE PRIOR TO SWITCHYARD PAVEMENT CONSTRUCTION. FOR ALTERNATIVE MATERIALS REFER STATEWIDE GEOTECHNICAL REPORT 26057-10 DATED 21 DECEMBER 2020 SECTION 6.3.
- PROVIDE ROCK BEACHING MIN. 3m UPDSTREAM AND DOWNSTREAM OF ALL DRAINAGE CULVERTS. WIDTH TO MATCH HEADWALL. ROCK BEACHING TO BE PLACED AT ALL BATTER CHUTE OUTLETS. 1.5m WIDTH TO MATCH HEADWALL. ALL ROCK BEACHING 2xD50 THICK. D50=200mm


LEGEND

- SECURITY FENCE
- EXISTING FENCE
- EXISTING CONTOURS
- DESIGN CONTOURS
- CONCRETE DISH DRAIN
- SWALE
- SUBSURFACE DRAINAGE
- SWITCHYARD PAVEMENT
- NATIVE VEGETATION (NO-GO AREA)
- ROCK BEACHING
- CONCRETE
- CRUSHED ROCK ACCESS ROAD
- GRATED PIT
- JUNCTION PIT
- FLAME TRAP PIT
- STORMWATER DRAINAGE PIPE
- ENVIRONMENTAL DRAINAGE PIPE
- CONTROL LINE AND LABEL
- DOUBLE SWING GATE
- STORMWATER PIT LABEL
- REFLECTIVE FLEXIBLE GUIDE POST
- STEEL BOLLARD
- RECYCLED PLASTIC BOLLARD

This copied document to be made available for the sole purpose of enabling its consideration and review as part of a planning process under the Planning and Environment Act 1987. The document must not be used for any purpose which may breach any copyright

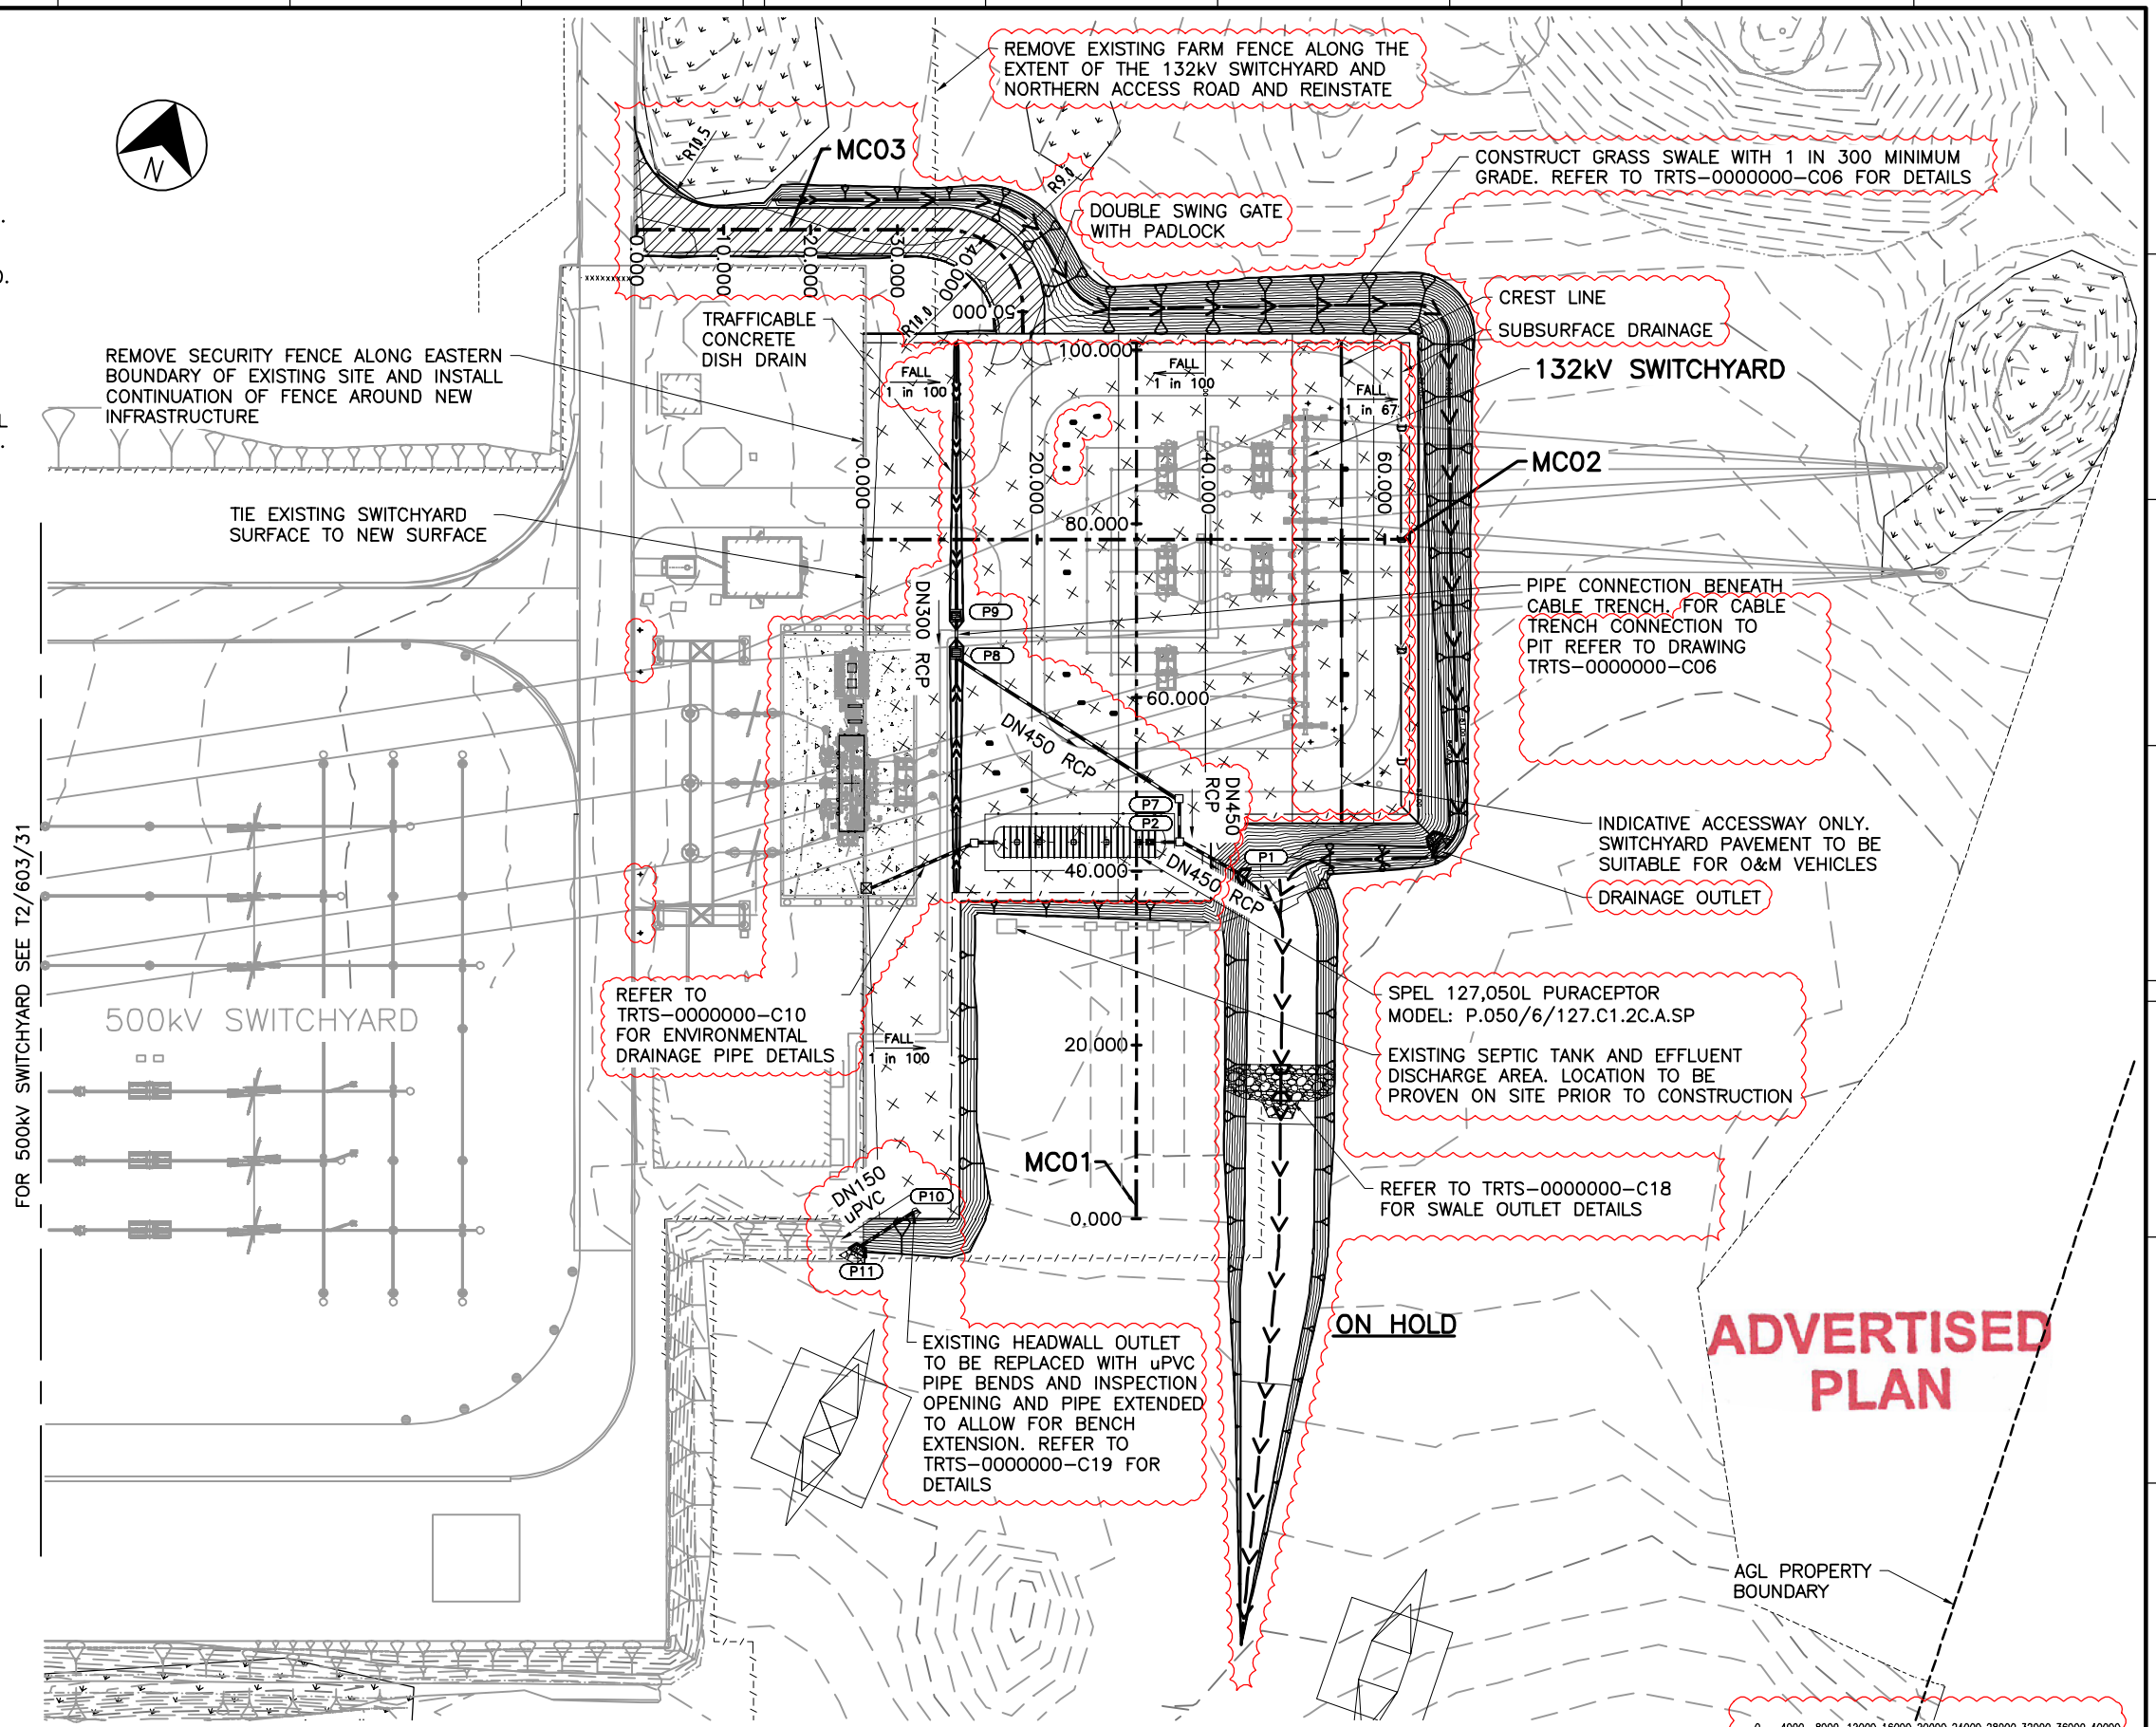

PLAN
SCALE 1:400



ADVERTISED PLAN

ON HOLD

REFERENCE DRAWINGS	DATE	REV	DESCRIPTION	BY	CONTRACTOR	ISSUED	Spec No.	Order No.	Legacy No.
500KV SWITCHYARD EARTHWORKS ARRANGEMENT	T2/603/31								
EARTHWORKS DETAILS	T2/603/38								
EARTHWORK AND DRAINAGE CONSTRUCTION NOTES	T2/603/28								
DRAWING TITLE	DRAWING No.			DATE	REV	DESCRIPTION	BY	CONTRACTOR	ISSUED
	18.08.21	1.0	FIRST ISSUE (TC-0012062)	MT	JACOBS				

		TARRONE TERMINAL STATION 132KV SWITCHYARD EARTHWORKS, ROADS AND DRAINAGE ARRANGEMENT	
DRAWN ENDORSED ENDORSED DATE	REV 1.2 REV 1.2 ENDORSED DATE	Spec No. Order No. Legacy No.	Drawing No. TRTS-0000000-C01

FOR REVIEW