



Attachment C

Development Plans

This copied document to be made available
for the sole purpose of enabling
its consideration and review as
part of a planning process under the
Planning and Environment Act 1987.
The document must not be used for any
purpose which may breach any
copyright

CAMPERDOWN BESS

REGIONAL CONTEXT

LEGEND

- Town
- + Rail
- Road
- Watercourse
- Proposed Access Route
- Development Area
- Cadastre (Subject Site)
- Cadastre

DISCLAIMER: All information within this document may be based on external sources. SLR Consulting Pty Ltd makes no warranty regarding the data's accuracy or reliability for any purpose.




Coordinate System: GDA2020 MGA Zone 54

Scale: 1:15,000 at A4


Project Number: 620.041535

Date Drawn: 22-Jul-2026

Drawn by: RB

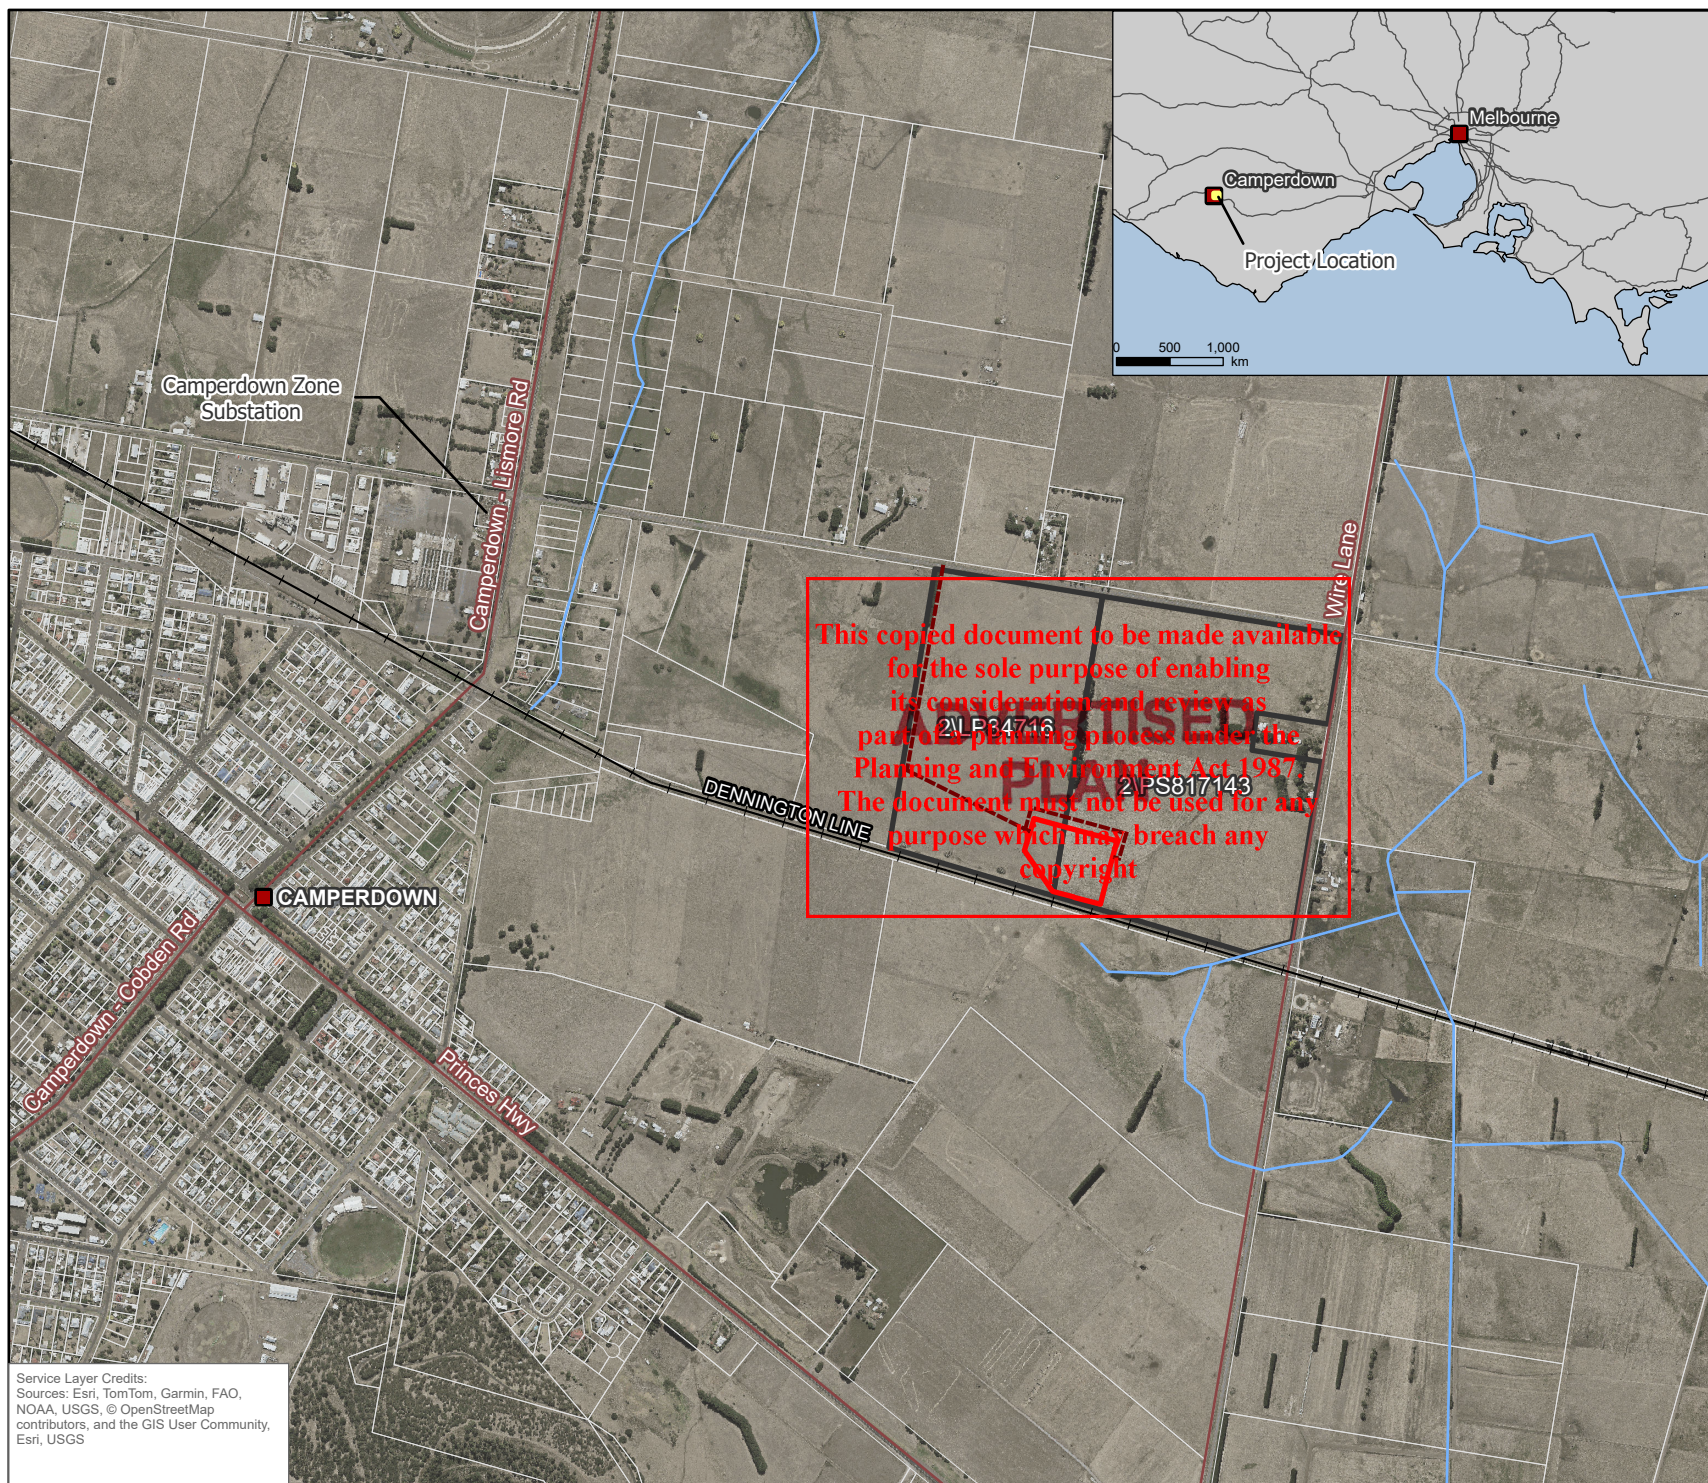

Service Layer Credits:
Sources: Esri, TomTom, Garmin, FAO, NOAA, USGS, © OpenStreetMap contributors, and the GIS User Community, Esri, USGS

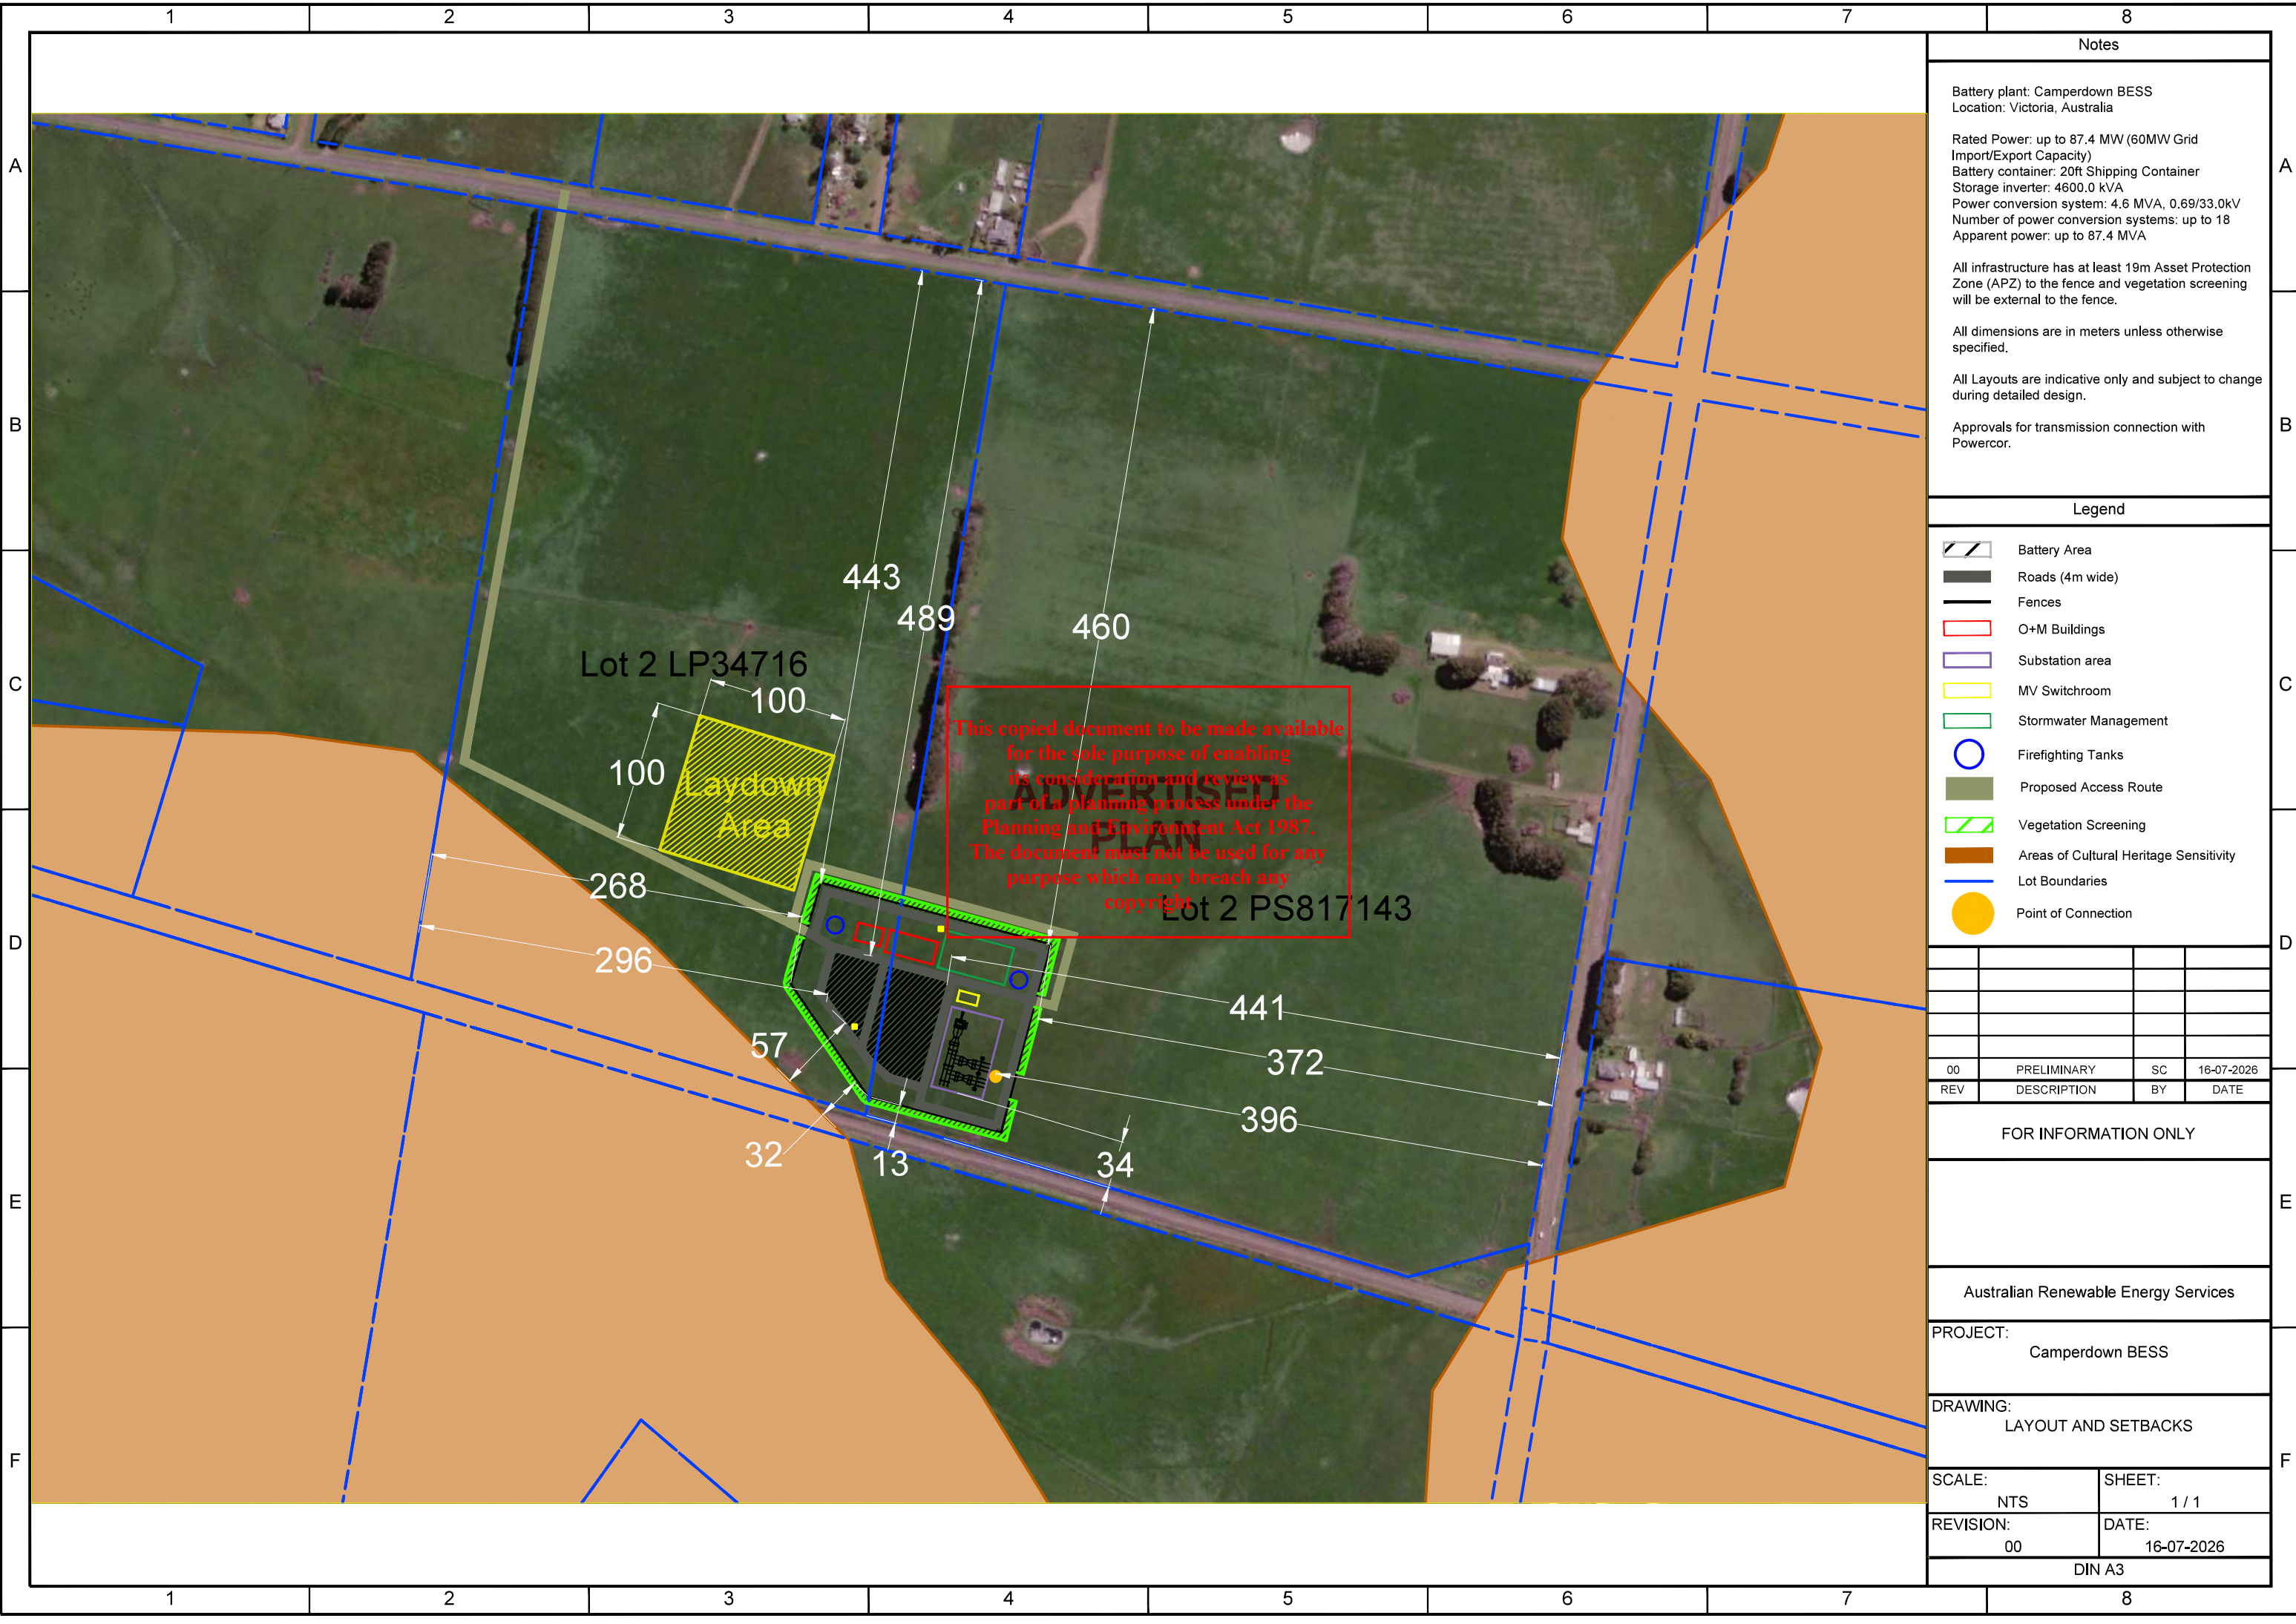

Notes

Battery plant: Camperdown BESS
Location: Victoria, Australia

Rated Power: up to 87.4 MW (60MW Grid Import/Export Capacity)
Battery container: 20ft Shipping Container
Storage inverter: 4600.0 kVA
Power conversion system: 4.6 MVA, 0.69/33.0kV
Number of power conversion systems: up to 18
Apparent power: up to 87.4 MVA

All infrastructure has at least 19m Asset Protection Zone (APZ) to the fence and vegetation screening will be external to the fence.

All dimensions are in meters unless otherwise specified.

All Layouts are indicative only and subject to change during detailed design.

Approvals for transmission connection with Powercor.

- Legend
- Battery Area
 - Roads (4m wide)
 - Fences
 - O+M Buildings
 - Substation area
 - MV Switchroom
 - Stormwater Management
 - Firefighting Tanks
 - Proposed Access Route
 - Vegetation Screening
 - Areas of Cultural Heritage Sensitivity
 - Lot Boundaries
 - Point of Connection

00	PRELIMINARY	SC	16-07-2026
REV	DESCRIPTION	BY	DATE

FOR INFORMATION ONLY

Australian Renewable Energy Services

PROJECT: Camperdown BESS

DRAWING: LAYOUT AND SETBACKS

SCALE: NTS	SHEET: 1 / 1
REVISION: 00	DATE: 16-07-2026

DIN A3



Notes

Battery plant: Camperdown BESS
Location: Victoria, Australia

Rated Power: up to 87.4 MW (60MW Grid Import/Export Capacity)
Battery container: 20ft Shipping Container
Storage inverter: 4600.0 kVA
Power conversion system: 4.6 MVA, 0.69/33.0kV
Number of power conversion systems: up to 18
Apparent power: up to 87.4 MVA

All infrastructure has at least 19m Asset Protection Zone (APZ) to the fence and vegetation screening will be external to the fence.

All dimensions are in meters unless otherwise specified.

All Layouts are indicative only and subject to change during detailed design.

Approvals for transmission connection with Powercor.

- Legend
- Power Conversion Units
 - Battery Containers
 - Roads (4m wide)
 - Fences
 - O+M Buildings
 - Substation area
 - MV Switchroom
 - Stormwater Management
 - Firefighting Water Tanks
 - Vegetation Screening
 - Areas of Cultural Heritage Sensitivity
 - Lot Boundaries
 - Fire Hydrants
 - Point of Connection

07	PRELIMINARY	SC	16-07-2026
06	PRELIMINARY	SC	23-04-2026
05	PRELIMINARY	SC	07-04-2026
04	PRELIMINARY	SC	25-03-2026
03	PRELIMINARY	SC	13-03-2026
02	PRELIMINARY	SC	27-01-2026
REV	DESCRIPTION	BY	DATE

FOR INFORMATION ONLY


Australian Renewable Energy Services

PROJECT: Camperdown BESS

DRAWING: LAYOUT (DETAIL)

SCALE: NTS	SHEET: 1 / 1
REVISION: 06	DATE: 16-07-2026

DIN A3

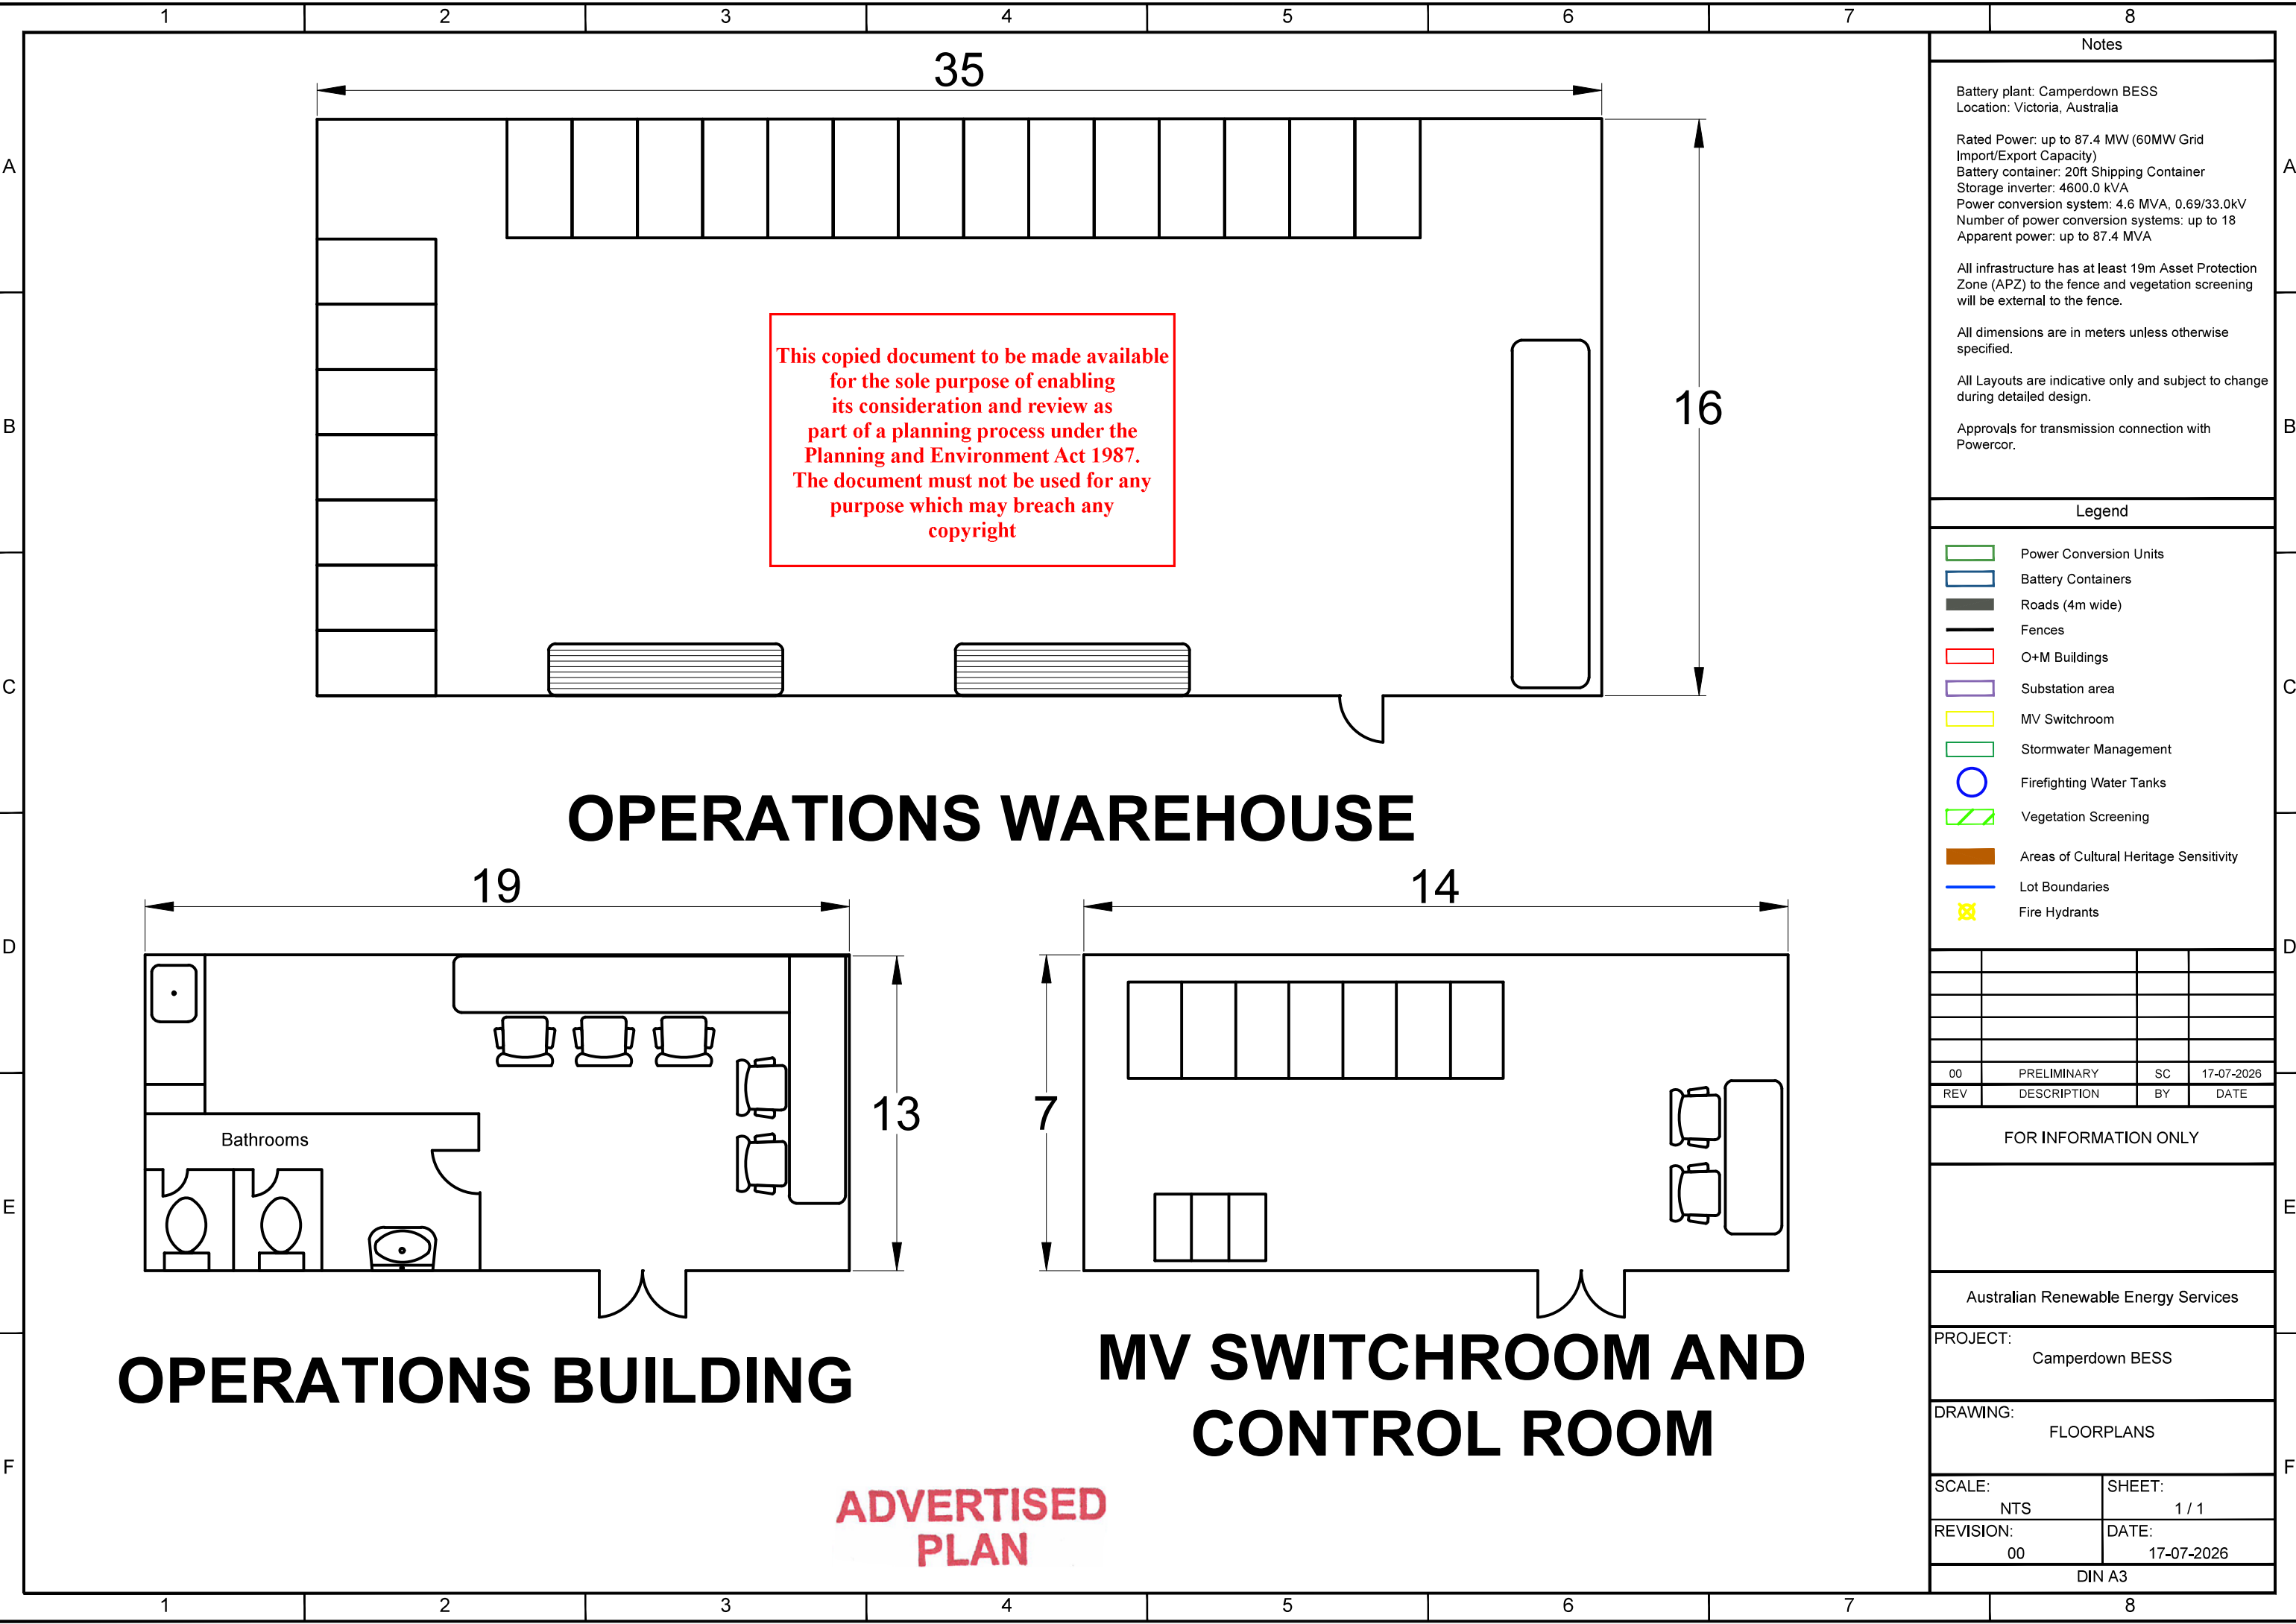

This copied document to be made available for the sole purpose of enabling its consideration and review as part of a planning process under the Planning and Environment Act 1987. The document must not be used for any purpose which may breach any copyright

Notes

Battery plant: Camperdown BESS
Location: Victoria, Australia

Rated Power: up to 87.4 MW (60MW Grid Import/Export Capacity)
Battery container: 20ft Shipping Container
Storage inverter: 4600.0 kVA
Power conversion system: 4.6 MVA, 0.69/33.0kV
Number of power conversion systems: up to 18
Apparent power: up to 87.4 MVA

All infrastructure has at least 19m Asset Protection Zone (APZ) to the fence and vegetation screening will be external to the fence.

All dimensions are in meters unless otherwise specified.

All Layouts are indicative only and subject to change during detailed design.

Approvals for transmission connection with Powercor.

- Legend**
- Power Conversion Units
 - Battery Containers
 - Roads (4m wide)
 - Fences
 - O+M Buildings
 - Substation area
 - MV Switchroom
 - Stormwater Management
 - Firefighting Water Tanks
 - Vegetation Screening
 - Areas of Cultural Heritage Sensitivity
 - Lot Boundaries
 - Fire Hydrants

00	PRELIMINARY	SC	17-07-2026
REV	DESCRIPTION	BY	DATE

FOR INFORMATION ONLY

Australian Renewable Energy Services

PROJECT: Camperdown BESS


DRAWING: FLOORPLANS

SCALE: NTS	SHEET: 1 / 1
REVISION: 00	DATE: 17-07-2026
DIN A3	

OPERATIONS BUILDING

MV SWITCHROOM AND CONTROL ROOM

ADVERTISED PLAN

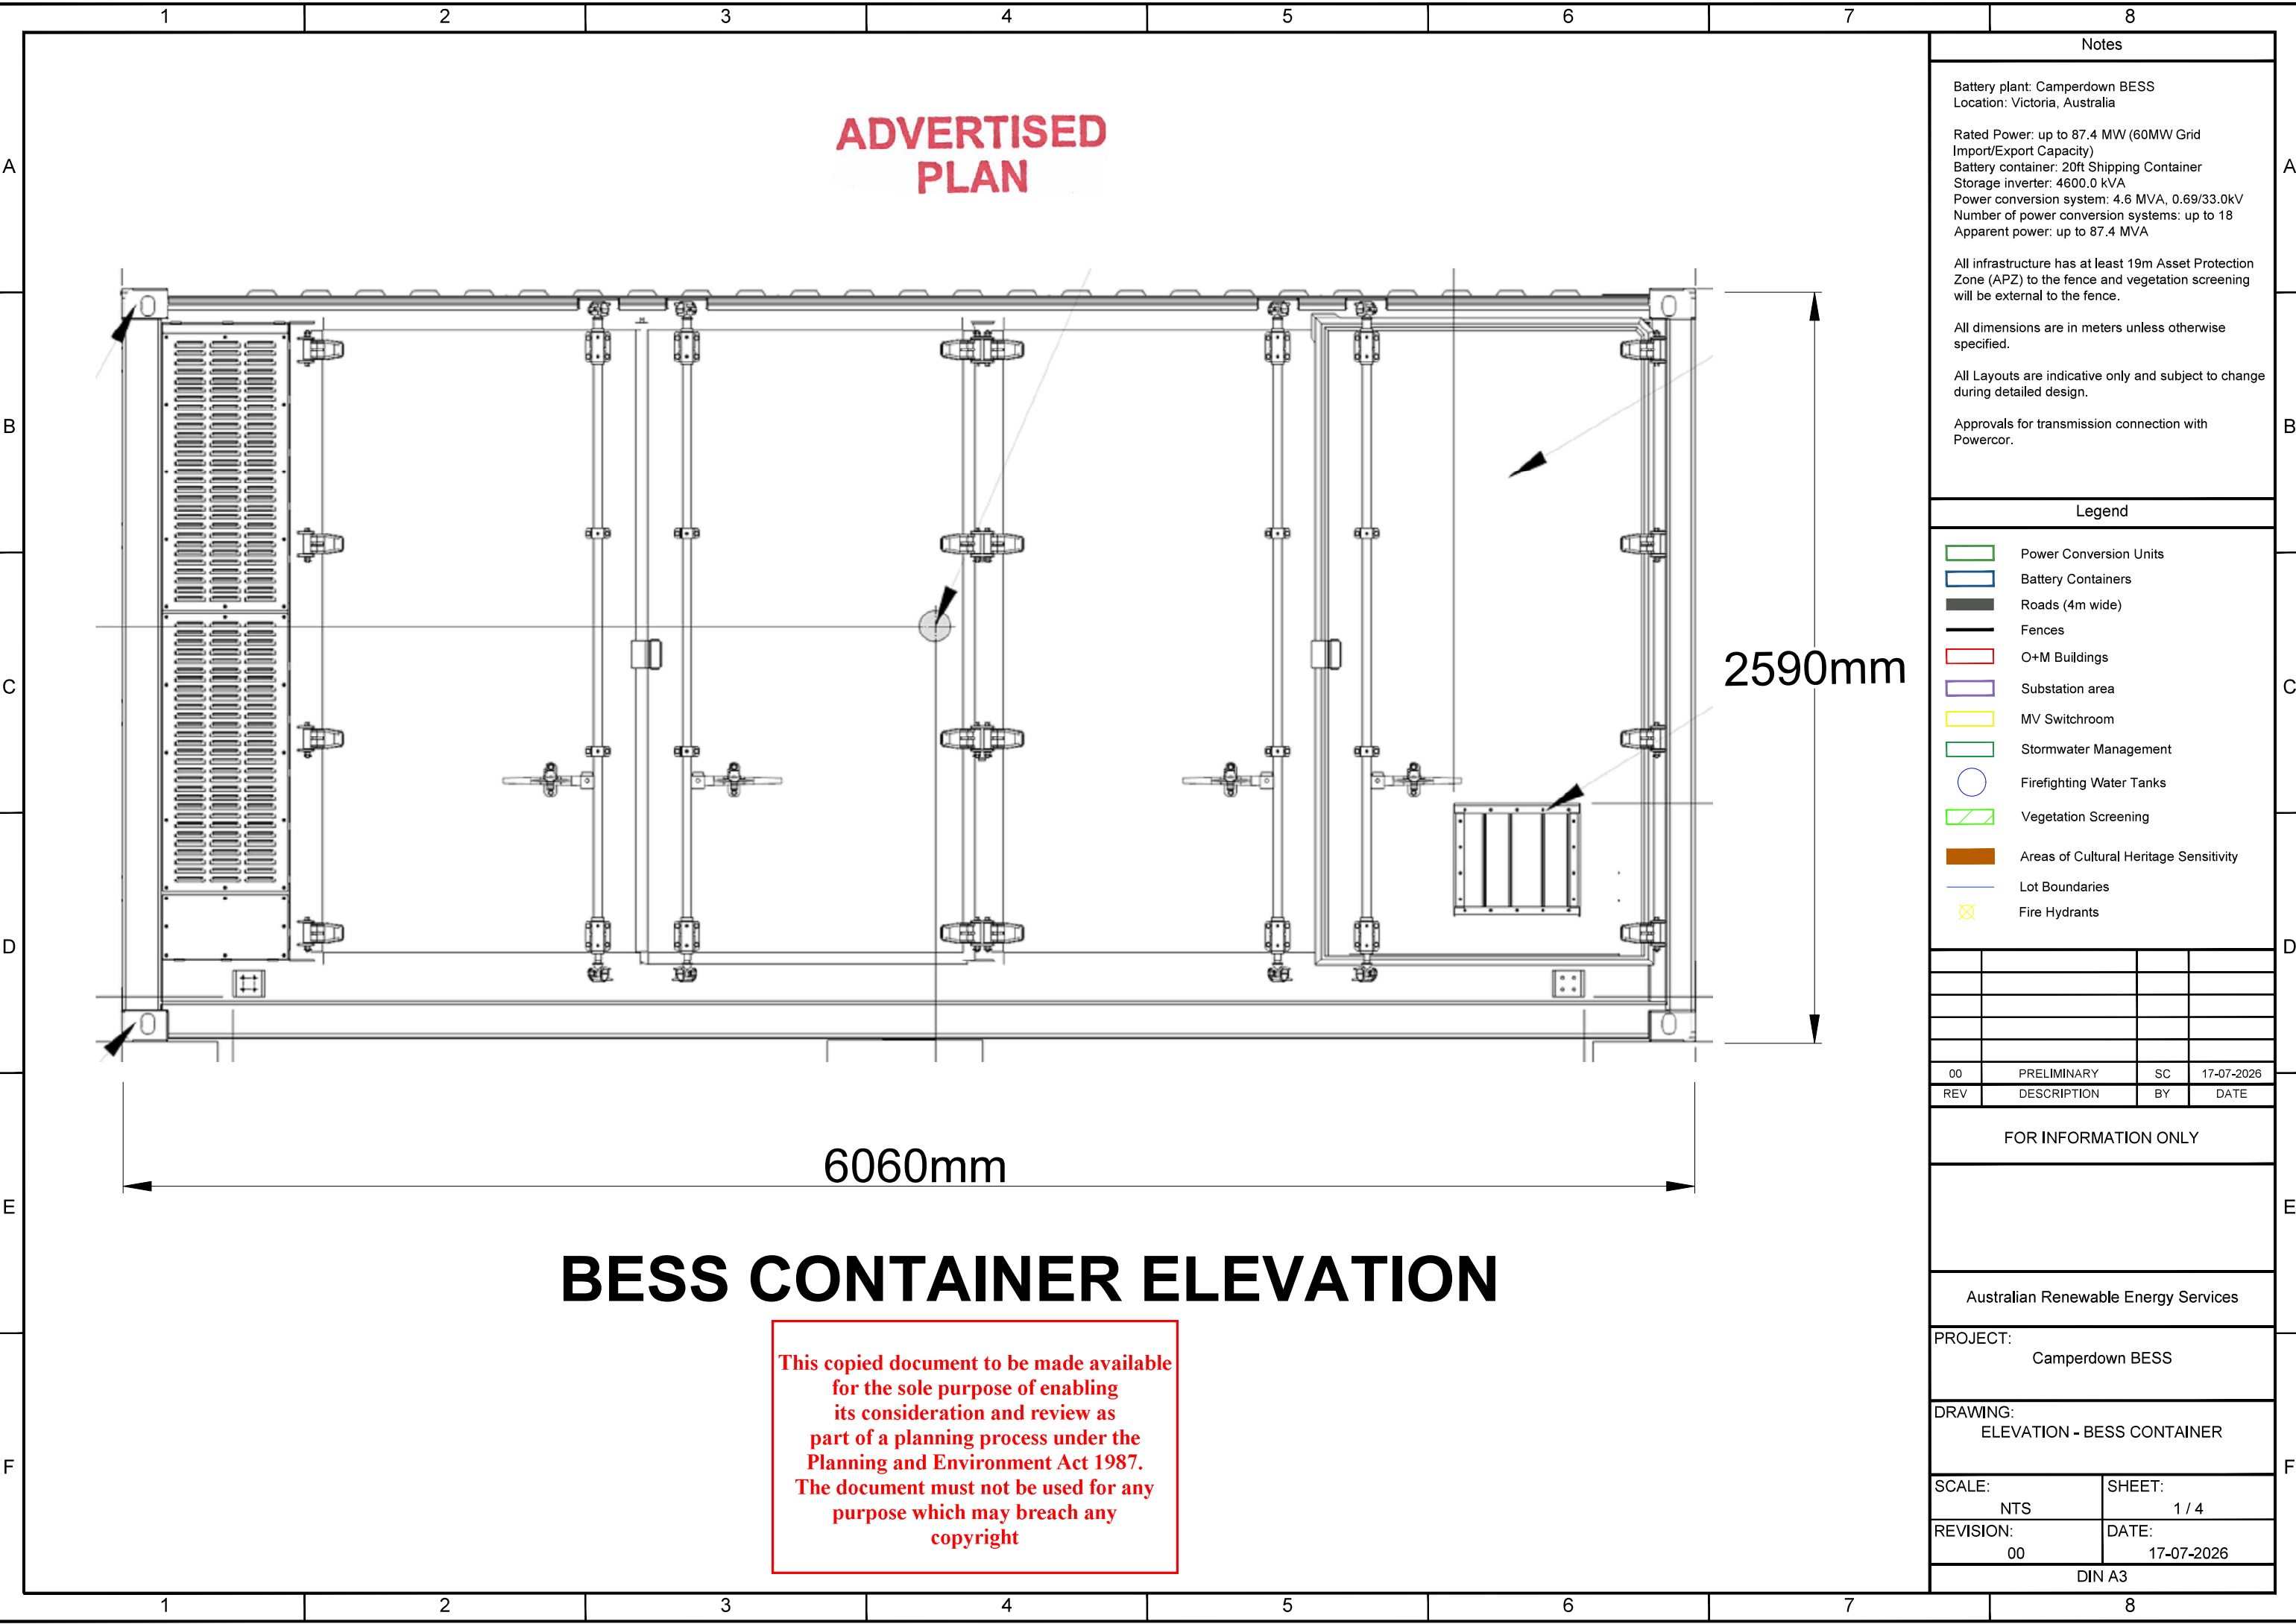

ADVERTISED
PLAN

2590mm

6060mm

BESS CONTAINER ELEVATION

This copied document to be made available
for the sole purpose of enabling
its consideration and review as
part of a planning process under the
Planning and Environment Act 1987.
The document must not be used for any
purpose which may breach any
copyright

Notes

Battery plant: Camperdown BESS
Location: Victoria, Australia

Rated Power: up to 87.4 MW (60MW Grid Import/Export Capacity)
Battery container: 20ft Shipping Container
Storage inverter: 4600.0 kVA
Power conversion system: 4.6 MVA, 0.69/33.0kV
Number of power conversion systems: up to 18
Apparent power: up to 87.4 MVA

All infrastructure has at least 19m Asset Protection Zone (APZ) to the fence and vegetation screening will be external to the fence.

All dimensions are in meters unless otherwise specified.

All Layouts are indicative only and subject to change during detailed design.

Approvals for transmission connection with Powercor.

Legend

Power Conversion Units

Battery Containers

Roads (4m wide)

Fences

O+M Buildings

Substation area

MV Switchroom

Stormwater Management

Firefighting Water Tanks

Vegetation Screening

Areas of Cultural Heritage Sensitivity

Lot Boundaries

Fire Hydrants

00	PRELIMINARY	SC	17-07-2026
REV	DESCRIPTION	BY	DATE

FOR INFORMATION ONLY

Australian Renewable Energy Services

PROJECT:
Camperdown BESS

DRAWING:
ELEVATION - BESS CONTAINER


SCALE:
NTS

SHEET:
1 / 4

REVISION:
00

DATE:
17-07-2026

DIN A3

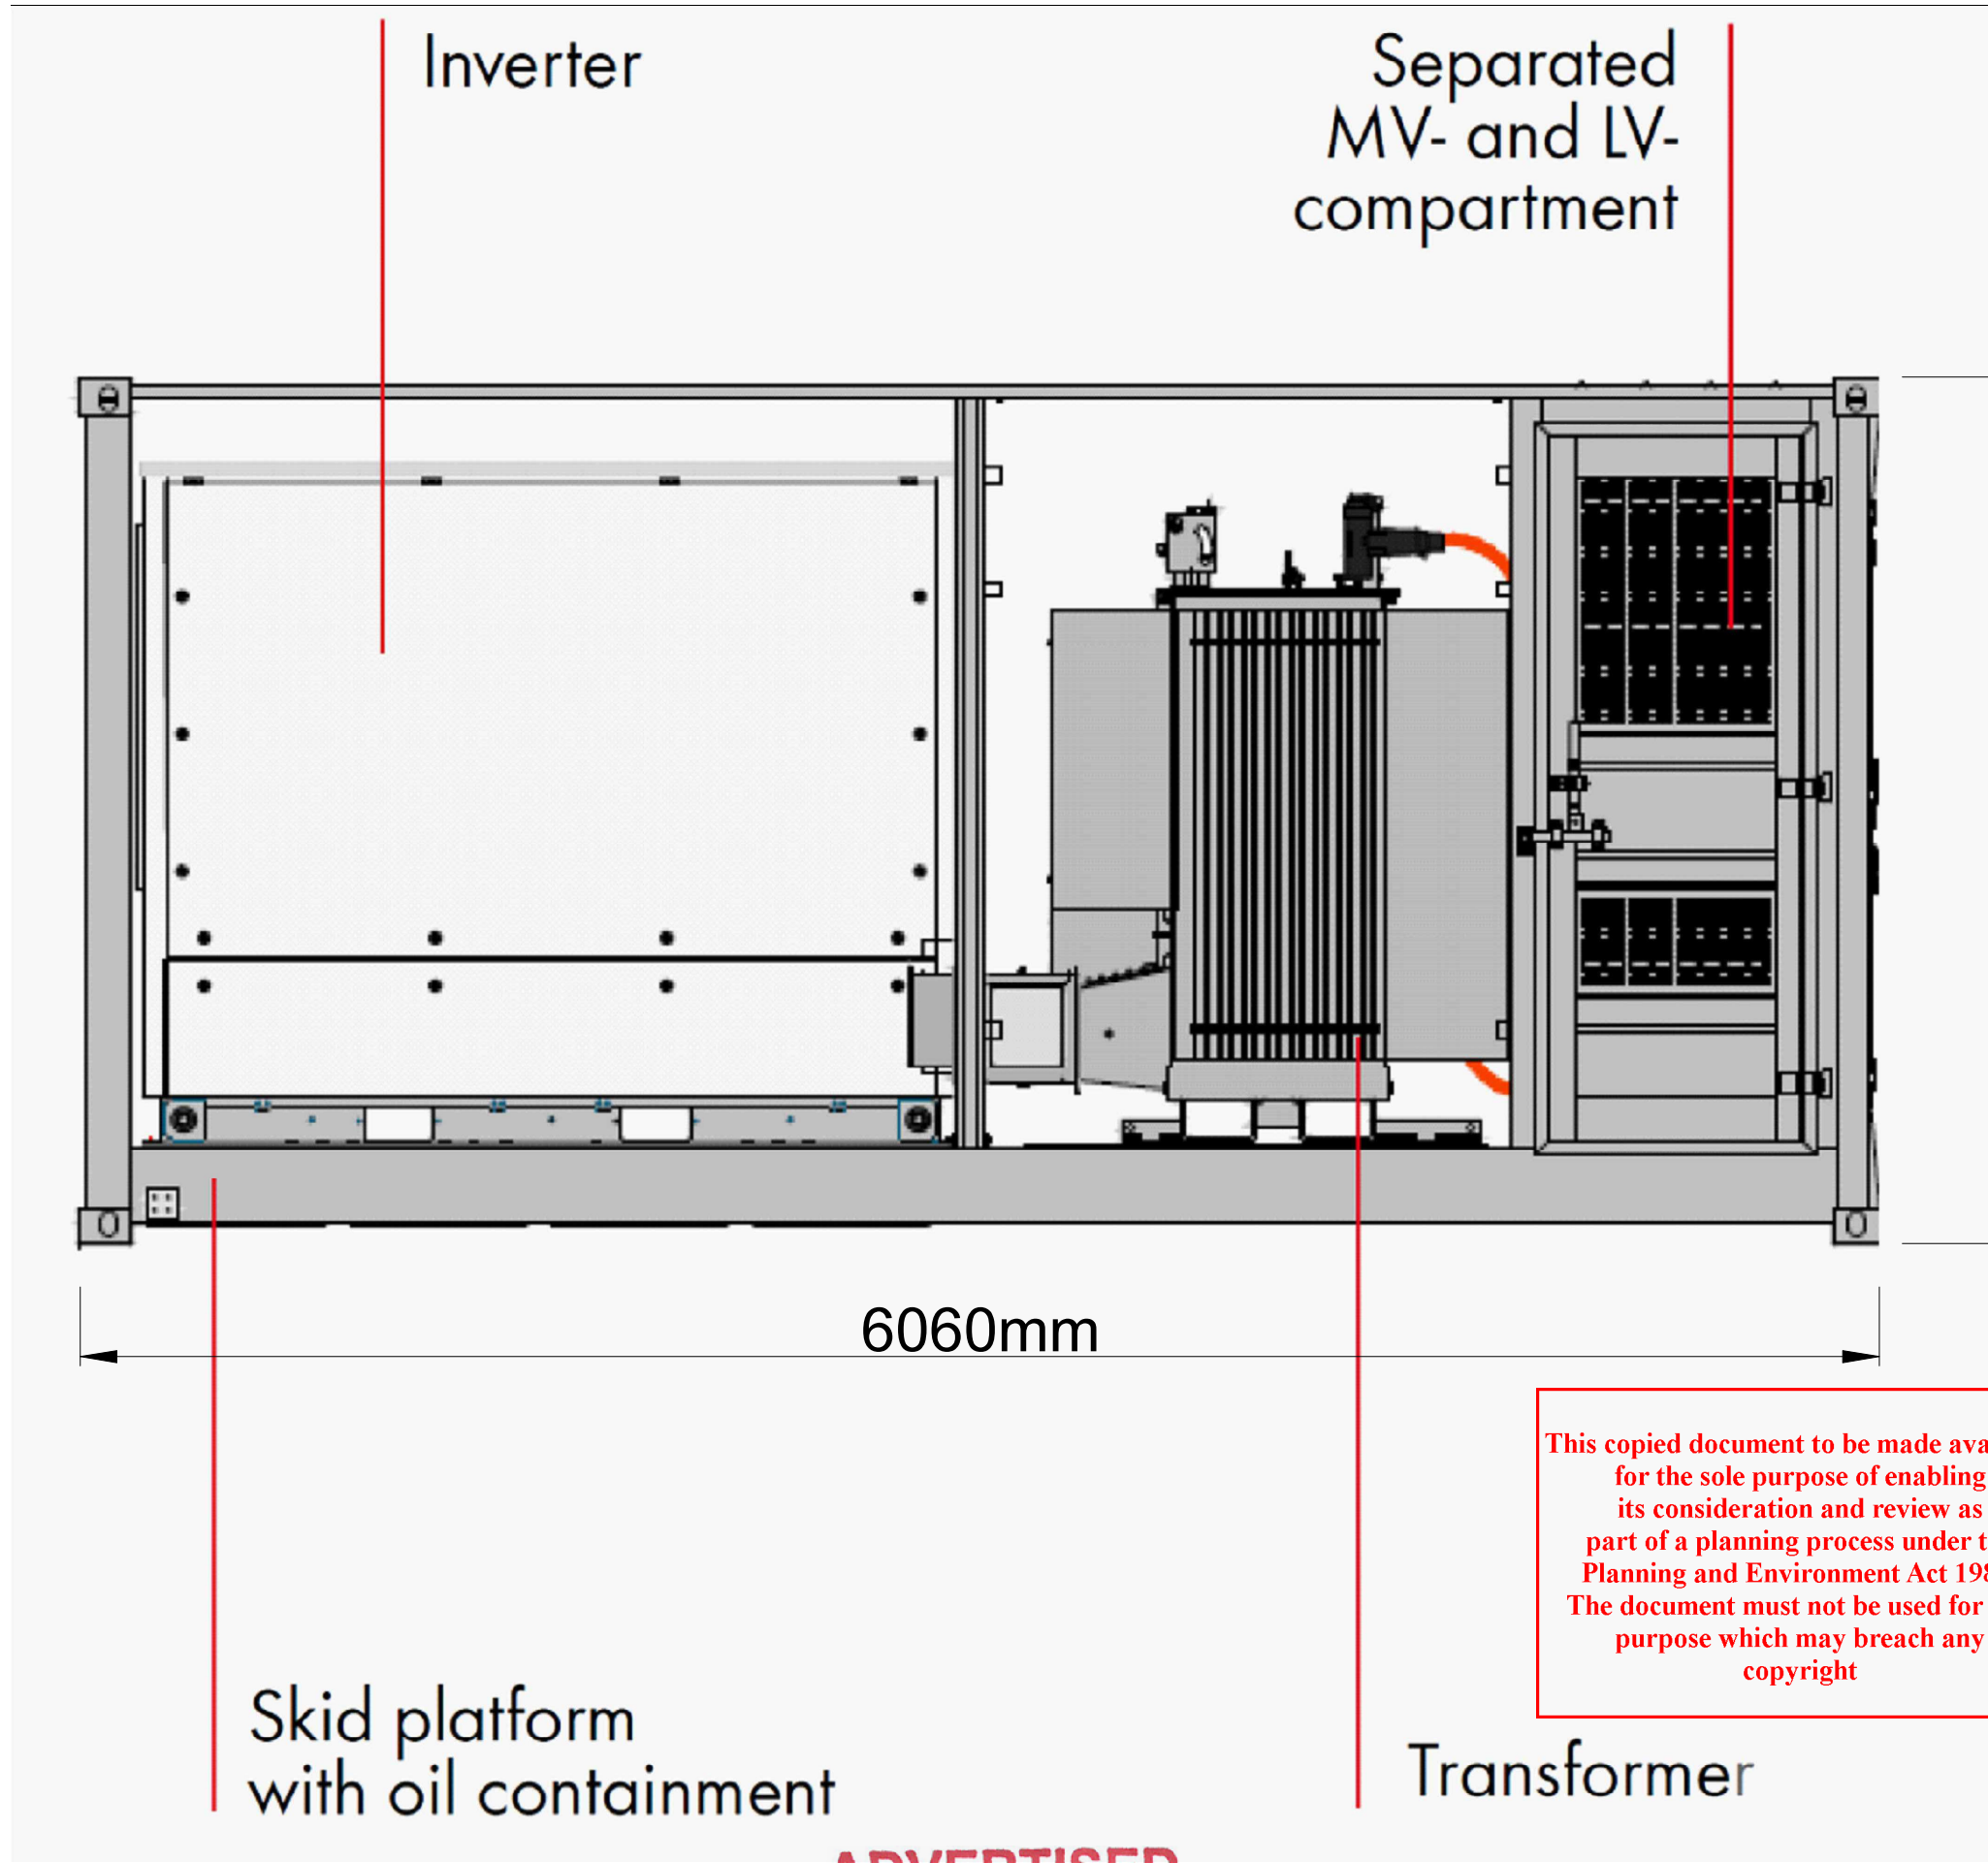

Notes

Battery plant: Camperdown BESS
Location: Victoria, Australia

Rated Power: up to 87.4 MW (60MW Grid Import/Export Capacity)
Battery container: 20ft Shipping Container
Storage inverter: 4600.0 kVA
Power conversion system: 4.6 MVA, 0.69/33.0kV
Number of power conversion systems: up to 18
Apparent power: up to 87.4 MVA

All infrastructure has at least 19m Asset Protection Zone (APZ) to the fence and vegetation screening will be external to the fence.

All dimensions are in meters unless otherwise specified.

All Layouts are indicative only and subject to change during detailed design.

Approvals for transmission connection with Powercor.

- Legend
- Power Conversion Units
 - Battery Containers
 - Roads (4m wide)
 - Fences
 - O+M Buildings
 - Substation area
 - MV Switchroom
 - Stormwater Management
 - Firefighting Water Tanks
 - Vegetation Screening
 - Areas of Cultural Heritage Sensitivity
 - Lot Boundaries
 - Fire Hydrants

00	PRELIMINARY	SC	17-07-2026
REV	DESCRIPTION	BY	DATE

FOR INFORMATION ONLY

Australian Renewable Energy Services


PROJECT: Camperdown BESS

DRAWING: ELEVATION - POWER CONVERSION UNIT

SCALE: NTS	SHEET: 2 / 4
REVISION: 00	DATE: 17-07-2026
DIN A3	

This copied document to be made available for the sole purpose of enabling its consideration and review as part of a planning process under the Planning and Environment Act 1987. The document must not be used for any purpose which may breach any copyright

ADVERTISED PLAN

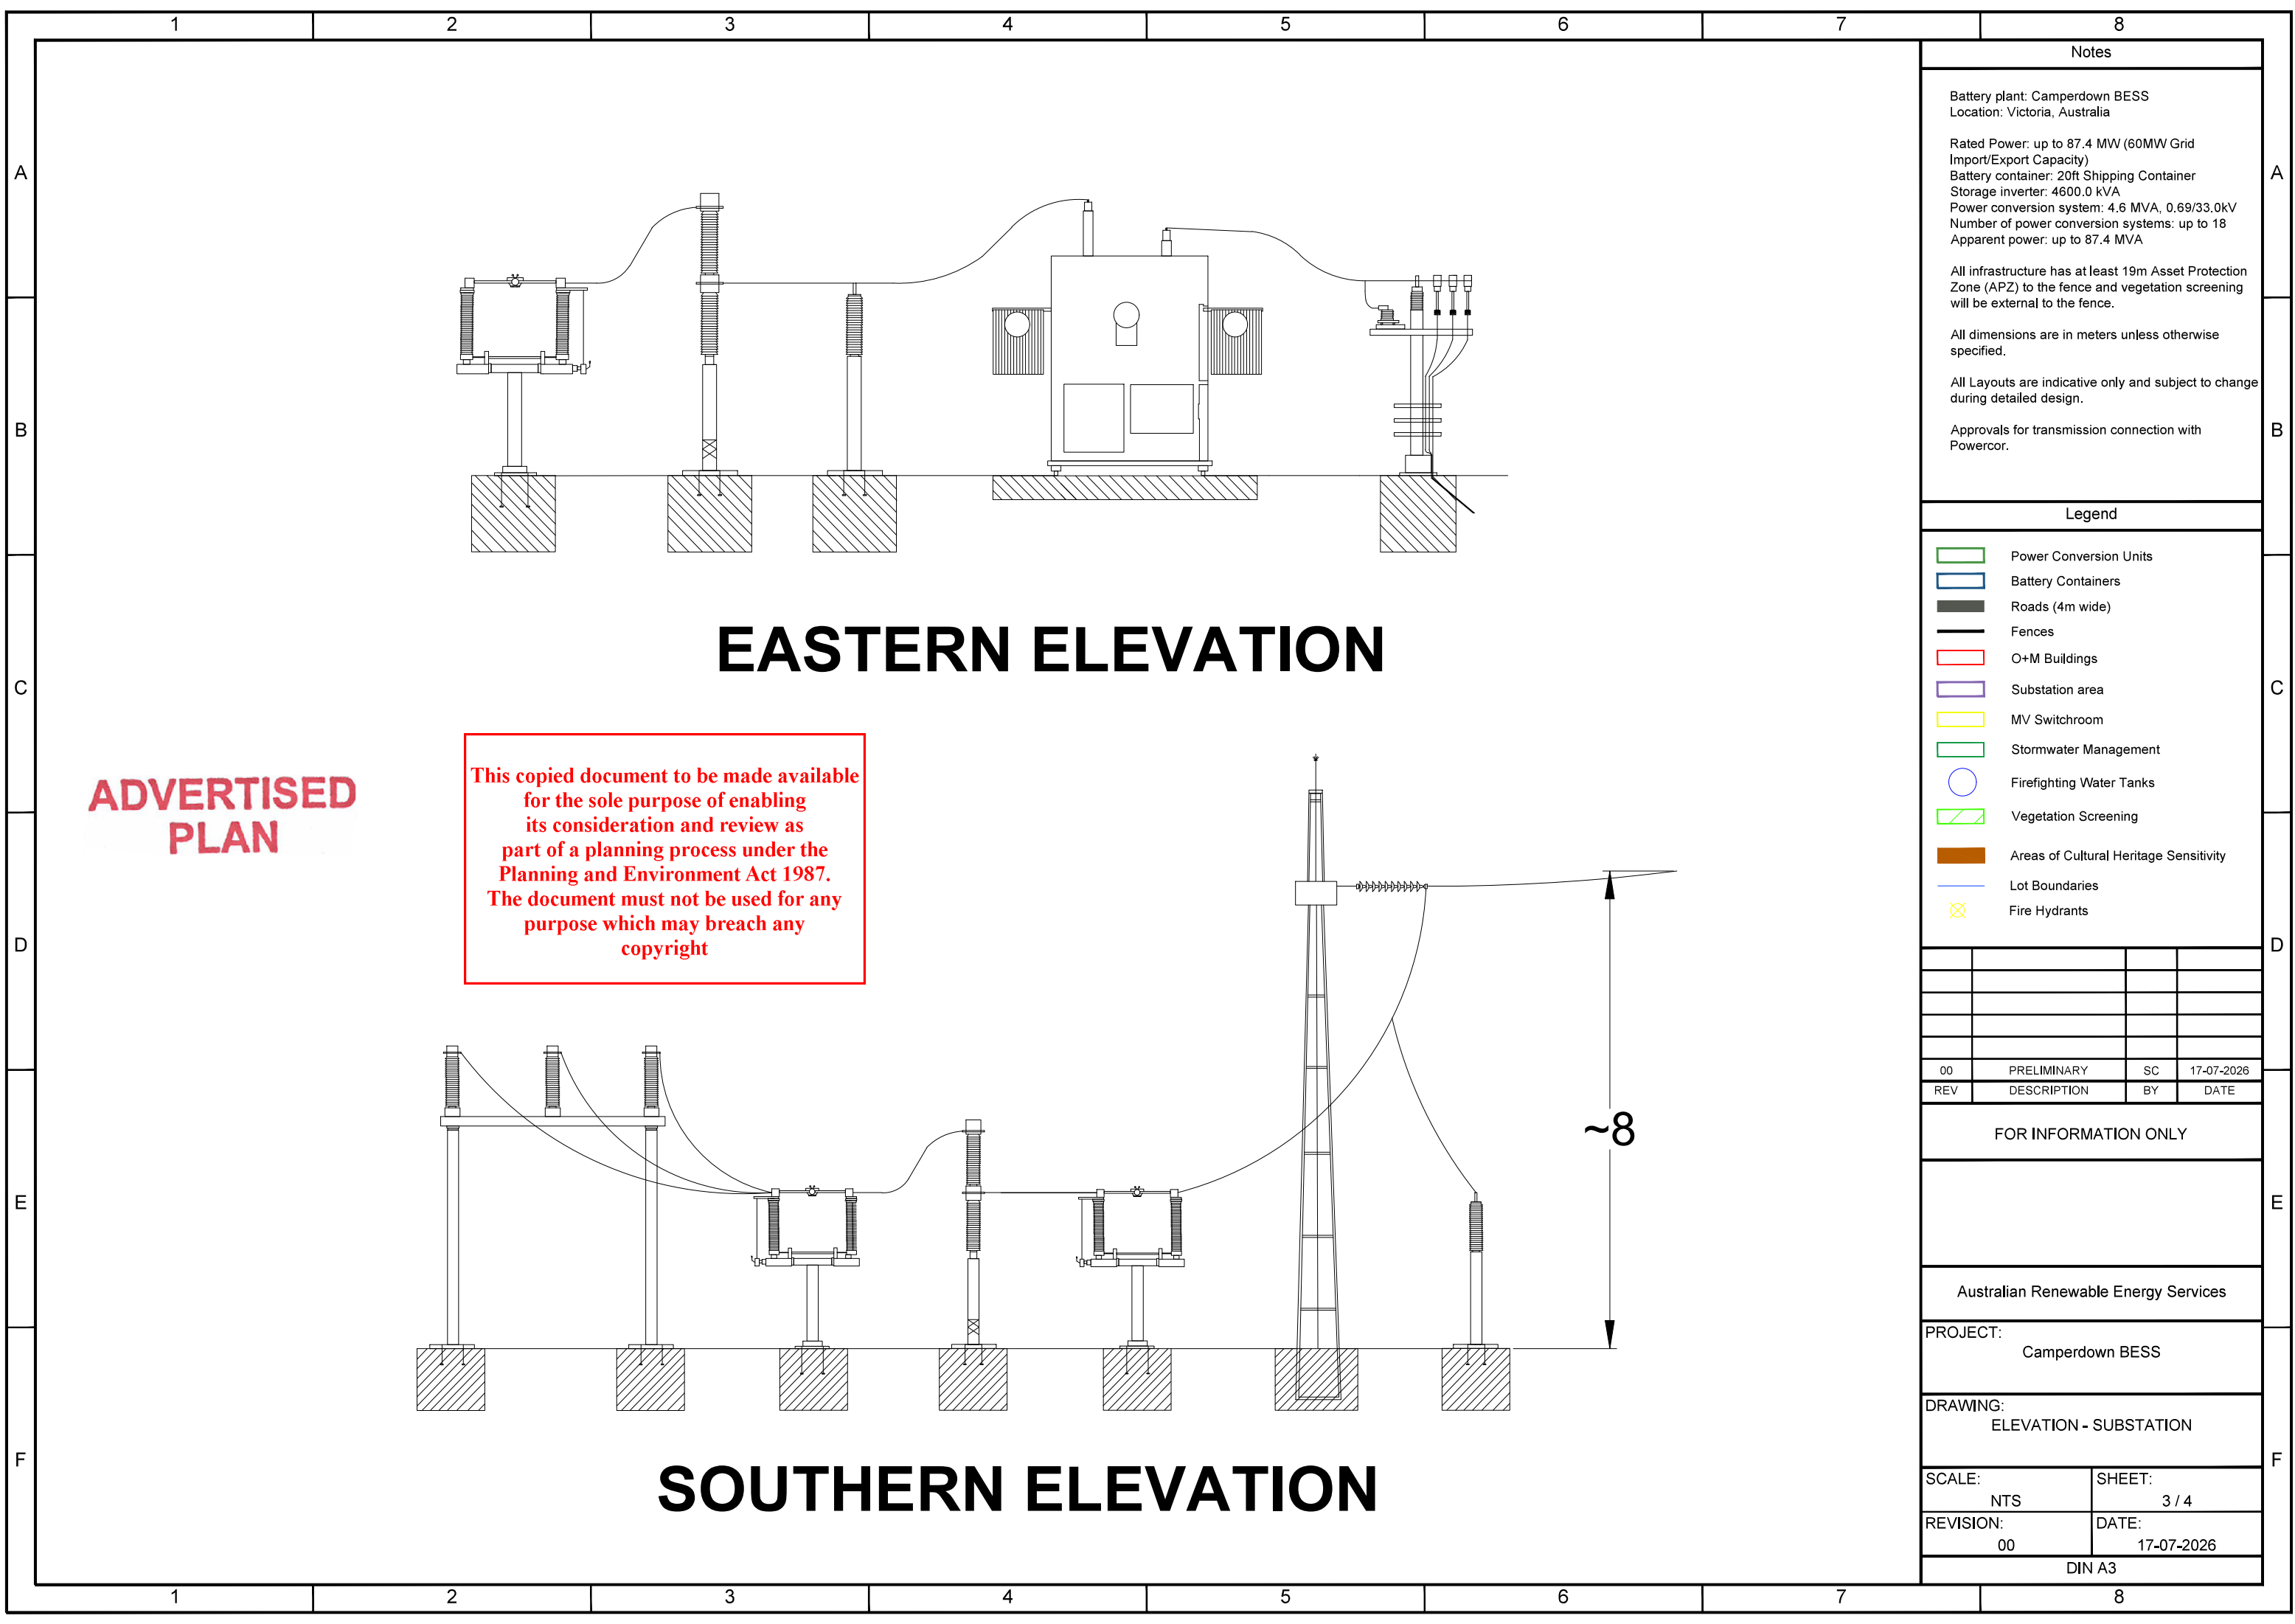

EASTERN ELEVATION

SOUTHERN ELEVATION

ADVERTISED
PLAN

This copied document to be made available
for the sole purpose of enabling
its consideration and review as
part of a planning process under the
Planning and Environment Act 1987.
The document must not be used for any
purpose which may breach any
copyright

Notes

Battery plant: Camperdown BESS
Location: Victoria, Australia

Rated Power: up to 87.4 MW (60MW Grid Import/Export Capacity)
Battery container: 20ft Shipping Container
Storage inverter: 4600.0 kVA
Power conversion system: 4.6 MVA, 0.69/33.0kV
Number of power conversion systems: up to 18
Apparent power: up to 87.4 MVA

All infrastructure has at least 19m Asset Protection Zone (APZ) to the fence and vegetation screening will be external to the fence.

All dimensions are in meters unless otherwise specified.


All Layouts are indicative only and subject to change during detailed design.

Approvals for transmission connection with Powercor.

- Legend
- Power Conversion Units
 - Battery Containers
 - Roads (4m wide)
 - Fences
 - O+M Buildings
 - Substation area
 - MV Switchroom
 - Stormwater Management
 - Firefighting Water Tanks
 - Vegetation Screening
 - Areas of Cultural Heritage Sensitivity
 - Lot Boundaries
 - Fire Hydrants

00	PRELIMINARY	SC	17-07-2026
REV	DESCRIPTION	BY	DATE

FOR INFORMATION ONLY	
Australian Renewable Energy Services	
PROJECT: Camperdown BESS	
DRAWING: ELEVATION - SUBSTATION	
SCALE: NTS	SHEET: 3 / 4
REVISION: 00	DATE: 17-07-2026
DIN A3	

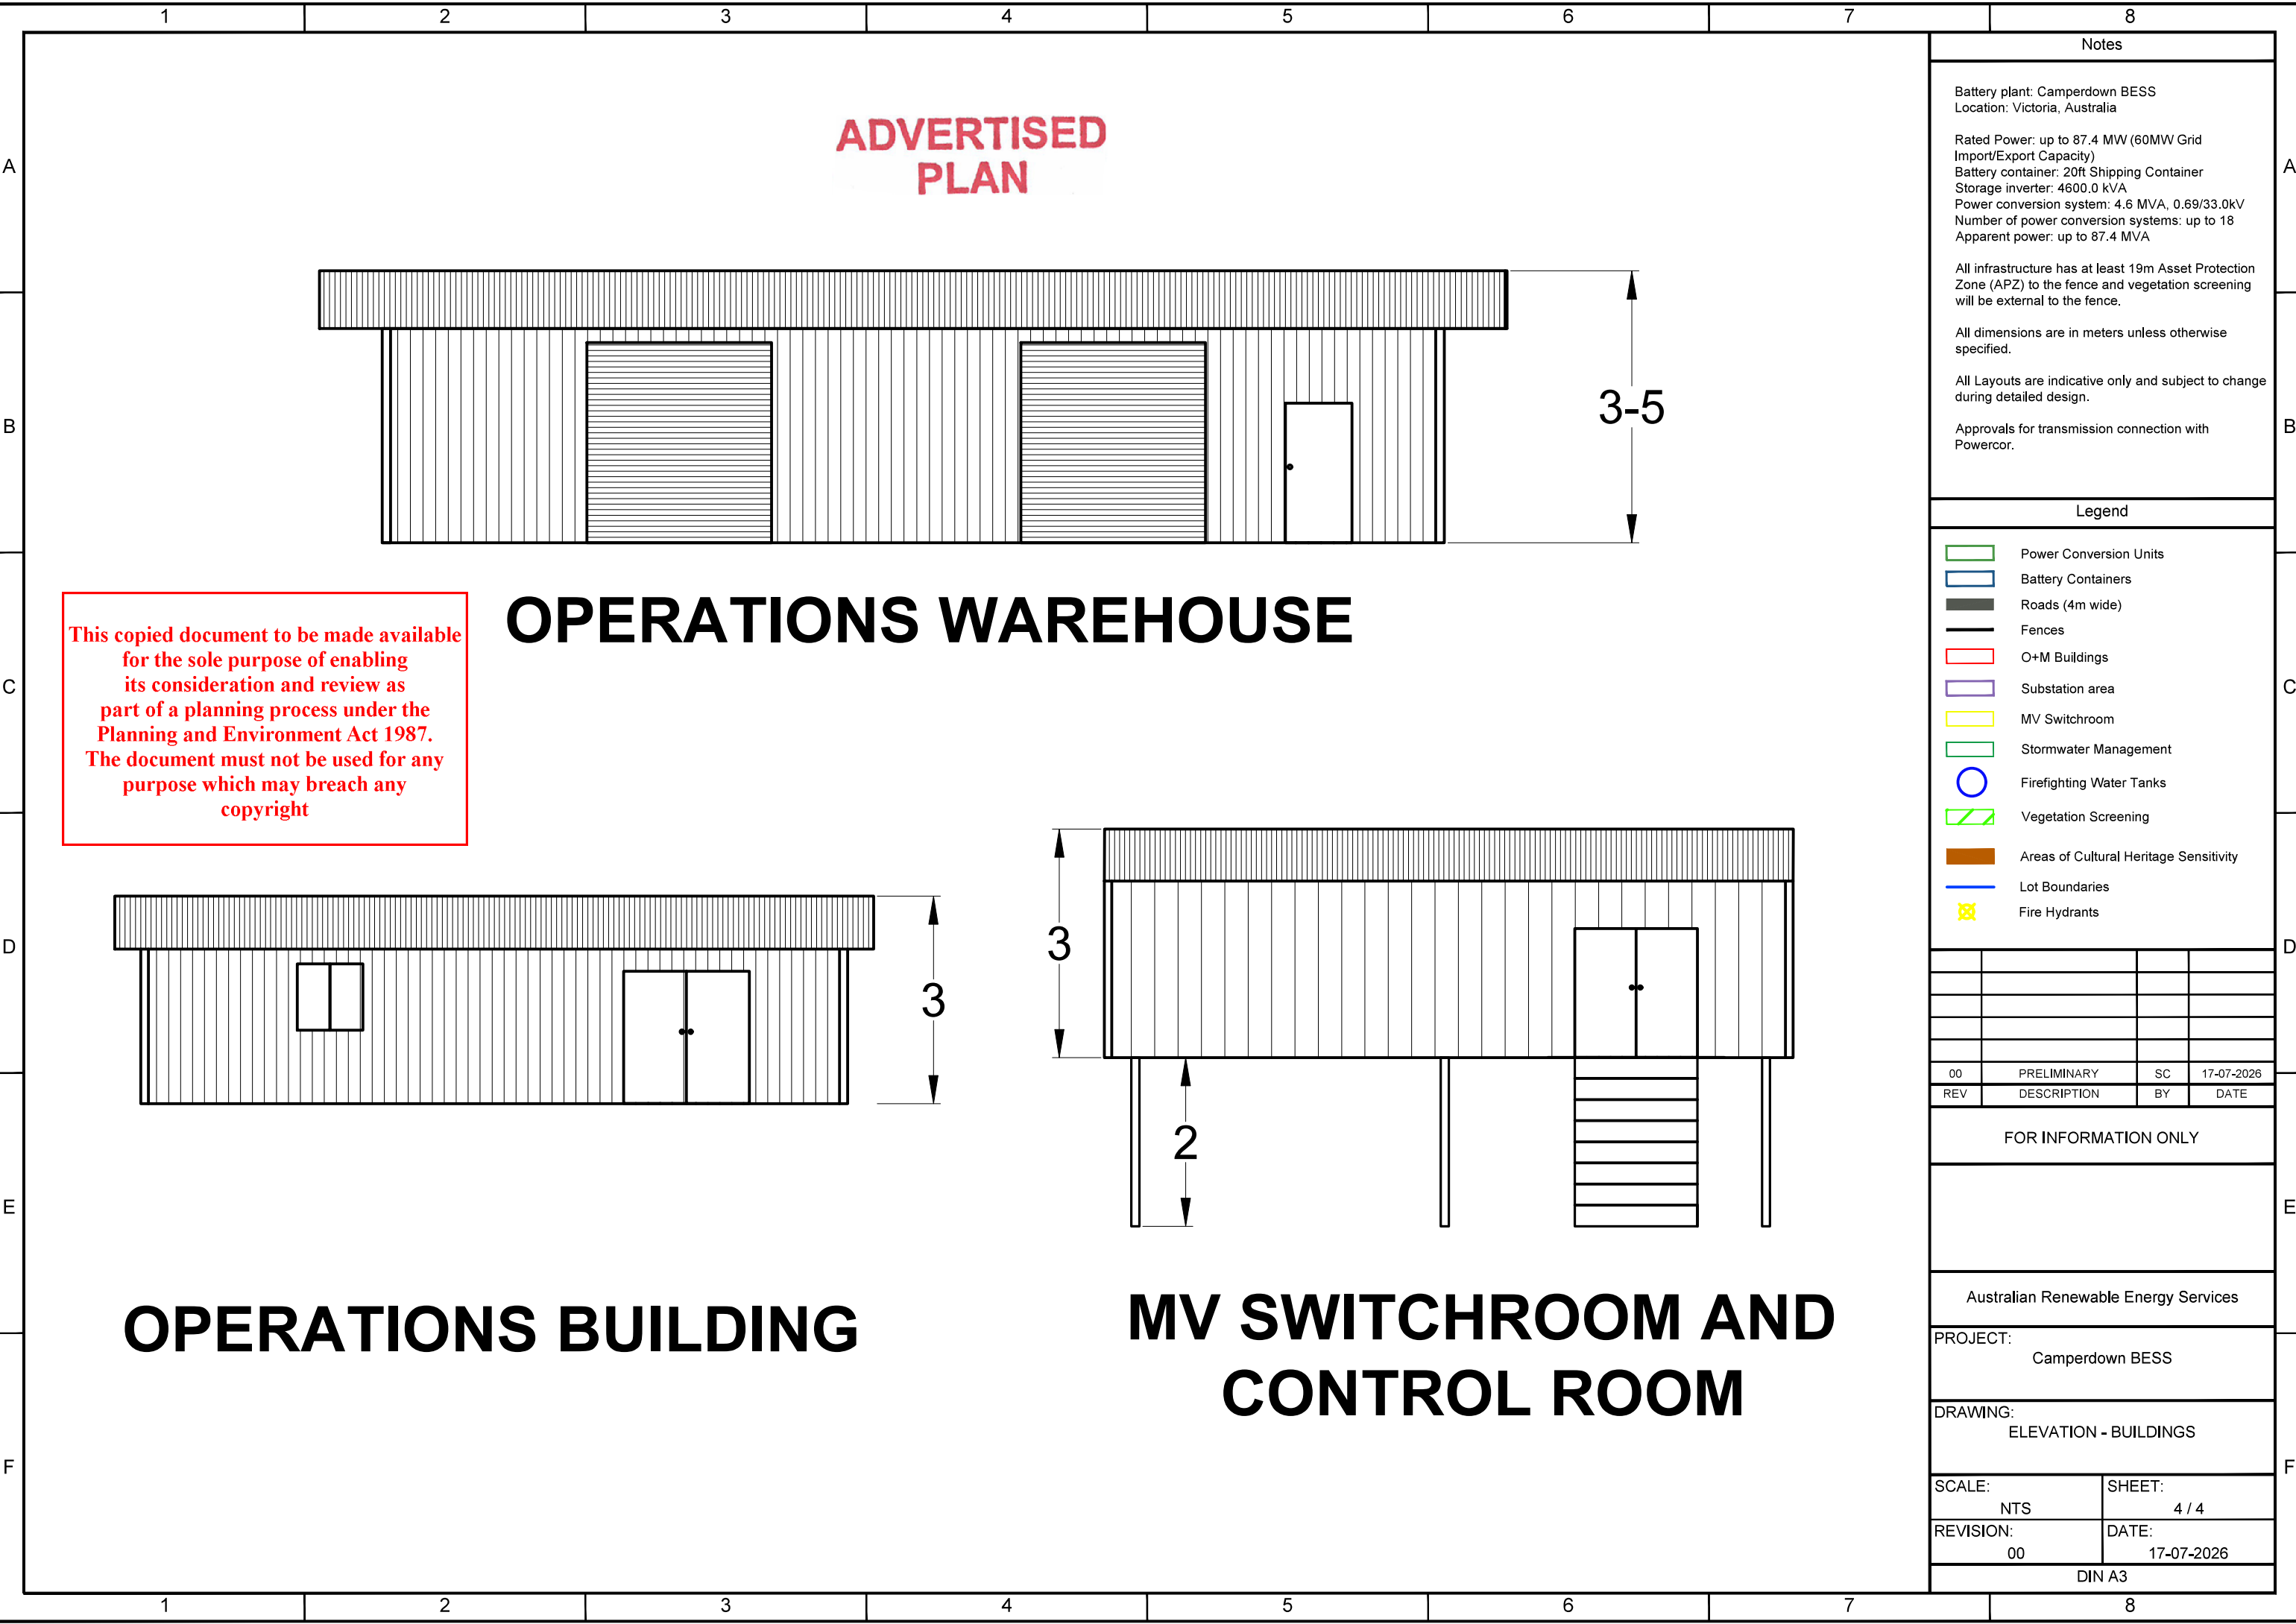


ADVERTISED
PLAN

3-5


OPERATIONS WAREHOUSE

This copied document to be made available
for the sole purpose of enabling
its consideration and review as
part of a planning process under the
Planning and Environment Act 1987.
The document must not be used for any
purpose which may breach any
copyright

3

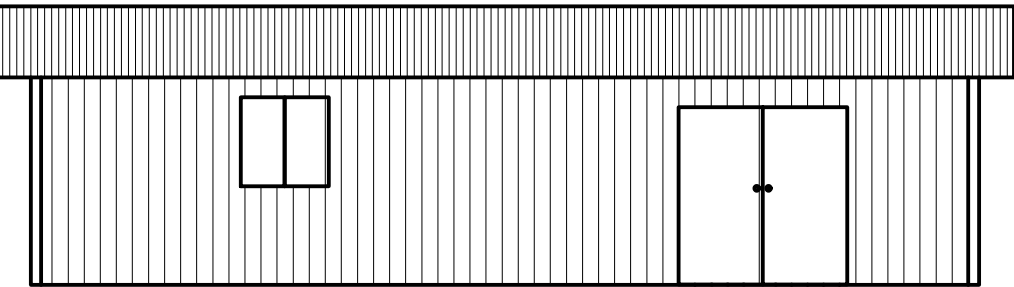

OPERATIONS BUILDING

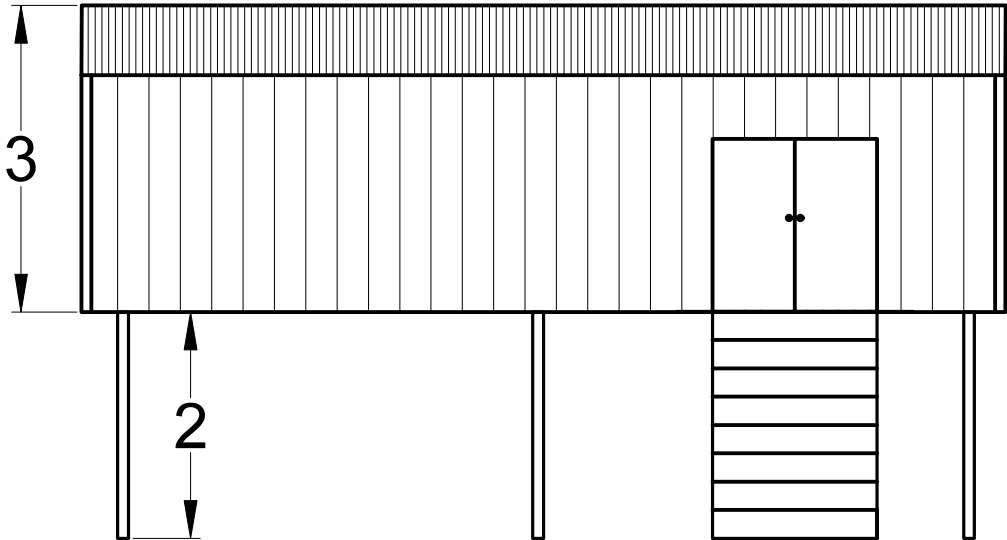

MV SWITCHROOM AND
CONTROL ROOM

2

Notes

Battery plant: Camperdown BESS
Location: Victoria, Australia

Rated Power: up to 87.4 MW (60MW Grid Import/Export Capacity)
Battery container: 20ft Shipping Container
Storage inverter: 4600.0 kVA
Power conversion system: 4.6 MVA, 0.69/33.0kV
Number of power conversion systems: up to 18
Apparent power: up to 87.4 MVA

All infrastructure has at least 19m Asset Protection Zone (APZ) to the fence and vegetation screening will be external to the fence.

All dimensions are in meters unless otherwise specified.

All Layouts are indicative only and subject to change during detailed design.

Approvals for transmission connection with Powercor.

Legend

Power Conversion Units

Battery Containers

Roads (4m wide)

Fences

O+M Buildings

Substation area

MV Switchroom

Stormwater Management

Firefighting Water Tanks

Vegetation Screening

Areas of Cultural Heritage Sensitivity

Lot Boundaries

Fire Hydrants

00	PRELIMINARY	SC	17-07-2026
REV	DESCRIPTION	BY	DATE
FOR INFORMATION ONLY			
Australian Renewable Energy Services			
PROJECT: Camperdown BESS			
DRAWING: ELEVATION - BUILDINGS			
SCALE: NTS		SHEET: 4 / 4	
REVISION: 00		DATE: 17-07-2026	
DIN A3			