



Vipac Engineers and Scientists Limited
279 Normanby Rd, Port Melbourne, VIC 3207, Australia
Private Bag 16, Port Melbourne, VIC 3207, Australia
t. +61 3 9647 9700 | e. melbourne@vipac.com.au
w. www.vipac.com.au | A.B.N. 33 005 453 627 | A.C.N. 005 453 627

DC Atherton Pty Ltd

55 - 61 Atherton Road, Oakleigh

Wind Impact Assessment



**ADVERTISED
PLAN**

30N-25-0038-TNT-98673-2

11 June 2026

Job Title:	55 - 61 Atherton Road, Oakleigh		
Report Title:	Wind Impact Assessment		
Document Reference:	30N-25-0038-TNT-98673-2		
Prepared For:	DC Atherton Pty Ltd		Prepared By:
		Vipac Engineers and Scientists Limited 279 Normanby Rd, Port Melbourne, VIC 3207, Australia	
Contact:	Katherine Bush		Tel: +61 3 9647 9700
Tel:	0415343286		
Author:	Eric Yuen	Wind Team Leader	
	11 Jun 2026		
Reviewer:	Peyman Mayeli	Senior Engineer	
	3 Jun 2026		
Issued By:	Samuel Gewargis	Project Engineer	
	11 Jun 2026		
This copied document to be made available for the sole purpose of enabling its consideration and review as part of a planning process under the Planning and Environment Act 1987. The document must not be used for any purpose which may breach any copyright			
Revision History:			
Rev. #	Comments / Details of change(s) made	Date	Revised by:
Rev. 00	Original issue	13 May 2025	
Rev. 01	Updated to entity	30 May 2025	EY
Rev. 02	Updated Architectural Drawings.	03 Jun 2026	SG

NOTE: This report has been prepared solely for the benefit of the client to whom this report is addressed for use herein ("Client") unless otherwise agreed in writing by Vipac Engineers and Scientists Limited ACN 005 453 627 ("Vipac"). Neither the whole of this report or any part of it may be published, duplicated or circulated without the prior written approval of Vipac except as required by law. Vipac does not assume any responsibility or liability for any losses suffered as a result of the publication, duplication or circulation of this report and excludes all liability whatsoever to any third party who may use or rely on the whole, or any part of this report.

Vipac has prepared this report using all reasonable care, skill and due diligence within the time period, budget and resources allocated to Vipac as agreed with the Client. Vipac excludes all liability to the Client whatsoever, whether in whole or in part, for the Client's use or reliance on the report other than for the purposes set out in the report, or any matters outside the agreed scope of the work.

For the purposes of preparing this report, reliance has been placed upon the material, representations, information and instructions provided to Vipac unless otherwise stated in the report. Originals of documents provided have not been required and no audit or examination of the validity of the documentation, representations, information or instructions provided has been undertaken except to the extent otherwise stated in this report. Information and findings contained in this report are based on Vipac's interpretation of data collected.

This document contains commercial, conceptual, engineering and other information that is proprietary to Vipac. The inclusion of this information in the report does not grant the Client any license to use the information without Vipac's prior written permission.

**ADVERTISED
PLAN**

Executive Summary

DC Atherton Pty Ltd commissioned Vipac Engineers and Scientists Ltd to prepare a statement of wind effects for the ground level areas adjacent to the proposed development at **55 - 61 Atherton Road, Oakleigh**. This appraisal is based on Vipac's experience as a wind-engineering consultancy.

Drawings of the proposed development were provided by **Peddle Thorp** in May 2026.

The findings of this study can be summarized as follows:

With proposed design:

- Wind conditions in the ground level footpath areas and access ways would be expected to be within the **walking** comfort criterion.
- The main entrances would be expected to be within the **standing** comfort criterion.
- Most of the terraces and balconies would be expected to be within the recommended **walking** comfort criterion. The balconies at the building corners might have some high wind conditions depending on the balustrade heights and partitions between the units.
- Wind gusts are expected to be within the recommended **safety** criterion.

As a general statement, educating occupants about wind conditions at open terrace/balcony areas during high-wind events and fixing loose, lightweight furniture on the terrace is highly recommended.

The assessments provided in this report have been made based on experience of similar situations in Melbourne and around the world. As with any opinion, it is possible that an assessment of wind effects based on experience and without experimental validation may not account for all complex flow scenarios in the vicinity.

Vipac recommends a scaled wind tunnel test or CFD simulation to be conducted at the detail design stage to quantify the wind conditions and determine the proper wind controls wherever necessary.

based on experience and without experimental validation may not account for all complex flow scenarios in the vicinity.

ADVERTISED PLAN

**This copied document to be made available
for the sole purpose of enabling
its consideration and review as
part of a planning process under the
Planning and Environment Act 1987.
The document must not be used for any
purpose which may breach any
copyright**

Table of Contents

1	Introduction	5
2	Analysis Approach	7
2.1	Site Exposure	8
2.2	Regional Wind Climate.....	9
2.3	Building Geometry and Orientation	10
2.4	Flow interactions with Adjacent Developments.....	11
2.5	Assessment Criteria	12
2.5.1	Use of Adjacent Pedestrian Occupied Areas & Recommended Comfort Criteria.....	13
2.5.2	Terrace / Balcony Recommended Criterion Discussion	13
3	Pedestrian Level Wind Effects.....	15
3.1	Discussion & Recommendations	15
4	Conclusions	16
Appendix A	Environmental Wind Effects	17
Appendix B	References	18
Appendix C	Drawings List.....	19

ADVERTISED PLAN

**This copied document to be made available
for the sole purpose of enabling
its consideration and review as
part of a planning process under the
Planning and Environment Act 1987.
The document must not be used for any
purpose which may breach any
copyright**

1 Introduction

Vipac Engineers and Scientists has been commissioned by **DC Atherton Pty Ltd** to carry out an appraisal of the pedestrian wind effects at the ground level of the proposed development at **55 - 61 Atherton Road, Oakleigh**.

Strong winds in pedestrian areas are frequently encountered in central business districts of cities around the world, including Sydney, Melbourne and Brisbane. Wind characteristics such as the mean speed, turbulence and ambient temperature determine the extent of disturbance to users of pedestrian areas. These disturbances can cause both comfort and safety problems and require careful consideration to mitigate successfully.

The proposed development is a 15-storey residential building with a roof height of 54m from the ground level. The site is bounded by Atherton Road to the south, Atkinson Street to the East, a 2-4 storeys car park to the north and existing development to the west. A satellite image of the proposed development site and a 3D perspective view of the building are shown in Figure 1 and Figure 2, respectively.

This report details the opinion of Vipac as an experienced wind engineering consultancy regarding the wind effects in ground level footpath areas adjacent to the development as proposed. No wind tunnel testing has been carried out for this development at this stage. Vipac has carried out wind tunnel studies on many developments of similar shape and having similar exposure to that of the proposed development. These serve as a valid reference for the prediction of wind effects. Empirical data for typical buildings in boundary layer flows has also been used to estimate the likely wind conditions on the ground level areas of the proposed development [2] & [3].

Drawings of the proposed development were supplied to Vipac by **Peddle Thorp** in May 2026. A list of drawings supplied is provided in Appendix C of this report.



Figure 1: Aerial view of the proposed development site.

**ADVERTISED
PLAN**



Figure 2: A 3D perspective view of the proposed development.

**This copied document to be made available
for the sole purpose of enabling
its consideration and review as
part of a planning process under the
Planning and Environment Act 1987.
The document must not be used for any
purpose which may breach any
copyright**

**ADVERTISED
PLAN**

2 Analysis Approach

In assessing whether a proposed development is likely to generate adverse wind conditions in ground level footpath areas, Vipac has considered the following five main points:

- The exposure of the proposed development to wind.
- The regional wind climate.
- The geometry and orientation of the proposed development.
- The interaction of flows with adjacent developments.
- The assessment criteria determined by the intended use of the areas affected by wind flows generated or augmented by the proposed development.

The pedestrian wind comfort at specific locations of ground level footpath areas may be assessed by predicting the gust and mean wind speeds with a probability of 0.1% and 20% expected at that location. The location may be deemed generally acceptable for its intended use while gust and mean wind speeds are within the threshold values noted in Section 2.5. Where Vipac predicts that a location would not meet its appropriate comfort criterion, the use of wind control devices and/or local building geometry modifications to achieve the desired comfort rating may be recommended. For complex flow scenarios or where predicted flow conditions are well more than the recommended criteria, Vipac recommends scale model wind tunnel testing to determine the type and scope of the wind control measures required to achieve acceptable wind conditions.

**This copied document to be made available
for the sole purpose of enabling
its consideration and review as
part of a planning process under the
Planning and Environment Act 1987.
The document must not be used for any
purpose which may breach any
copyright**

**ADVERTISED
PLAN**

2.1 Site Exposure

The proposed development is located on a relatively flat terrain. The site is surrounded within an approximately 3 km radius predominately by suburban dwellings; A satellite image showing these site surroundings is shown in Figure 3.

Considering the immediate surroundings and terrain, for the purposes of this study, the site of the proposed development is assumed to be within Terrain Category 3 for all wind directions (Figure 3).



Figure 3: Assumed terrain categories for wind speed estimation.

This copied document to be made available
for the sole purpose of enabling
its consideration and review as
part of a planning process under the
Planning and Environment Act 1987.
The document must not be used for any
purpose which may breach any
copyright

**ADVERTISED
PLAN**

2.2 Regional Wind Climate

The mean and gust wind speeds have been recorded in the Melbourne area for over 30 years. This data has been analysed and the directional probability distribution of wind speeds has been determined. The directional distribution of hourly mean wind speed at the gradient height, with a probability of 0.1% of time and 20% of time exceeded are shown in Figure 4. The wind data at this free stream height is common to all Melbourne city sites and may be used as a reference to assess ground level wind conditions at the site.

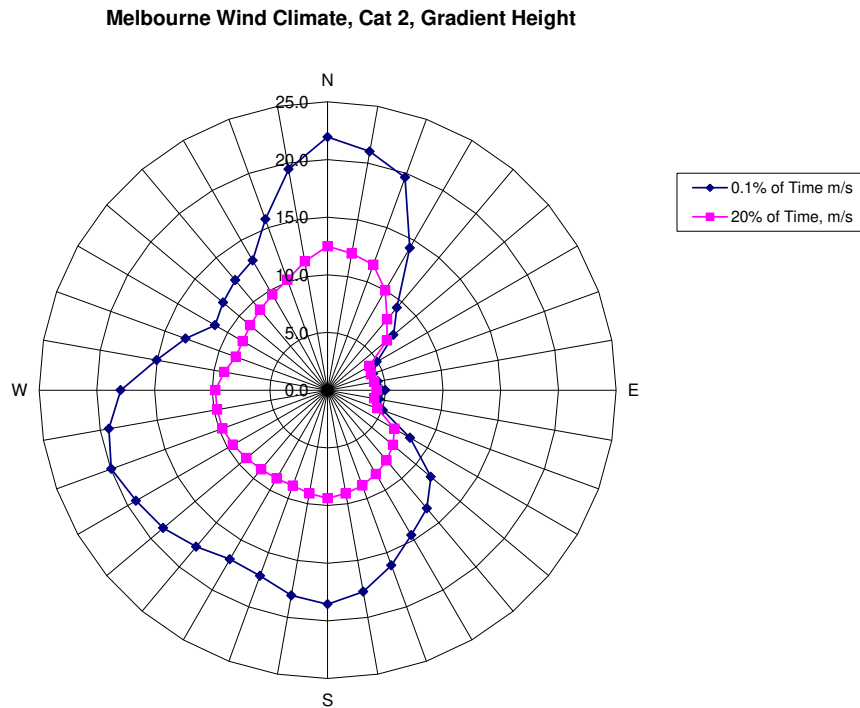


Figure 4: Directional Distribution of Mean Hourly Wind Velocities (m/s) for 0.1% and 20% exceeded at Gradient Height for Melbourne.

**ADVERTISED
PLAN**

This copied document to be made available
for the sole purpose of enabling
its consideration and review as
part of a planning process under the
Planning and Environment Act 1987.
The document must not be used for any
purpose which may breach any
copyright

2.3 Building Geometry and Orientation

The proposed development is a 15-storey mixed-use building. The overall plan-form dimensions are approximately 40.92m x 38.17 m as shown in Figure 5. The main entrances are located on two streetscapes. The development incorporates tower setbacks from all surrounding street boundaries.

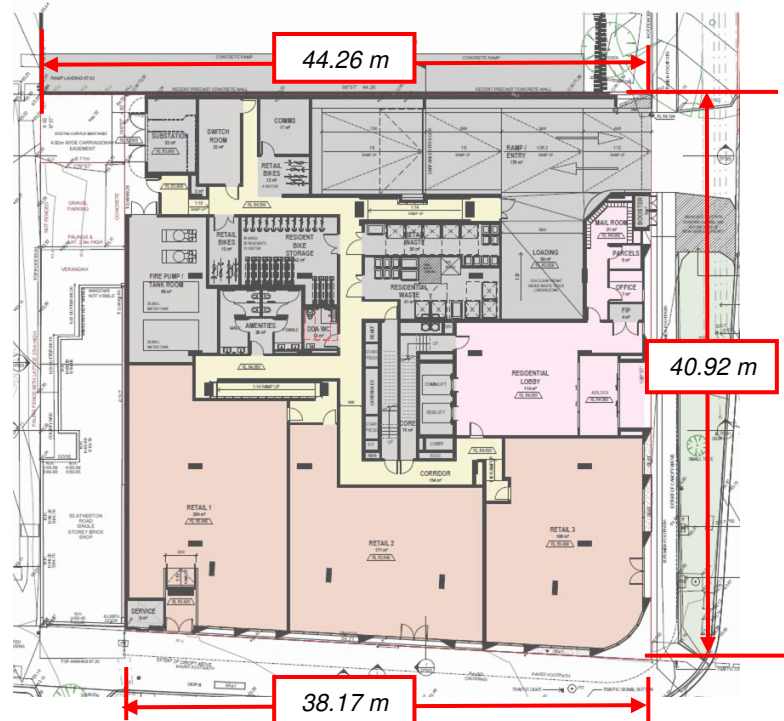


Figure 5: Ground floor plan with the overall dimensions overlaid.

This copied document to be made available for the sole purpose of enabling its consideration and review as part of a planning process under the Planning and Environment Act 1987. The document must not be used for any purpose which may breach any copyright

**ADVERTISED
PLAN**

2.4 Flow interactions with Adjacent Developments

The immediately adjacent developments are 1 to 6 storeys and shown in Figure 6. At ground level, the site is exposed to prevailing winds from the northerly and westerly directions channelling along Atherton Road and Atkinson Street. The development is taller than the surrounding buildings and so is exposed to winds from all directions at the upper levels.



Figure 6: Immediately adjacent surroundings and their approximate number of floors (F).

**ADVERTISED
PLAN**

This copied document to be made available for the sole purpose of enabling its consideration and review as part of a planning process under the Planning and Environment Act 1987. The document must not be used for any purpose which may breach any copyright

2.5 Assessment Criteria

The following wind comfort criteria detailed in Table 1 were applied in this study.

Table 1: Wind Comfort Criteria as per Clause 58.04-4

Unsafe	Comfortable
Annual maximum 3 second gust wind speed exceeding 20m/sec with a probability of exceedance of 0.1% considering at least 16 wind directions.	Hourly mean wind speed or gust equivalent mean speed from all wind directions combined with probability of exceedance less than 20% of the time, equal to or less than: 3m/sec for sitting areas (outdoor cafés) 4m/sec for standing areas (window shopping, queuing) 5m/sec for walking areas (steady steps for most pedestrians)

This criterion specifically calls for the safety criterion to be used to assess infrequent winds (e.g. peak event of $\leq 0.1\%$ of the time); and the perceived pedestrian comfort to be assessed based on frequently occurring winds (e.g. winds that occurs 80% of the time).

In Table 1, the mean wind velocity is defined as the maximum of hourly mean or gust equivalent mean ($\text{Gust}/1.85$)

This criterion specifies that safe and comfortable wind conditions must be achieved in publicly accessible areas within a distance equal to half the longest width of the building measured from all facades or half the overall height of the building, whichever is greater, as shown in Figure 7.

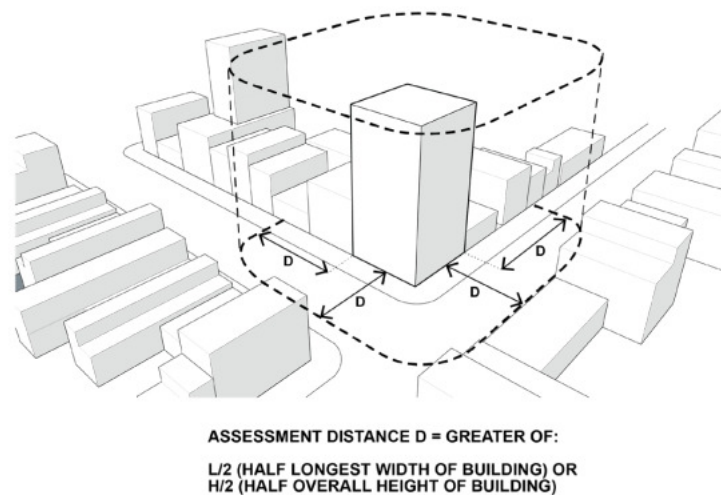


Figure 7: Assessment distance.

This copied document to be made available for the sole purpose of enabling its consideration and review as part of a planning process under the Planning and Environment Act 1987. The document must not be used for any purpose which may breach any copyright

ADVERTISED
PLAN

2.5.1 Use of Adjacent Pedestrian Occupied Areas & Recommended Comfort Criteria

The consideration of the (intended) function of the environment heavily influences the appropriateness of the recommended wind comfort criteria. For example, people frequenting locations such as parks are will likely tolerate a windier environment when compared to people dining at an outdoor café.

This is partly due to the pedestrian's judgement in clothing and predetermined expectation of the wind environment and partly due to the sensitivity of their activities to wind. For example, patrons at outdoor dining areas are highly sensitivity to wind due to the stationary nature of the activity; whereas pedestrians on the public footpaths may maintain a level of comfort under otherwise uncomfortable conditions by partaking in general activities performed on the footpath such as walking.

The following table lists the specific areas adjacent to the proposed development and the corresponding recommended criteria.

Table 2: Recommended application of criteria

Area	Specific location	Recommended Criteria
Public Footpaths, Access ways	Along Atkinson Street, Atherton Rad, the load to the west (Figure 8)	Walking
Building Entrances	Main Building Entrances at Atkinson Street and Atherton Road (Figure 8)	Standing
Balcony/Terraces	Up the height of the building (Figure 9)	Walking (See discussion below)

2.5.2 Terrace / Balcony Recommended Criterion Discussion

There are Private Balconies located up the height of the development. Vipac recommends as a minimum that balcony/terrace areas meet the criterion for walking since:


- these areas are not public spaces;
- the use of these areas is optional, and only intended to be used on fair weather days with calm winds;
- residents at private open spaces can chose to retreat indoors during uncomfortable wind conditions, while a pedestrian or person using a public area may not have this option.
- many similar developments in Melbourne and other Australian capital cities experience wind conditions on balconies and elevated deck areas in the vicinity of the criterion for walking.

This copied document to be made available for the sole purpose of enabling its consideration and review as part of a planning process under the Planning and Environment Act 1987. The document must not be used for any purpose which may breach any copyright

**ADVERTISED
PLAN**



This copied document to be made available for the sole purpose of enabling its consideration and review as part of a planning process under the Planning and Environment Act 1987. The document must not be used for any purpose which may breach any copyright

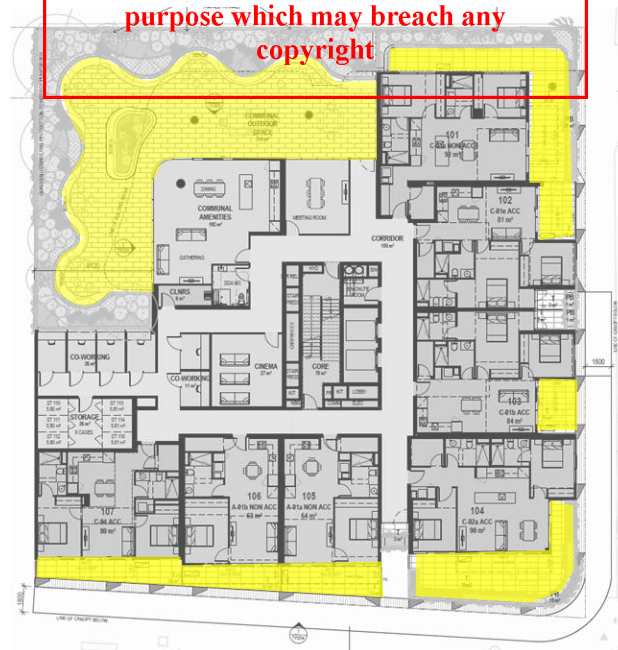

Recommended to fulfil Walking

Figure 9: Level 1 floor plan with recommended wind criteria overlaid.

**ADVERTISED
PLAN**

3 Pedestrian Level Wind Effects

3.1 Discussion & Recommendations

The proposed design has several features that are expected to be beneficial to the pedestrian wind environment. This is inclusive but not limited to the following:

- Residential entrances away from building corners.
- Balconies/terraces up on all facades and round tower corners.

Due to the proposed height above the surrounding areas, the proposed development is particularly exposed to adverse northerly, westerly, and southerly winds. Such that high wind levels are expected along Atherton Road and Atkinson Street and the southeast corner. However, the proposed development has balcony wrapped tower design from level 1 upwards. These high roughness facades in combination with the curved tower form are expected to be beneficial to the wind environment on the ground floor; such that the surrounding pedestrian streetscape is expected to be within the recommended walking comfort criterion.

The main entrances are located along Atherton Road and Atkinson Street and away from building corners. These entrances are expected to be within the recommended standing comfort criterion.

Most terraces on level 1 are expected to have windspeeds within the walking comfort criterion. However, the areas at building corners might have some high wind conditions.

Most balconies/terraces on other levels are expected to have windspeeds within the walking comfort criterion. However, the building corner balconies, particularly at the high levels, might experience the high wind conditions. In general, the higher, the balustrades, the better the wind conditions of balconies. At this stage, the balustrade heights have not been specified. We recommend a scaled wind tunnel test or CFD simulation to be conducted to determine proper balustrade heights and other wind control measures wherever necessary.

The gust wind speeds are expected to be within safety criterion.

It should be noted that this study is based on experience only and has not utilised any experimental data for the analysis.

**This copied document to be made available
for the sole purpose of enabling
its consideration and review as
part of a planning process under the
Planning and Environment Act 1987.
The document must not be used for any
purpose which may breach any
copyright**

**ADVERTISED
PLAN**

4 Conclusions

An appraisal of the likely wind conditions at the pedestrian ground level and terrace areas of the proposed development at **55 - 61 Atherton Road, Oakleigh** has been made.

Vipac has carefully considered the form and exposure of the proposed development, nominated criteria for various public areas according to their function and referred to past experience to produce our opinion of likely wind conditions.

The findings of this study can be summarised as follows.

With proposed design:

- Wind conditions in the ground level footpath areas and access ways would be expected to be within the **walking** comfort criterion.
- The main entrances would be expected to be within the **standing** comfort criterion.
- Most of the terraces and balconies would be expected to be within the recommended **walking** comfort criterion. The balconies at the building corners might have some high wind conditions depending on the balustrade heights and partitions between the units.
- Wind gusts are expected to be within the recommended **safety** criterion.

As a general statement, educating occupants about wind conditions at open terrace/balcony areas during high-wind events and fixing loose, lightweight furniture on the terrace is highly recommended.

The assessments provided in this report have been made based on experience of similar situations in Melbourne and around the world. As with any opinion, it is possible that an assessment of wind effects based on experience and without experimental validation may not account for all complex flow scenarios in the vicinity.

Vipac recommends a scaled wind tunnel test be conducted at the detail design stage to quantify the wind conditions and determine the proper wind controls wherever necessary.

This Report has been Prepared

For

DC Atherton Pty Ltd

By

VIPAC ENGINEERS & SCIENTISTS PTY LTD.

**ADVERTISED
PLAN**

**This copied document to be made available
for the sole purpose of enabling
its consideration and review as
part of a planning process under the
Planning and Environment Act 1987.
The document must not be used for any
purpose which may breach any
copyright**

Appendix A Environmental Wind Effects

Atmospheric Boundary Layer

As wind flows over the earth it encounters various roughness elements and terrain such as water, forests, houses, and buildings. To varying degrees, these elements reduce the mean wind speed at low elevations and increase air turbulence. The wind above these obstructions travels with unattenuated velocity, driven by atmospheric pressure gradients. The resultant increase in wind speed with height above ground is known as a wind velocity profile. When this wind profile encounters a tall building, some of the fast-moving wind at upper elevations is diverted down to ground level resulting in local adverse wind effects.

The terminology used to describe the wind flow patterns around the proposed development is based on the aerodynamic mechanism, direction, and nature of the wind flow.



Downwash – refers to a flow of air down the exposed face of a tower. A tall tower can deflect a fast-moving wind at higher elevations downwards.

Corner accelerations – when wind flows around the corner of a building it tends to accelerate in a similar manner to airflow over the top of an aeroplane wing.

Flow separation – when wind flowing along a surface suddenly detaches from that surface and the resultant energy dissipation produces increased turbulence in the flow. Flow separation at a building corner or at a solid screen can result in gusty conditions.

Flow channelling – the well-known “street canyon” effect occurs when a large volume of air is funnelled through a constricted pathway. To maintain flow continuity the wind must speed up as it passes through the constriction. Examples of this might occur between two towers, in a narrowing street or under a bridge.

Direct exposure – a location with little upstream shielding for a wind direction of interest. The location will be exposed to the unabated mean wind and gust velocity. Piers and open water frontage may have such exposure.

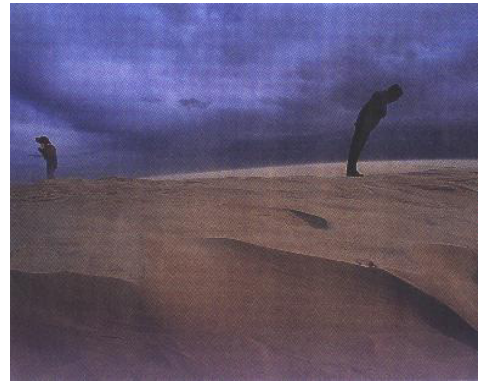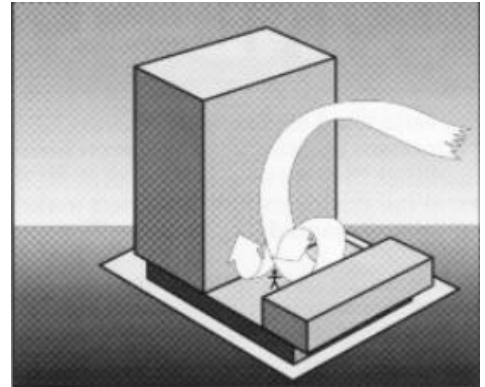

ADVERTISED
PLAN

This copied document to be made available
for the sole purpose of enabling
its consideration and review as
part of a planning process under the
Planning and Environment Act 1987.
The document must not be used for any
purpose which may breach any
copyright

Appendix B References

- [1] *Structural Design Actions, Part 2: Wind Actions*, Australian/New Zealand Standard 1170.2:2011.
- [2] *Wind Effects on Structures* E. Simiu, R Scanlan, Publisher: Wiley-Interscience.
- [3] *Architectural Aerodynamics* R. Aynsley, W. Melbourne, B. Vickery, Publisher: Applied Science Publishers.
- [4] *The Aerodynamic Characteristics of Windbreaks, Resulting in Empirical Design Rules* J. Gandemer, Publisher: *Journal of Wind Engineering and Industrial Aerodynamics*.
- [6] *Wind Protection by Model Fences in a simulated Atmospheric Boundary Layer* J.K. Rain, D.C. Stevenson, Publisher: *Journal of Industrial Aerodynamics*, 2.
- [7] *Criteria for Environmental Wind Conditions* W.H Melbourne, Publisher: *Journal of Wind Engineering and Industrial Aerodynamics*.
- [8] *Wind Design Guide* J. Bennett Publisher: *BBSC 433 – Architectural Aerodynamics*.
- [9] *Central City Built Form Review: Wind Assessments*, Global Wind Technology Services.
- [10] *Wind Guidelines for Planning Applicants* H. Fricke Publisher: *Moonee Valley City Council*.

**This copied document to be made available
for the sole purpose of enabling
its consideration and review as
part of a planning process under the
Planning and Environment Act 1987.
The document must not be used for any
purpose which may breach any
copyright**

**ADVERTISED
PLAN**

Appendix C Drawings List

Drawings Received: **May 2026**

3-23-0047_55-61 Atherton Road Oakleigh_DFP Townplanning Package 251022

Drawings Received: **May 2025**

3-23-0047_55-61 Artherton Road Oakleigh_DESIGN CONCEPT PACKAGE.pdf

**This copied document to be made available
for the sole purpose of enabling
its consideration and review as
part of a planning process under the
Planning and Environment Act 1987.
The document must not be used for any
purpose which may breach any
copyright**

**ADVERTISED
PLAN**